



**SIMPSON**

**Strong-Tie**



# STRONG-WALL® Shearwalls

## C-L-SW17





# Design Flexibility and Product Innovation







Every jobsite presents its own variety of parameters and requirements. Strong-Wall® shearwalls from Simpson Strong-Tie provide a system-oriented approach to building design that offers enhanced design flexibility and greater lateral-force resistance. With unsurpassed testing capabilities and field experience, our factory-built shearwalls maintain the industry's highest quality standards and meet code requirements for ICC-ES, City of Los Angeles and the State of Florida.

## Table of Contents

Introduction . . . . .	4
What's New . . . . .	5
Important Information and General Notes . . . . .	6

### **Steel Strong-Wall® 9**

Standard Application on Concrete Foundations . . . . .	10
Anchor Tension Equations . . . . .	15
Garage Portal Systems on Concrete Foundations . . . . .	16
Alternate Garage Front Options . . . . .	17
First-Story Wood Floor Systems . . . . .	18
Balloon Framing on Concrete Foundations . . . . .	20
Cumulative Overturning . . . . .	23
Two-Story Stacked on Concrete Foundations . . . . .	25
Cold-Formed Steel on Concrete Foundations . . . . .	28
Anchorage Solutions . . . . .	29
Anchor Reinforcement Solutions on Grade Beams . . . . .	34
Anchor Bolt Templates . . . . .	35

### **Strong-Wall® Wood Shearwall 36**

Applications . . . . .	37
Product and Kit Description . . . . .	38
Standard and Balloon Framing on Concrete Foundations . . . . .	40
Garage Portal Systems on Concrete Foundations . . . . .	45
Two-Story Stacked on Concrete Foundations . . . . .	48
Anchorage Solutions . . . . .	52
Anchor Reinforcement Solutions on Grade Beams . . . . .	58
Anchor Bolt Templates . . . . .	59

### **Anchorage and Installation Details 60**

Steel Strong-Wall . . . . .	61
Strong-Wall Wood Shearwall . . . . .	77

#### Product Identification Key

Products are divided into three general categories, identified by tabs along the page's outer edge.

**Steel Strong-Wall**

**9—35 ▶**

**Strong-Wall  
Wood Shearwall**

**36—59 ▶**

**Anchorage and  
Installation Details**

**60—93 ▶**

## Introduction

For more than 60 years, Simpson Strong-Tie has focused on creating structural products that help people build safer and stronger homes and buildings. A leader in structural systems research and technology, Simpson Strong-Tie is one of the largest suppliers of structural building products in the world. The Simpson Strong-Tie commitment to product development, engineering, testing and training is evident in the consistent quality and delivery of its products and services.

For more information, visit the company's website at [strongtie.com](http://strongtie.com).

### The Simpson Strong-Tie Company Inc. No-Equal Pledge® includes:

- Quality products value-engineered for the lowest installed cost at the highest-rated performance levels
- The most thoroughly tested and evaluated products in the industry
- Strategically located manufacturing and warehouse facilities
- National code agency listings
- The largest number of patented connectors in the industry
- Global locations with an international sales team
- In-house R&D and tool and die professionals
- In-house product testing and quality control engineers
- Support of industry groups including AISI, AITC, ASTM, ASCE, AWC, AWWA, ACI, AISC, CSI, CFSEI, ICFA, NBMDA, NLBMDA, SDI, SETMA, SFA, SFIA, STAFDA, SREA, NFBA, TPI, WDSC, WIJMA, WTCA and local engineering groups



## Simpson Strong-Tie® Quality Policy

We help people build safer structures economically. We do this by designing, engineering and manufacturing No-Equal structural connectors and other related products that meet or exceed our customers' needs and expectations. Everyone is responsible for product quality and is committed to ensuring the effectiveness of the Quality Management System.

**Karen Colonias**  
Chief Executive Officer

### We Are ISO 9001-2008 Registered



Simpson Strong-Tie is an ISO 9001-2008 registered company. ISO 9001-2008 is an internationally-recognized quality assurance system which lets our domestic and international customers know that they can count on the consistent quality of Simpson Strong-Tie® products and services.

## Getting Fast Technical Support

When you call for engineering technical support, we can help you quickly if you have the following information at hand. This will help us to serve you promptly and efficiently.

- Which Simpson Strong-Tie catalog are you using?  
(See the front cover for the catalog number)
- Which Simpson Strong-Tie product are you using?
- What is your application?
- What is your load requirement?
- What is your design code and building jurisdiction?
- Is your structure residential or commercial?

**(800) 999-5099 | [strongtie.com](http://strongtie.com)**



## What's New

### Simpson Strong-Tie® Strong-Wall® Wood Shearwall

The Strong-Wall wood shearwall (WSW) is a specially designed, prefabricated, engineered wood panel that helps structures resist lateral forces such as those generated by earthquakes and high winds. The WSW is field-customizable and can be trimmed and drilled. It features front, side- and back-access holdowns that allow for easier installation

and inspection. Reusable templates locate the required holdown anchor bolts accurately in the foundation. The WSW is suitable for residential, multi-family and light-frame commercial construction and in balloon-framing applications up to 20' tall.

### Strong-Wall Shearwalls Code Reports

Simpson Strong-Tie received code listing under the 2015 IRC/IBC for Steel Strong-Wall® shearwalls (ICC-ES ESR-1679). Steel Strong-Wall shearwalls conform to the latest ICC-ES Acceptance Criteria (AC322), and they have the most code-listed prefabricated shearwall applications in the industry. Code-listed applications include installation on concrete foundations, first-story wood-floor and two-story stacked-wall systems, balloon framing and cold-formed steel applications.

Simpson Strong-Tie Strong-Wall wood shearwalls are also code listed under the 2015 IRC/IBC (ICC-ES ESR-2652) and conform to the latest ICC-ES Acceptance Criteria (AC130).

Both the Steel Strong-Wall and Strong-Wall wood shearwalls are now code listed with grade-beam anchorage solutions.

### Original Wood Strong-Wall Phasing Out in 2018

The original wood Strong-Wall shearwall is being phased out. We will guarantee availability until December 31, 2018, and will continue to sell them so long as inventory remains. We will support them on the website

and in their code report beyond that date. We recommend considering the new Strong-Wall wood shearwall as a replacement.

### New Strong-Wall Shearwall Selector Web Application

The latest version of the Simpson Strong-Tie Strong-Wall Shearwall Selector web application provides a convenient, Web-based experience that eliminates the need to download software. The selector has been updated to the 2015 International Building Code (IBC). It provides

complete Strong-Wall and anchorage solutions utilizing the Strong-Wall wood shearwall and the Steel Strong-Wall shearwall, as well as the original wood Strong-Wall.

### Strong-Wall® Shearwall Selector Application

This application helps design professionals select an appropriate Simpson Strong-Tie Steel Strong-Wall, Strong-Wall wood shearwall or original wood Strong-Wall system.

#### Optimized Solution

Provides the most cost-effective Strong-Wall solution based on the input shear load.

#### Manual Solution

Allows designers to choose which type and number of walls meet their requirements.

- ◆ Finds lowest cost solution
- ◆ Provides actual drift and uplift values
- ◆ Provides solutions for different model Codes
- ◆ Includes new anchorage solutions
- ◆ Saves, exports and prints solutions

You can find the Strong-Wall Shearwall Selector application at [strongtie.com/webapps/strongwallshearwallselector](http://strongtie.com/webapps/strongwallshearwallselector).





# Important Information and General Notes

## Warning

Simpson Strong-Tie Company Inc. structural connectors, anchors, and other products are designed and tested to provide specified design loads. To obtain optimal performance from Simpson Strong-Tie Company Inc. products and achieve maximum allowable design load, the products must be properly installed and used in accordance with the installation instructions and design limits provided by Simpson Strong-Tie Company Inc. To ensure proper installation and use, designers and installers must carefully read the following General Notes, General Instructions For The Installer and General Instructions For The Designer, as well as consult the applicable catalog pages for specific product installation instructions and notes.

Proper product installation requires careful attention to all notes and instructions, including these basic rules:

1. Be familiar with the application and correct use of the product.
2. Follow all installation instructions provided in the applicable catalog, website, Installer's Pocket Guide or any other Simpson Strong-Tie publications.
3. Install all required fasteners per installation instructions provided by Simpson Strong-Tie Company Inc.: a) use proper fastener type; b) use proper fastener quantity; c) fill all fastener holes; d) do not overdrive or underdrive nails, including when using gun nailers; and e) ensure screws are completely driven.
4. Only bend products that are specifically designed to be bent. For those products that require bending, do not bend more than once.

In addition to following the basic rules provided above as well as all notes, warnings and instructions provided in the catalog, installers, designers, engineers and consumers should consult the Simpson Strong-Tie Company Inc. website at [www.strongtie.com](http://www.strongtie.com) to obtain

additional design and installation information, including:

- Instructional builder/contractor training kits containing an instructional video, an instructor guide and a student guide in both English and Spanish;
- Information on workshops Simpson Strong-Tie conducts at various training centers throughout the country;
- Product specific installation videos;
- Specialty catalogs;
- Code reports;
- Technical fliers and bulletins;
- Engineering letters;
- Master format specifications;
- Material safety data sheets;
- Corrosion information;
- Simpson Strong-Tie Autocad menu;
- Simpson Strong-Tie Strong-Wall® Selector web application; and
- Answers to frequently asked questions and technical topics.

Failure to fully follow all of the notes and instructions provided by Simpson Strong-Tie Company Inc. may result in improper installation of products. Improperly installed products may not perform to the specifications set forth in this catalog and may reduce a structure's ability to resist the movement, stress, and loading that occurs from gravity loads as well as impact events such as earthquakes and high velocity winds.

Simpson Strong-Tie Company Inc. does not guarantee the performance or safety of products that are modified, improperly installed or not used in accordance with the design and load limits set forth in this catalog.

## General Notes

**These general notes are provided to ensure proper installation of Simpson Strong-Tie Company Inc. products and must be followed fully.**

- a. Simpson Strong-Tie Company Inc. reserves the right to change specifications, designs and models without notice or liability for such changes.
- b. Steel used for each Simpson Strong-Tie® product is individually selected based on the product's steel specifications, including strength, thickness, formability, finish and weldability. Contact Simpson Strong-Tie for steel information on specific products.
- c. Unless otherwise noted, dimensions are in inches, loads are in pounds.
- d. Unless otherwise noted, welds, screws, bolts and nails may not be combined to achieve highest load value. 8d (0.131" x 2 1/2"), 10d (0.148" x 3") and 16d (0.162" x 3 1/2") specify common nails that meet the requirements of ASTM F1667. When a shorter nail is specified, it will be noted (for example 8d x 1 1/2"). Refer to Simpson Strong-Tie Nailing Guide, NDS (National Design Specification) and ASTM F1667 (American Society of Testing and Materials) for more nail info.
- e. Do not overload. Do not exceed catalog allowable loads, which would jeopardize the connection.
- f. Unless otherwise noted, allowable loads are for Douglas Fir-Larch under continuously dry conditions. Allowable loads for other species or conditions must be adjusted according to the code. The section from the AC13 criteria indicating the range of specific gravity reads as follows: 3.2.3 The species of lumber used shall have a specific

gravity not greater than 0.55 as determined in accordance with the NDS. This chart shows specific gravity and perpendicular-to-grain compression capacities for the different wood species:

Species	Fc1	Specific Gravity
Douglas Fir-Larch (DF)	625 psi	0.50
Southern Pine (SP)	565 psi	0.55
Spruce-Pine-Fir (SPF)	425 psi	0.42
Hem Fir (HF)	405 psi	0.43
Glulam	650 psi	0.50
LVL (DF/SP)	750 psi	0.50
LSL (E = 1.3 x 10 <sup>6</sup> )	680 psi	0.50
LSL (E ≥ 1.5 x 10 <sup>6</sup> )	880 psi	0.50
Parallam® PSL	750 psi	0.50

- g. All references to bolts or machine bolts (MBs) are for structural quality through bolts (not lag screws or carriage bolts) equal to or better than ASTM Standard A307, Grade A.
- h. Unless otherwise noted, bending steel in the field may cause fractures at the bend line. Fractured steel will not carry load and must be replaced.
- i. A fastener that splits the wood will not take the design load. Evaluate splits to determine if the connection will perform as required. Dry wood may split more easily and should be evaluated as required. If wood tends to split, consider pre-boring holes



# Important Information and General Notes

- with diameters not exceeding 0.75 of the nail diameter (2015 NDS 12.1.5.3). Use a  $\frac{3}{32}$ " bit for Strong-Drive® SDS Heavy-Duty Connector screws and a  $\frac{3}{32}$ " bit for Strong-Drive SD9/SD10 Connector screws.
- j. Wood shrinks and expands as it loses and gains moisture, particularly perpendicular to its grain. Take wood shrinkage into account when designing and installing connections. Simpson Strong-Tie manufactures products to fit common dry lumber dimensions. If you need a connector with dimensions other than those listed in this catalog, Simpson Strong-Tie may be able to vary connector dimensions; contact Simpson Strong-Tie. The effects of wood shrinkage are increased in multiple lumber connections, such as floor-to-floor installations. This may result in the vertical rod nuts becoming loose, requiring post-installation tightening. (Contact Simpson Strong-Tie for information on Takeup Devices.)
  - k. Built-up lumber (multiple members) must be fastened together to act as one unit to resist the applied load (excluding the connector fasteners). This must be determined by the Designer.
  - l. Some model configurations may differ from those shown in this catalog. Contact Simpson Strong-Tie for details.
  - m. Do not weld products listed in this catalog unless this publication specifically identifies a product as acceptable for welding, or unless specific approval for welding is provided in writing by Simpson Strong-Tie. Some steels have poor weldability and a tendency to crack when welded. Cracked steel will not carry load and must be replaced.

## General Instructions for the Installer

These general instructions for the installer are provided to ensure proper selection and installation of Simpson Strong-Tie Company Inc. products and must be followed carefully. These general instructions are in addition to the specific installation instructions and notes provided for each particular product, all of which should be consulted prior to and during installation of Simpson Strong-Tie Company Inc. products.

- a. All specified fasteners must be installed according to the instructions in this catalog. Incorrect fastener quantity, size, placement, type, material, or finish may cause the connection to fail. Prior to using a particular fastener, please consult the Fastener Guide in this catalog.
  - 16d fasteners are common nails (0.162" dia. x  $3\frac{1}{2}$ " long) and cannot be replaced with 16d sinkers (0.148" dia. x  $3\frac{1}{4}$ " long) for full load value unless otherwise specified.
  - Unless otherwise noted screws may not be used to replace nails in connectors unless approved and recommended by the Designer/Engineer of Record. Unless stated otherwise, Simpson Strong-Tie cannot and does not make any representations regarding the suitability of use or load-carrying capacities of connectors with screws replacing nails.
  - When using stainless-steel connectors, use stainless-steel fasteners. When using ZMAX®/HDG galvanized connectors, use fasteners that meet the zinc coating specifications of ASTM A153 or other fasteners allowed in this catalog.
- b. Fill all fastener holes as specified in the installation instructions for that product.
- c. Do not overdrive nails. Overdriven nails reduce shear capacity.
- d. Use the materials specified in the installation instructions. Substitution of or failure to use specified materials may cause the connection to fail.
- e. Do not add fastener holes or otherwise modify Simpson Strong-Tie Company Inc. products. The performance of modified products may be substantially weakened. Simpson Strong-Tie will not warrant or guarantee the performance of such modified products.
- f. Install products in the position specified in the catalog.
- g. Do not alter installation procedures from those set forth in this catalog.
- h. Bolt holes shall be at least a minimum of  $\frac{1}{32}$ " and no more than a maximum of  $\frac{1}{16}$ " larger than the bolt diameter (per the 2015 NDS, Section 12.1.3.2 and AISI S100-12, Table E3 if applicable).
- i. Install all specified fasteners before loading the shearwall.
- j. Some hardened fasteners may have premature failure if exposed to moisture. These fasteners are recommended to be used in dry interior applications.
- k. Use proper safety equipment.
- l. Welding galvanized steel may produce harmful fumes; follow proper welding procedures and safety precautions. Welding should be in accordance with A.W.S. (American Welding Society) standards. Unless otherwise noted Simpson Strong-Tie® connectors cannot be welded.
- m. Pneumatic or powder-actuated fasteners may deflect and injure the operator or others. Pneumatic nail tools may be used to install connectors, provided the correct quantity and type of nails (length and diameter) are properly installed in the nail holes. Tools with nail hole-locating mechanisms should be used. Follow the manufacturer's instructions and use the appropriate safety equipment. Overdriving nails may reduce allowable loads. Contact Simpson Strong-Tie. Powder-actuated fasteners should not be used to install connectors, unless noted otherwise.
- n. For cold-formed steel applications, all screws shall be installed in accordance with the screw manufacturer's recommendations. All screws shall penetrate and protrude through the joined materials a minimum of 3 full exposed threads per AISI Standard for Cold Formed Steel Framing — General Provisions, Section D1.3, if applicable.
- o. Nuts shall be installed such that the end of the threaded rod or bolt is at least flush with the top of the nut.
- p. To achieve tabulated values for embedded concrete/masonry products, full consolidation of concrete or grout is required.
- q. Drilling, sawing, sanding or machining wood products generates wood dust, a substance known to the State of California to cause cancer. For more information on Proposition 65, visit [www.oehha.ca.gov](http://www.oehha.ca.gov).
- r. For additional installation information, visit the Simpson Strong-Tie page at [www.youtube.com/strongtie](http://www.youtube.com/strongtie).



## Important Information and General Notes

### General Instructions for the Designer

These general instructions for the designer are provided to ensure proper selection and installation of Simpson Strong-Tie Company Inc. products and must be followed carefully. These general instructions are in addition to the specific design and installation instructions and notes provided for each particular product, all of which should be consulted prior to and during the design process.

- a. The term "Designer" used throughout this catalog is intended to mean a licensed/certified building design professional, a licensed professional engineer, or a licensed architect.
- b. All connected members and related elements shall be designed by the Designer.
- c. All installations should be designed only in accordance with the allowable load values set forth in this catalog.
- d. Simpson Strong-Tie strongly recommends the following addition to construction drawings and specifications: "Simpson Strong-Tie® products are specifically required to meet the structural calculations of plan. Before substituting another brand, confirm load capacity based on reliable published testing data or calculations. The Engineer/Designer of Record should evaluate and give written approval for substitution prior to installation."
- e. For cold-formed steel applications, as a minimum all screws must comply with Society of Automotive Engineers (SAE) Standard J78, Steel Self-Drilling/Tapping Screws, and must have a Type II coating in accordance with ASTM B 633, Electrodeposited Coatings of Zinc on Iron and Steel. Screw strength shall be calculated in accordance with AISI S100-12 Section E4, if applicable, or shall be based on the manufacturer's design capacity determined from testing.
- f. Local and/or regional building codes may require meeting special conditions. Building codes often require special inspection of anchors installed in concrete and masonry. For compliance with these requirements, it is necessary to contact the local and/or regional building authority. Except where mandated by code, Simpson Strong-Tie products do not require special inspection.
- g. For Masterformat® specifications, visit [www.strongtie.com/literature/masterformat.html](http://www.strongtie.com/literature/masterformat.html).

### Limited Warranty

Simpson Strong-Tie Company Inc. warrants catalog products to be free from defects in material or manufacturing. Simpson Strong-Tie Company Inc. products are further warranted for adequacy of design when used in accordance with design limits in this catalog and when properly specified, installed and maintained. This warranty does not apply to uses not in compliance with specific applications and installations set forth in this catalog, or to non-catalog or modified products, or to deterioration due to environmental conditions.

Simpson Strong-Tie® connectors are designed to enable structures to resist the movement, stress and loading that results from impact events such as earthquakes and high-velocity winds. Other Simpson Strong-Tie products are designed to the load capacities and uses listed in this catalog. Properly-installed Simpson Strong-Tie products will perform in accordance with the specifications set forth in the applicable Simpson Strong-Tie catalog. Additional performance limitations for specific products may be listed on the applicable catalog pages.

Due to the particular characteristics of potential impact events, the specific design and location of the structure, the building

materials used, the quality of construction, and the condition of the soils involved, damage may nonetheless result to a structure and its contents even if the loads resulting from the impact event do not exceed Simpson Strong-Tie catalog specifications and Simpson Strong-Tie connectors are properly installed in accordance with applicable building codes.

All warranty obligations of Simpson Strong-Tie Company Inc. shall be limited, at the discretion of Simpson Strong-Tie Company Inc., to repair or replacement of the defective part. These remedies shall constitute Simpson Strong-Tie Company Inc.'s sole obligation and sole remedy of purchaser under this warranty. In no event will Simpson Strong-Tie Company Inc. be responsible for incidental, consequential, or special loss or damage, however caused.

**This warranty is expressly in lieu of all other warranties, expressed or implied, including warranties of merchantability or fitness for a particular purpose, all such other warranties being hereby expressly excluded. This warranty may change periodically — consult our website [strongtie.com](http://strongtie.com) for current information.**

### Terms and Conditions of Sale

#### Product Use

Products in this catalog are designed and manufactured for the specific purposes shown, and should not be used with other connectors not approved by a qualified Designer. Modifications to products or changes in installations should only be made by a qualified Designer. The performance of such modified products or altered installations is the sole responsibility of the Designer.

#### Indemnity

Customers or Designers modifying products or installations, or designing non-catalog products for fabrication by Simpson Strong-Tie Company Inc. shall, regardless of specific instructions to the user, indemnify, defend and hold harmless Simpson Strong-Tie Company Inc. for any and all claimed loss or damage occasioned in whole or in part by non-catalog or modified products.

#### Non-Catalog and Modified Products

Consult Simpson Strong-Tie Company Inc. for applications for which there is no catalog product, or for connectors for use in hostile environments, with excessive wood shrinkage, or with abnormal loading or erection requirements.

Non-catalog products must be designed by the customer and will be fabricated by Simpson Strong-Tie in accordance with customer specifications.

Simpson Strong-Tie cannot and does not make any representations regarding the suitability of use or load-carrying capacities of non-catalog products. Simpson Strong-Tie provides no warranty, express or implied, on non-catalog products.



Working with specifiers, builders and contractors has given Simpson Strong-Tie insight into the needs of the various players in the design and construction process. This insight has enabled Simpson Strong-Tie to design a composite shearwall that features some of the highest allowable loads in the industry while offering the easiest and fastest installation: The Steel Strong-Wall® shearwall.

- **Code Listed** — New ICC-ES ESR-1679, City of L.A. RR 25625 and State of Florida FL 5113 code reports evaluated to the 2015 IRC/IBC
- **Less Labor = Increased Production** — Fewer anchor bolts and fasteners coupled with easy access to the top and bottom of the wall result in more efficient installation
- **Easier for All Trades** — An easy-to-use anchor-bolt template for concrete contractors, preattached wood studs and predrilled holes where electricians need them for wiring
- **Support and Service** — Simpson Strong-Tie provides the best engineering technical support and experienced field representation available

The Steel Strong-Wall product line has grown to address more applications:

- Standard installations on concrete
- Garage portal system
- Anchorage solutions
- Wood floor solutions
- Two-story stacked shearwalls
- Balloon framing up to 20' tall
- Cold-formed steel applications



# Standard Application on Concrete Foundations

Simpson Strong-Tie® Steel Strong-Wall® shearwalls provide superior performance, design flexibility and ease of installation. All Steel Strong-Wall shearwalls are evaluated to the 2015 IRC/IBC and are listed by ICC-ES.


**Material:** Vertical Panel—10 gauge

**Finish:** Vertical Panel—Galvanized


Top and Base Plates—Simpson Strong-Tie® gray paint

**Codes:** ICC-ES ESR-1679;  
City of L.A. RR 25625;  
State of Florida FL5113


## Naming Legend




## Wall Profiles




SSW12




SSW15



SSW18




SSW21




SSW24


Preattached wood studs are 2x4 for walls 7'-10' tall, and 2x6 for walls 11'-13' tall.




SSW15




SSW18



SSW21



SSW24

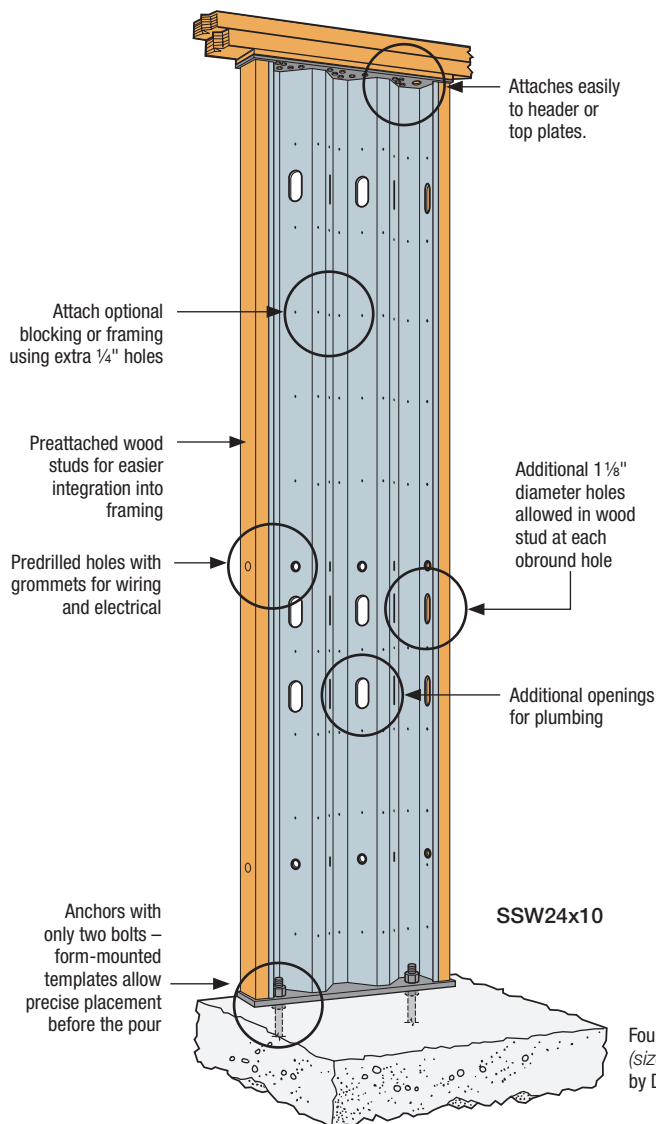


SSW24x10

Foundation design  
(size and reinforcement)  
by Designer

## Standard Installation

U.S. Patent 8,281,551  
Canadian Patent 2,489,845

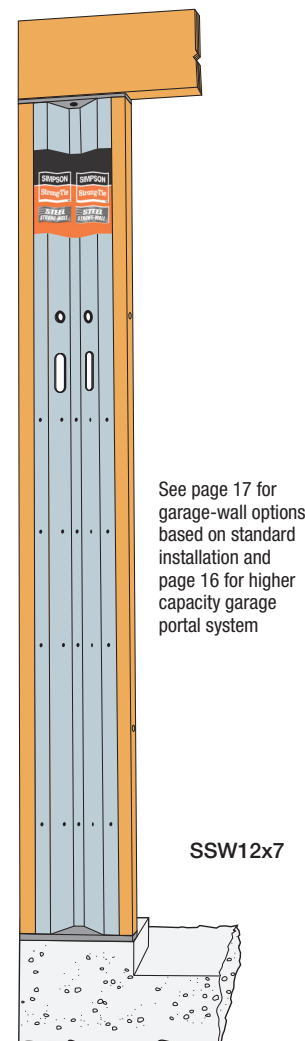

SSW12x7

## Garage Installation

U.S. Patent 8,281,551  
Canadian Patent 2,489,845


# Standard Application on Concrete Foundations

## Installation Information

- Do not cut the Steel Strong-Wall® or enlarge existing holes. Doing so will compromise the performance of the wall.
- Do not use an impact wrench to tighten nuts on the anchor bolts.
- Maximum shim thickness between the Steel Strong-Wall and top plates or header is  $\frac{7}{8}$ " using Simpson Strong-Tie® Strong-Drive®  $\frac{1}{4}$ " x  $3\frac{1}{2}$ " SDS Heavy-Duty Connector screws. For top of wall height adjustment, see detail 5/SSW2 on page 67.
- Walls with 2x4 preattached studs may also be used in 2x6 or 2x8 wall framing. Install the wall flush to one face of the framing and add furring to the opposite side.
- Walls may be installed with solid or multi-ply headers, see detail 11/SSW2 page 68 for details.

## Steel Strong-Wall® Product Data

Model No.	W (in.)	H (in.)	T (in.)	Anchor Bolts		Number of Screws in Top of Wall	Total Wall Weight (lb.)
				Qty.	Dia. (in.)		
SSW12x7	12	80	3½	2	¾	4	74
SSW15x7	15	80	3½	2	1	6	86
SSW18x7	18	80	3½	2	1	9	99
SSW21x7	21	80	3½	2	1	12	117
SSW24x7	24	80	3½	2	1	14	127
SSW12x7.4	12	85½	3½	2	¾	4	78
SSW15x7.4	15	85½	3½	2	1	6	91
SSW18x7.4	18	85½	3½	2	1	9	104
SSW21x7.4	21	85½	3½	2	1	12	122
SSW24x7.4	24	85½	3½	2	1	14	134
SSW12x8	12	93¼	3½	2	¾	4	85
SSW15x8	15	93¼	3½	2	1	6	99
SSW18x8	18	93¼	3½	2	1	9	113
SSW21x8	21	93¼	3½	2	1	12	132
SSW24x8	24	93¼	3½	2	1	14	144
SSW12x9	12	105¼	3½	2	¾	4	94
SSW15x9	15	105¼	3½	2	1	6	110
SSW18x9	18	105¼	3½	2	1	9	125
SSW21x9	21	105¼	3½	2	1	12	147
SSW24x9	24	105¼	3½	2	1	14	160
SSW12x10	12	117¼	3½	2	¾	4	104
SSW15x10	15	117¼	3½	2	1	6	121
SSW18x10	18	117¼	3½	2	1	9	138
SSW21x10	21	117¼	3½	2	1	12	162
SSW24x10	24	117¼	3½	2	1	14	177
SSW15x11	15	129¼	5½	2	1	6	148
SSW18x11	18	129¼	5½	2	1	9	167
SSW21x11	21	129¼	5½	2	1	12	193
SSW24x11	24	129¼	5½	2	1	14	209
SSW15x12	15	141¼	5½	2	1	6	160
SSW18x12	18	141¼	5½	2	1	9	180
SSW21x12	21	141¼	5½	2	1	12	208
SSW24x12	24	141¼	5½	2	1	14	225
SSW18x13	18	153¼	5½	2	1	9	194
SSW21x13	21	153¼	5½	2	1	12	224
SSW24x13	24	153¼	5½	2	1	14	243

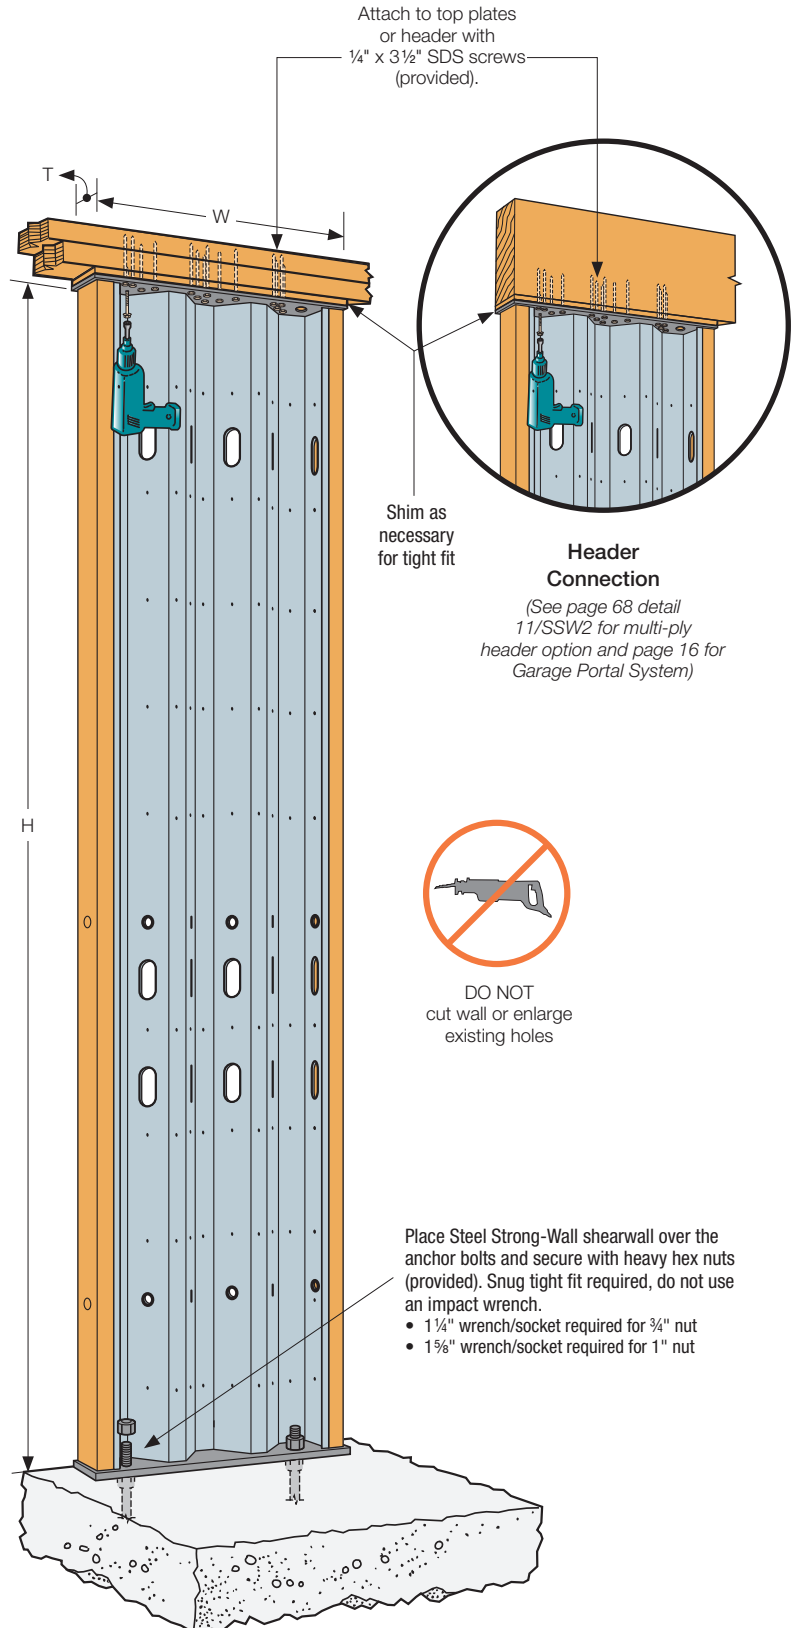

### Standard Installation

U.S. Patent 8,281,551  
 Canadian Patent 2,489,845



# Standard Application on Concrete Foundations

SSW Model	Allowable Axial Load (lb.)	Seismic <sup>2</sup>			Wind		
		Allowable ASD Shear Load V (lb.)	Drift at Allowable Shear (in.)	Anchor Tension at Allowable Shear <sup>5</sup> (lb.)	Allowable ASD Shear Load V (lb.)	Drift at Allowable Shear (in.)	Anchor Tension at Allowable Shear <sup>5</sup> (lb.)
SSW12x7	1,000	955	0.36	9,840	1,215	0.46	13,620
	4,000	955	0.36	9,840	1,095	0.42	11,765
	7,500	890	0.34	9,010	890	0.34	9,010
SSW15x7	1,000	1,855	0.36	15,655	1,860	0.36	15,715
	4,000	1,665	0.33	13,550	1,665	0.33	13,550
	7,500	1,445	0.28	11,340	1,445	0.28	11,340
SSW18x7	1,000	2,905	0.34	19,660	3,480	0.41	25,805
	4,000	2,905	0.34	19,660	3,250	0.38	23,135
	7,500	2,905	0.34	19,660	2,980	0.35	20,370
SSW21x7	1,000	4,200	0.32	23,755	4,440	0.34	25,710
	4,000	4,200	0.32	23,755	4,440	0.34	25,710
	7,500	4,200	0.32	23,755	4,310	0.33	24,635
SSW24x7	1,000	5,495	0.29	26,270	5,730	0.31	27,835
	4,000	5,495	0.29	26,270	5,730	0.31	27,835
	7,500	5,495	0.29	26,270	5,730	0.31	27,835
SSW12x7.4	1,000	870	0.39	9,515	1,105	0.49	13,070
	4,000	870	0.39	9,515	970	0.43	10,940
	7,500	750	0.33	7,940	750	0.33	7,940
SSW15x7.4	1,000	1,685	0.39	15,035	1,700	0.39	15,215
	4,000	1,500	0.34	12,905	1,500	0.34	12,905
	7,500	1,270	0.29	10,510	1,270	0.29	10,510
SSW18x7.4	1,000	2,700	0.37	19,475	3,255	0.44	25,790
	4,000	2,700	0.37	19,475	3,040	0.42	23,125
	7,500	2,700	0.37	19,475	2,790	0.38	20,390
SSW21x7.4	1,000	3,890	0.35	23,420	4,230	0.38	26,405
	4,000	3,890	0.35	23,420	4,230	0.38	26,405
	7,500	3,890	0.35	23,420	4,035	0.36	24,655
SSW24x7.4	1,000	5,330	0.34	27,610	5,450	0.34	28,485
	4,000	5,330	0.34	27,610	5,450	0.34	28,485
	7,500	5,330	0.34	27,610	5,450	0.34	28,485
SSW12x8	1,000	775	0.42	9,180	985	0.53	12,560
	4,000	775	0.42	9,180	865	0.47	10,550
	7,500	665	0.36	7,630	665	0.36	7,630
SSW15x8	1,000	1,505	0.42	14,515	1,530	0.43	14,835
	4,000	1,345	0.37	12,545	1,345	0.37	12,545
	7,500	1,135	0.32	10,190	1,135	0.32	10,190
SSW18x8	1,000	2,480	0.41	19,525	2,985	0.50	25,795
	4,000	2,480	0.41	19,525	2,790	0.47	23,160
	7,500	2,480	0.41	19,525	2,560	0.43	20,410
SSW21x8	1,000	3,560	0.39	23,360	3,960	0.43	27,240
	4,000	3,560	0.39	23,360	3,960	0.43	27,240
	7,500	3,560	0.39	23,360	3,700	0.41	24,660
SSW24x8	1,000	4,865	0.37	27,435	5,105	0.39	29,370
	4,000	4,865	0.37	27,435	5,105	0.39	29,370
	7,500	4,865	0.37	27,435	5,055	0.39	28,960
SSW12x9	1,000	660	0.47	8,745	840	0.60	11,915
	4,000	660	0.47	8,745	705	0.50	9,485
	7,500	505	0.36	6,380	505	0.36	6,380
SSW15x9	1,000	1,315	0.45	14,250	1,315	0.47	14,250
	4,000	1,130	0.38	11,740	1,130	0.40	11,740
	7,500	925	0.31	9,235	925	0.33	9,235
SSW18x9	1,000	2,145	0.47	18,890	2,645	0.58	25,800
	4,000	2,145	0.47	18,890	2,470	0.54	23,130
	7,500	2,145	0.47	18,890	2,265	0.50	20,370
SSW21x9	1,000	3,145	0.46	23,265	3,590	0.52	28,215
	4,000	3,145	0.46	23,265	3,530	0.51	27,490
	7,500	3,145	0.46	23,265	3,280	0.47	24,680
SSW24x9	1,000	4,285	0.44	27,210	4,605	0.47	30,150
	4,000	4,285	0.44	27,210	4,605	0.47	30,150
	7,500	4,285	0.44	27,210	4,480	0.46	28,970

See footnotes on page 13.

# Standard Application on Concrete Foundations

SSW Model	Allowable Axial Load (lb.)	Seismic <sup>2</sup>			Wind		
		Allowable ASD Shear Load V (lb.)	Drift at Allowable Shear (in.)	Anchor Tension at Allowable Shear <sup>5</sup> (lb.)	Allowable ASD Shear Load V (lb.)	Drift at Allowable Shear (in.)	Anchor Tension at Allowable Shear <sup>5</sup> (lb.)
SSW12x10	1,000	570	0.52	8,345	725	0.67	11,300
	4,000	570	0.52	8,345	570	0.52	8,345
	7,500	360	0.33	4,930	360	0.33	4,930
SSW15x10	1,000	1,110	0.53	13,150	1,145	0.54	13,690
	4,000	960	0.45	10,975	960	0.45	10,975
	7,500	715	0.34	7,775	715	0.34	7,775
SSW18x10	1,000	1,860	0.53	18,030	2,360	0.67	25,545
	4,000	1,860	0.53	18,030	2,215	0.63	23,095
	7,500	1,860	0.53	18,030	2,035	0.57	20,395
SSW21x10	1,000	3,045	0.50	25,905	3,265	0.56	28,795
	4,000	3,045	0.50	25,905	3,170	0.54	27,510
	7,500	2,780	0.45	22,780	2,780	0.47	22,780
SSW24x10	1,000	3,835	0.50	27,100	4,205	0.55	30,920
	4,000	3,835	0.50	27,100	4,205	0.55	30,920
	7,500	3,790	0.49	26,660	3,790	0.49	26,660
SSW15x11	1,000	975	0.58	12,625	1,015	0.60	13,285
	4,000	815	0.48	10,135	815	0.48	10,135
	7,500	550	0.33	6,470	550	0.33	6,470
SSW18x11	1,000	1,635	0.58	17,295	2,075	0.73	24,280
	4,000	1,635	0.58	17,295	2,010	0.71	23,110
	7,500	1,635	0.58	17,295	1,730	0.61	18,645
SSW21x11	1,000	2,485	0.58	22,325	2,990	0.70	29,230
	4,000	2,485	0.58	22,325	2,785	0.65	26,220
	7,500	2,305	0.54	20,205	2,305	0.54	20,205
SSW24x11	1,000	3,475	0.57	27,055	3,845	0.63	31,285
	4,000	3,475	0.57	27,055	3,710	0.60	29,680
	7,500	3,205	0.52	24,260	3,205	0.52	24,260
SSW15x12	1,000	815	0.63	11,280	905	0.70	12,855
	4,000	690	0.53	9,245	690	0.53	9,245
	7,500	390	0.30	4,905	390	0.30	4,905
SSW18x12	1,000	1,450	0.63	16,605	1,845	0.80	23,220
	4,000	1,450	0.63	16,605	1,815	0.79	22,650
	7,500	1,435	0.62	16,380	1,435	0.62	16,380
SSW21x12	1,000	2,210	0.63	21,485	2,755	0.79	29,555
	4,000	2,210	0.63	21,485	2,420	0.69	24,335
	7,500	1,900	0.54	17,690	1,900	0.54	17,690
SSW24x12	1,000	3,150	0.63	26,710	3,540	0.71	31,575
	4,000	3,150	0.63	26,710	3,250	0.65	27,890
	7,500	2,705	0.54	21,855	2,705	0.54	21,855
SSW18x13	1,000	1,335	0.68	16,580	1,695	0.87	23,105
	4,000	1,335	0.68	16,580	1,580	0.81	20,830
	7,500	1,180	0.60	14,195	1,180	0.60	14,195
SSW21x13	1,000	1,985	0.68	20,765	2,520	0.87	29,200
	4,000	1,985	0.68	20,765	2,110	0.73	22,530
	7,500	1,555	0.53	15,300	1,555	0.53	15,300
SSW24x13	1,000	2,830	0.68	25,795	3,275	0.79	31,755
	4,000	2,830	0.68	25,795	2,860	0.69	26,165
	7,500	2,280	0.55	19,545	2,280	0.55	19,545

- Allowable shear loads and anchor tension forces are applicable to installation on concrete with minimum  $f'_c = 2,500$  psi using the ASD basic (Section 1605.3.1) or the alternative basic (Section 1605.3.2) load combinations. Load values include evaluation of bearing stresses on the foundation and do not require further evaluation by the Designer.
- For seismic designs based on the 2015 IBC using  $R = 6.5$ . For other codes, use the seismic coefficients corresponding to light-frame bearing walls with wood structural panels or sheet steel panels.
- Allowable shear, drift, and anchor tension values may be interpolated for intermediate height or axial loads.
- High-strength anchor bolts are required for anchor tension forces exceeding the allowable load for standard-strength bolts tabulated on pages 29–30. High-strength anchor bolts are required for SSW12 when the seismic overturning moment (seismic shear x shearwall height) exceeds 61,600 in.-lb. See pages 29–35 for SSWAB anchor bolt information and anchorage solutions.
- Tabulated anchor tension loads assume no resisting axial load. For anchor tension loads at design shear values and including the effect of axial load, refer to the Strong-Wall Selector web application or use the equations on page 15. Drifts at lower design shear may be linearly reduced.
- See page 14 for allowable out-of-plane loads and axial capacities.



# Standard Application on Concrete Foundations

## Allowable Out-of-Plane Loads (psf) for Single-Story Walls on Concrete Foundations

Model Width (in.)	Axial Load (lb.)	Nominal Height of Shearwall (ft.)					
		8	9	10	11	12	13
12	1,000	200	140	105	N/A	N/A	N/A
	4,000	150	105	70	N/A	N/A	N/A
	7,500	90	55	25	N/A	N/A	N/A
15	1,000	165	130	100	80	70	N/A
	4,000	130	95	70	50	40	N/A
	7,500	95	65	45	30	15	N/A
18	7,500	310	215	160	120	90	70
21	7,500	260	185	135	100	70	50
24	7,500	275	195	135	105	80	65

1. Loads shown are at ASD level in pounds per square foot (psf) of wall with no further increase in load allowed.
2. Axial load denotes maximum gravity load permitted on entire panel acting in combination with the out-of-plane load.
3. Load considers a deflection limit of  $h/240$ .
4. Values are applicable to either the ASD basic or alternative basic load combinations.
5. Allowable out-of-plane loads for the 12- and 15-inch walls may be linearly interpolated between the axial loads shown.
6. Table loads apply only to single-story walls on concrete foundations.
7. N/A = Not Applicable.

## Axial Capacities for Single-Story Walls on Concrete Foundations

Model Width (in.)	Compression Capacity with No Lateral Loads (lb.)							
	Nominal Height of Shearwall (ft.)							
	7	7.4	8	9	10	11	12	13
12	20,200	19,000	17,200	14,500	11,800	N/A	N/A	N/A
15	25,300	24,200	22,600	20,000	17,400	14,900	12,600	N/A
18	42,500	40,400	37,500	32,900	28,400	24,100	20,200	17,200
21	43,700	41,100	37,500	32,000	26,700	22,000	18,400	15,700
24	51,600	48,800	44,800	38,700	32,900	27,400	22,900	19,500

1. Compression capacity is lesser of wall buckling capacity or 2,500 psi concrete bearing limit.
2. Compression capacity of wall assumes no lateral loads present. See allowable in-plane or out-of-plane load tables for combined lateral and axial loading conditions.
3. Values are applicable to either the ASD basic or alternative basic load combinations.
4. Table loads apply only to single-story walls on concrete foundations.
5. N/A = Not Applicable.

## Allowable Tension Loads for Steel Strong-Wall® Wood Jamb Stud

Model Width (in.)	Tension Capacity per Jamb Stud (lb.)							
	Nominal Height of Shearwall (ft.)							
	7	7.4	8	9	10	11	12	13
12	1,535	1,535	1,845	2,150	2,500	N/A	N/A	N/A
15	1,845	2,150	2,460	2,500	2,500	3,070	3,685	N/A
18	1,845	1,845	2,150	2,500	2,500	3,380	3,685	3,980
21	1,845	1,845	2,150	2,500	2,500	3,070	3,685	3,980
24	1,845	1,845	2,150	2,500	2,500	3,070	3,685	3,980

1. Allowable tension load is based on capacity of the lesser of the connection between the stud and the steel shearwall or stud tension capacity. The capacity of the SSW wall anchor bolt and anchorage to the foundation must be adequate to transfer the additional tension.
2. Loads include a 1.60 load duration increase for wood subjected to wind or earthquake. Reductions for other load durations must be taken according to the applicable code.
3. N/A = Not Applicable.

# Anchor Tension Equations

## Calculating Anchor Tension Forces at Base of Wall

These equations may be used to calculate anchor tension forces at the base of the first-story wall to aid Designers in developing anchorage solutions other than those shown on pages 29-34.

$$12 \text{ in. wall } T = [11.2f'_c - \sqrt{126f'_c{}^2 - 2.38f'_c(3.44P + Vhk)}] - P$$

$$15 \text{ in. wall } T = [14.4f'_c - \sqrt{208f'_c{}^2 - 2.38f'_c(4.63P + Vhk)}] - P$$

$$18 \text{ in. wall } T = [18.0f'_c - \sqrt{324f'_c{}^2 - 2.38f'_c(6.13P + Vhk)}] - P$$

$$21 \text{ in. wall } T = [21.6f'_c - \sqrt{465f'_c{}^2 - 2.38f'_c(7.63P + Vhk)}] - P$$

$$24 \text{ in. wall } T = [25.1f'_c - \sqrt{632f'_c{}^2 - 2.38f'_c(9.13P + Vhk)}] - P$$

### Notes:

- Equations may be used to calculate anchor tension forces at the base of first-story walls on concrete foundations.
- Equations are based on the design methodology contained in AISC Steel Design Guide 1 – Base Plate and Anchor-Rod Design, second edition using a rectangular compression stress block.
- Equations are based on concrete bearing on a 3½"-wide base plate at the edge of the concrete.

### Example 1 — Single-Story SSW:

#### Given:

- SSW18x9 wall on 2.5 ksi concrete
- Seismic Loading
- Design Shear ( $V$ ) = 2.0 kips < 2.15 kips ( $V_{allowable}$ )
- $P$  (Vertical Load) = 1.0 kip
- $h$  = Wall height = 105.25"
- $k$  = 1.0

$$T = [18.0f'_c - \sqrt{324f'_c{}^2 - 2.38f'_c(6.13P + Vhk)}] - P$$

$$T = [18.0(2.5) - \sqrt{324(2.5)^2 - 2.38(2.5)(6.13 \times 1.0 + 2.0 \times 105.25 \times 1.0)}] - 1.0 = 16.9 \text{ kips}$$


### Example 2 — Two-Story Stacked SSW Condition:

#### Given:

- See Two-Story Design Example on page 28
- SSW18x9-STK wall on 2.5 ksi concrete
- Wind Loading
- $M_{base} = 17,550 \text{ ft.-lb.}$  (Moment at base of two-story stacked wall)
- $Vh = 17,550 \times \left(\frac{12}{1000}\right) \text{ kip-in} = 210.6 \text{ kip-in.}$
- $P$  (Vertical Load) = 2.0 kips
- $k$  = 1.0

$$T = [18.0f'_c - \sqrt{324f'_c{}^2 - 2.38f'_c(6.13P + Vhk)}] - P$$

$$T = [18.0(2.5) - \sqrt{324(2.5)^2 - 2.38(2.5)(6.13 \times 2.0 + 210.6 \times 1.0)}] - 2.0 = 16.6 \text{ kips}$$

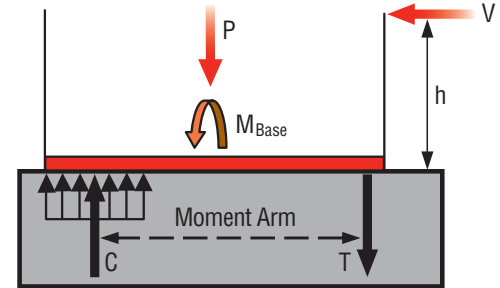

**Forces at Base of Wall**

$T$  = Resulting anchorage tension force (kips)

$V$  = Design shear (kips)

$P$  = Total vertical load (kips)

$h$  = Wall height (inches)

$f'_c$  = Concrete compressive Strength (ksi)

$k$  = 1.0 for all applications except Garage Portal Systems

For Garage Portal Systems using the SSWP-KT Portal Kit:

$k$  = 0.80 for SSW12

$k$  = 0.85 for SSW15

$k$  = 0.90 for SSW18

For two-story stacked applications,

substitute  $M_{base}$  for  $Vh$ :

$$Vh = M_{base} \left( \frac{12}{1000} \right) \text{ kip-in.}$$

Where  $M_{base}$  = Design moment at base of wall (ft.-lb.)



# Garage Portal Systems on Concrete Foundations

Simpson Strong-Tie offers a Steel Strong-Wall® shearwall option for garage portal systems which combines simplified installation with superior performance.

- Higher capacity with reduced concrete anchorage requirements (see *Alternate Garage Front Options on page 17 for other options*)
- Same anchor bolt template
- Complete kit available to simplify the connection to the header or beam


**For product data and naming scheme information, see pages 10–11.**

**Suggested Example Specification: SSW12x7 with SSWP-KT**

## Garage Header Rough Opening Height

Model No.	H Curb	Rough Opening Height
SSW12x7 SSW15x7 SSW18x7	5 1/2"	7'-1 1/2"
	6"	7'-2"
SSW12x7.4 SSW15x7.4 SSW18x7.4	0"	7'-1 1/2"
SSW12x8 SSW15x8 SSW18x8	5 1/2"	8'-2 3/4" <sup>3</sup>
	6"	8'-3 1/4" <sup>3</sup>

1. The height of the garage curb above the garage slab is critical for rough header opening at garage return walls.
2. Shims are not provided with Steel Strong-Wall®.
3. Furring down garage header may be necessary for correct rough opening height.




**For a complete set of wall profile drawings, see page 10.**

## Installation

- Portal Frame Connection Kit is required to achieve increased load values listed for portal frame system.
- SSWPS straps must be installed on exterior face of the Steel Strong-Wall® shearwall. Position header flush with exterior face of the Steel Strong-Wall shearwall.
- Do not cut the Steel Strong-Wall or enlarge existing holes. Doing so will compromise the performance of the wall.
- Do not use an impact wrench to tighten nuts on the anchor bolts.
- Maximum shim thickness between the Steel Strong-Wall and header is 7/8" using Simpson Strong-Tie® Strong-Drive® 1/4" x 3 1/2" SDS Heavy-Duty Connector screws.
- Walls with 2x4 preattached studs may also be used in 2x6 wall framing. Install the wall flush to exterior face of the framing and add furring to the opposite side.
- Walls may be installed with solid or multi-ply headers, see detail 11/SSW2 page 68 for details.

## Portal Frame Connection Kit

Model No.	Contents
SSWP-KT	(2) 10 gauge SSWPS straps (8) #14 x 1" self-drilling screws Installation instructions

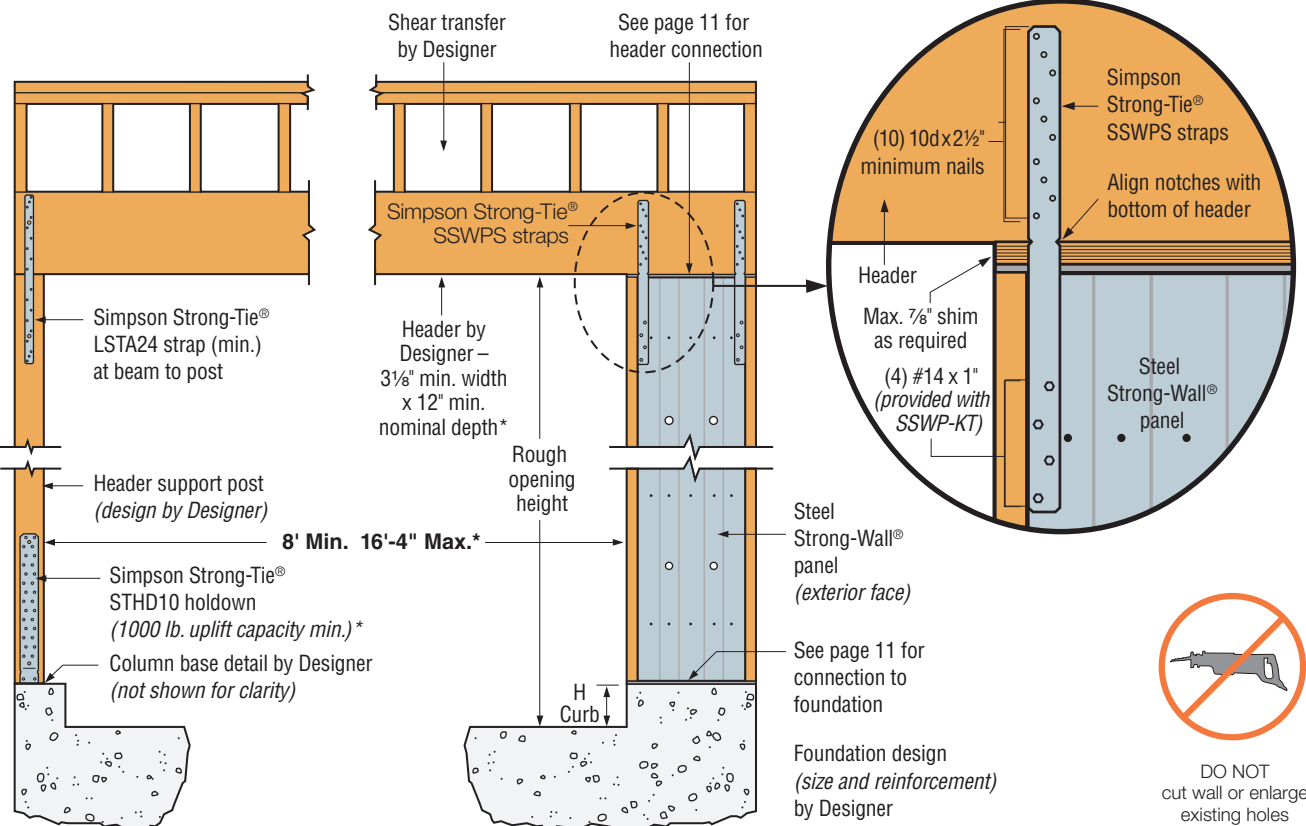

\*This installation reflects lateral load requirements of a single-wall portal system. It is the Designer's responsibility to provide a complete load path for all loads in accordance with the governing codes. Refer to footnotes 2, 4 and 9 on page 17.

U.S. Patent  
8,281,551  
Canadian Patent  
2,489,845



**DO NOT**  
cut wall or enlarge  
existing holes

# Garage Portal Systems on Concrete Foundations

SSW Model	Allowable Axial Load (lb.)	Single-Wall Garage Portal System <sup>2</sup>					
		Seismic <sup>3</sup>			Wind		
		Allowable ASD Shear Load V (lb.)	Drift at Allowable Shear (in.)	Anchor Tension at Allowable Shear <sup>6</sup> (lb.)	Allowable ASD Shear Load V (lb.)	Drift at Allowable Shear (in.)	Anchor Tension at Allowable Shear <sup>6</sup> (lb.)
SSW12x7 w/ SSWP-KT	1,000	1,350	0.42	11,550	1,645	0.51	15,390
	4,000	1,350	0.42	11,550	1,435	0.45	12,560
	7,500	1,185	0.37	9,750	1,185	0.37	9,750
SSW15x7 w/ SSWP-KT	1,000	2,210	0.38	15,930	2,210	0.38	15,930
	4,000	2,000	0.34	13,925	2,000	0.34	13,925
	7,500	1,760	0.30	11,835	1,760	0.30	11,835
SSW18x7 w/ SSWP-KT	1,000	3,865	0.40	25,785	3,865	0.40	25,785
	4,000	3,610	0.38	23,125	3,610	0.38	23,125
	7,500	3,315	0.35	20,405	3,315	0.35	20,405
SSW12x7.4 w/ SSWP-KT	1,000	1,275	0.45	11,695	1,535	0.54	15,320
	4,000	1,275	0.45	11,695	1,310	0.46	12,135
	7,500	1,045	0.37	9,055	1,045	0.37	9,055
SSW15x7.4 w/ SSWP-KT	1,000	2,065	0.42	15,900	2,065	0.42	15,900
	4,000	1,855	0.37	13,765	1,855	0.37	13,765
	7,500	1,590	0.32	11,330	1,590	0.32	11,330
SSW18x7.4 w/ SSWP-KT	1,000	3,615	0.45	25,770	3,615	0.45	25,770
	4,000	3,380	0.42	23,150	3,380	0.42	23,150
	7,500	3,100	0.38	20,390	3,100	0.38	20,390
SSW12x8 w/ SSWP-KT	1,000	1,180	0.46	11,845	1,375	0.55	14,770
	4,000	1,140	0.45	11,305	1,140	0.45	11,305
	7,500	875	0.35	8,110	875	0.35	8,110
SSW15x8 w/ SSWP-KT	1,000	1,865	0.42	15,570	1,865	0.42	15,570
	4,000	1,640	0.37	13,130	1,640	0.37	13,130
	7,500	1,380	0.31	10,600	1,380	0.31	10,600
SSW18x8 w/ SSWP-KT	1,000	3,280	0.47	25,325	3,315	0.48	25,775
	4,000	3,100	0.45	23,160	3,100	0.45	23,160
	7,500	2,840	0.41	20,365	2,840	0.41	20,365

1. Allowable shear loads and anchor tension forces are applicable to Single-Wall Garage Portal System installation on concrete with minimum  $f'c = 2,500$  psi using the ASD basic (Section 1605.3.1) or the alternative basic (Section 1605.3.2) load combinations. Load values include evaluation of bearing stresses.
2. A Double-Wall Garage Portal System consists of two walls with a header continuous across both panels. The allowable load is twice the Single-Wall Portal value.
3. For seismic designs based on the 2015 IBC using  $R=6.5$ . For other codes, use the seismic coefficients corresponding to light-frame bearing walls with wood structural panels or sheet steel panels.
4. The minimum header size shown in the details is the minimum required for lateral rigidity of the portal system. Larger headers may be required due to vertical loading. Support post uplift connectors may be reduced where justified by calculations.
5. Recommended header moisture content is 19% or less at time of installation.
6. Allowable shear, drift and anchor tension values may be interpolated for intermediate height or axial loads.
7. High-strength anchor bolts are required for anchor tension forces exceeding the allowable load for standard-strength bolts tabulated on pages 29–30. High-strength anchor bolts are required for SSW12 when the seismic overturning moment (seismic shear x shearwall height) exceeds 61,600 in.-lb. See pages 29–35 for SSWAB anchor bolt information and anchorage solutions.
8. Tabulated anchor tension loads assume no resisting axial load. For anchor tension loads at design shear values and including the effect of axial load, refer to the Strong-Wall Selector web application or use the equations on page 15 (include  $K$  factor in uplift calculations). Drifts at lower design shear may be linearly reduced.
9. Longer header spans can be accommodated if larger headers are used such that equivalent stiffness is equal to or greater than that provided by the minimum header size and maximum length indicated.


## Alternate Garage Front Options

These alternate garage front options may be used for applications when the Steel Strong-Wall® shearwall is installed at the full height (*option 1*) or without the additional Portal Frame Kit (*option 2*), when higher capacity or reduced concrete anchorage are not needed. Refer to the Standard Application on Concrete Foundations on pages 10–13 for product data and allowable load values.

### For Garage Wall Option 2, the Designer shall design for:

1. Shear transfer
2. Out-of-plane loading effect
3. Increased overturning and drift due to additional height

U.S. Patent  
8,281,551  
Canadian Patent  
2,489,845

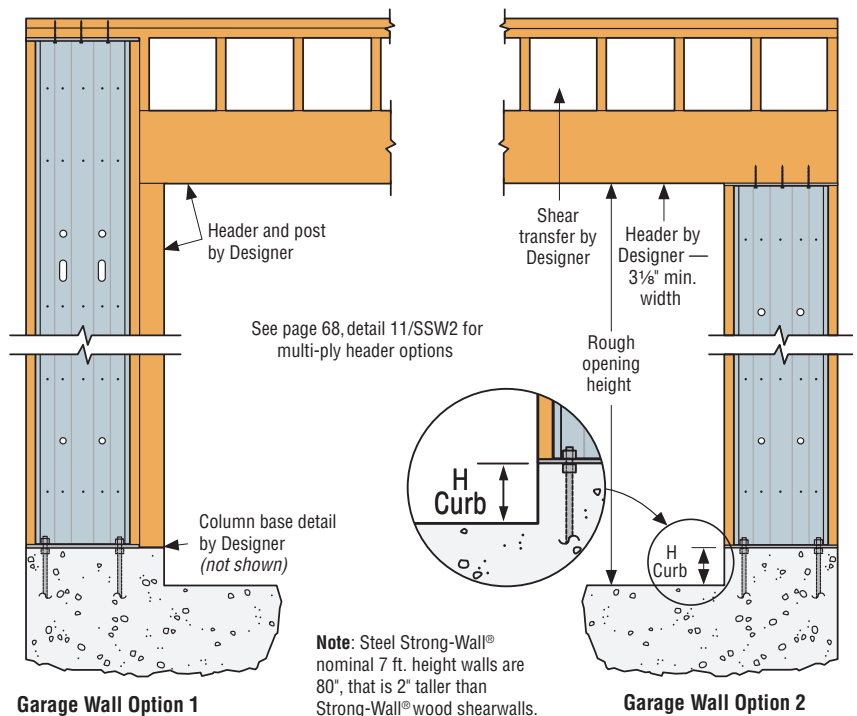



# First-Story Wood Floor Systems

Steel Strong-Wall® shearwalls designed for use on concrete foundations can be used with wood floor systems by extending the anchor bolts and installing compression nuts and solid blocking below the wall.

**Material & Finish:** See page 10.

**Codes:** ICC-ES ESR-1679:

City of L.A. RR25625;

State of Florida FL5113

**For product data and naming scheme information, see pages 10–13.**


## Wood First-Floor Wall Connection Kit

Wall Width (in.)	Model No.	Contents
12	SSW12-1KT	(1) Shear-Transfer Plate (with #14 self-drilling screws) (2) ¾" or 1" x 18" Threaded Rods F1554 Grade 36
15	SSW15-1KT	
18	SSW18-1KT	(2) Coupler Nuts (2) Heavy Hex Nuts Installation Instructions
21	SSW21-1KT	
24	SSW24-1KT	

1. Two heavy hex nuts included with each wall.

Simpson Strong-Tie® A34 angle

Solid blocking under center and each end of wall

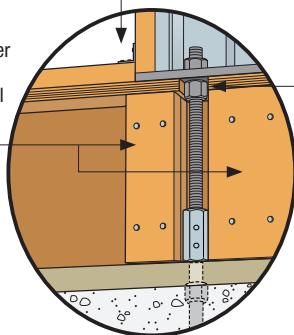

### Blocking/Connection Detail


(See Detail 10/SSW2 on page 72 for perpendicular blocking where required)

Drill/notch subfloor to allow nut to sit flush with underside of wall (Notching of rim joist may also be required)

Place Steel Strong-Wall® shearwall over the anchor bolts and secure with heavy hex nuts (provided). Snug tight fit required, do not use an impact wrench.

- 1½" wrench/socket required for ¾" nut
- 1¾" wrench/socket required for 1" nut

CNW Nuts and Threaded Rods (Included with SSW\_-1KT)

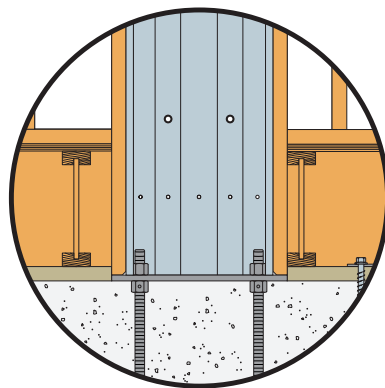

### Alternate First-Story Installation

Installation for first-story wood-floor system. Specify taller wall model to allow for floor framing and use load values for installation on concrete on pages 12–13.

Attach to top plates or header with SDS ¼" x 3½" screws (provided)


Shim as necessary for tight fit



DO NOT cut wall or enlarge existing holes

SSW shear-transfer plate installs with 10d nails into the rim joist and #14 self-drilling screws into the Strong-Wall® (Sold separately with SSW\_-1KT)

Simpson Strong-Tie® A34 each side

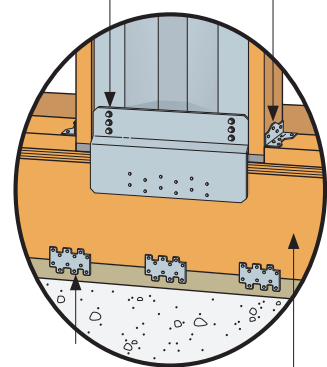


Shear transfer by Designer (Simpson Strong-Tie® LTP4 shown)

Rim joist

### Exterior View of Shear-Transfer Plate

Simpson Strong-Tie® A34 each side (sold separately)

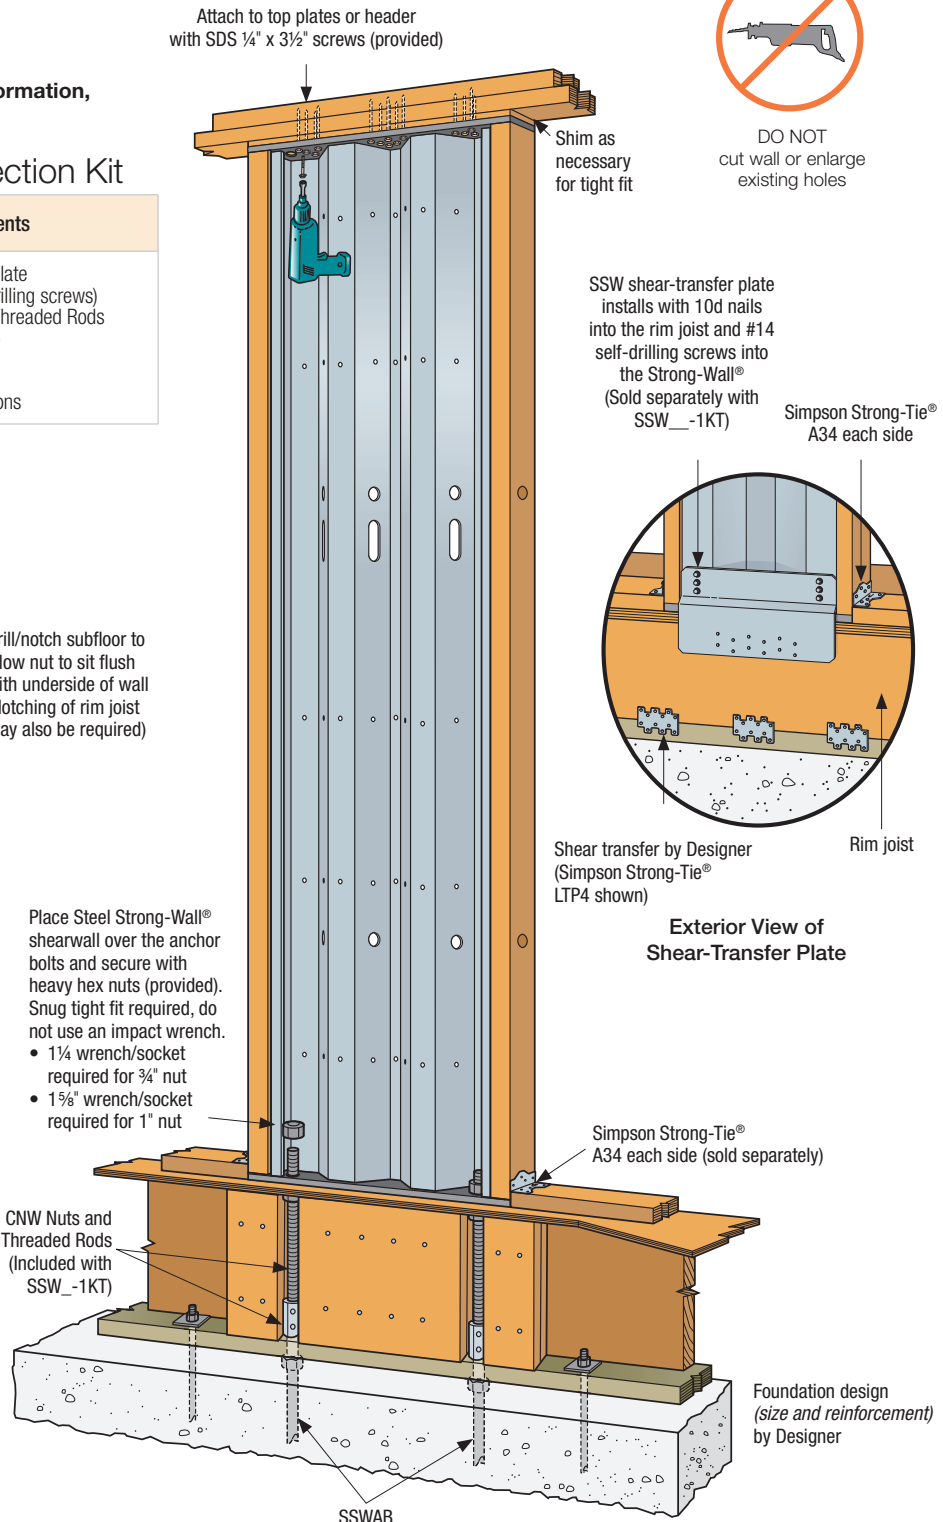

SSWAB

Foundation design (size and reinforcement) by Designer

### First-Story Wood Floor Installation

U.S. Patent 8,281,551  
Canadian Patent 2,489,845

# First-Story Wood Floor Systems

SSW Model	Seismic <sup>2</sup>			Wind		
	Allowable ASD Shear Load V <sup>5,6</sup> (lb.)	Drift at Allowable Shear (in.)	Anchor Tension at Allowable Shear <sup>4</sup> (lb.)	Allowable ASD Shear Load V <sup>5,6</sup> (lb.)	Drift at Allowable Shear (in.)	Anchor Tension at Allowable Shear <sup>4</sup> (lb.)
SSW12x7	525	0.30	6,110	525	0.30	6,110
SSW15x7	1,385	0.35	11,980	1,385	0.35	11,980
SSW18x7	1,830	0.27	11,950	1,830	0.27	11,950
SSW21x7	2,100	0.21	11,015	2,100	0.21	11,015
SSW24x7	2,450	0.17	10,740	2,450	0.17	10,740
SSW12x8	450	0.36	6,105	450	0.36	6,105
SSW15x8	1,185	0.42	11,945	1,185	0.42	11,945
SSW18x8	1,570	0.33	11,950	1,570	0.33	11,950
SSW21x8	1,955	0.27	11,955	1,955	0.27	11,955
SSW24x8	2,340	0.23	11,955	2,340	0.23	11,955
SSW12x9	400	0.42	6,125	400	0.42	6,125
SSW15x9	1,050	0.47	11,945	1,050	0.47	11,945
SSW18x9	1,390	0.38	11,945	1,390	0.38	11,945
SSW21x9	1,735	0.31	11,975	1,735	0.31	11,975
SSW24x9	2,075	0.26	11,965	2,075	0.26	11,965
SSW12x10	360	0.48	6,140	360	0.48	6,140
SSW15x10	885	0.52	11,220	945	0.56	11,980
SSW18x10	1,250	0.44	11,965	1,250	0.44	11,965
SSW21x10	1,555	0.33	11,955	1,555	0.33	11,955
SSW24x10	1,860	0.30	11,950	1,860	0.30	11,950
SSW15x11	780	0.58	10,900	855	0.63	11,945
SSW18x11	1,135	0.50	11,975	1,135	0.50	11,975
SSW21x11	1,410	0.40	11,950	1,410	0.40	11,950
SSW24x11	1,690	0.34	11,970	1,690	0.34	11,970
SSW15x12	670	0.63	10,230	785	0.74	11,985
SSW18x12	1,035	0.55	11,935	1,035	0.55	11,935
SSW21x12	1,290	0.45	11,950	1,290	0.45	11,950
SSW24x12	1,545	0.38	11,960	1,545	0.38	11,960
SSW18x13	955	0.60	11,945	955	0.60	11,945
SSW21x13	1,190	0.50	11,960	1,190	0.50	11,960
SSW24x13	1,425	0.42	11,965	1,425	0.42	11,965

1. Loads are applicable to first-story raised wood floor installations supported on concrete or masonry foundations using the ASD basic (Section 1605.3.1) or the alternative basic (Section 1605.3.2) load combinations. Load values include evaluation of anchor rod compression capacity and do not require further evaluation by the Designer.

2. For seismic designs based on the 2015 IBC using R = 6.5. For other codes, use the seismic coefficients corresponding to light-frame bearing walls with wood structural panels or sheet steel panels.

3. Minimum standard-strength anchor bolts required. See pages 29–35 for SSWAB anchor bolt information and anchorage solutions.

4. Tabulated anchor tension loads assume no resisting axial load. Anchor rod tension at design shear load and including the effect of axial load may be determined using the Strong-Wall Shearwall Selector web application or the following equation:

$$T = [(V \times h) / B] - P/2, \text{ where:}$$

T = Anchor rod tension load (lb.)

V = Design shear load (lb.)

h = Strong-Wall® height per page 11 (in.)

P = Applied axial load (lb.)

B = Anchor bolt centerline dimension (in.)

(6¾" for SSW12, 9¼" for SSW15, 12¼" for SSW18, 15¼" for SSW21, and 18¼" for SSW24)

5. Allowable shear loads assume a maximum first-floor joist depth of 12". For allowable shear load with joists up to 16" deep, multiply table values by 0.93 for SSW12x models and 0.96 for other SSW widths.

6. Allowable shear loads are based on 1,000 lb. total uniformly distributed axial load acting on the entire panel in combination with the shear load. For allowable shear loads at 2,000 lb. uniformly distributed axial load, multiply table values by 0.92 for SSW12x models, and 0.96 for other SSW widths.

# Balloon Framing on Concrete Foundations

Simpson Strong-Tie® offers a complete stacked-wall solution for balloon-framing applications. The Steel Strong-Wall® option for heights up to 20' combines simplified installation with superior performance.

- Some of the highest loads in the industry
- Same anchor bolt template as single-story installation
- Complete kit available to simplify the connection between the walls

**Material & Finish:** See page 10.


**Codes:** ICC-ES ESR-1679;

City of L.A. RR25625;


State of Florida FL5113

## Top Wall:

### Naming Legend



## Bottom Wall:

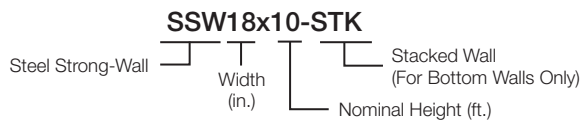

Suggested Example Specification: SSW18x8 over SSW18x10-STK

## Steel Strong-Wall® Balloon Framing Stacked-Wall Product Data — Bottom Walls

Model No.	W (in.)	H (in.)	T (in.)	Anchor Bolts	
				Qty.	Dia. (in.)
SSW15x8-STK	15	93 1/4	3 1/2	2	1
SSW15x10-STK	15	117 1/4	3 1/2	2	1
SSW18x8-STK	18	93 1/4	3 1/2	2	1
SSW18x10-STK	18	117 1/4	3 1/2	2	1
SSW21x8-STK	21	93 1/4	3 1/2	2	1
SSW21x10-STK	21	117 1/4	3 1/2	2	1
SSW24x8-STK	24	93 1/4	3 1/2	2	1
SSW24x10-STK	24	117 1/4	3 1/2	2	1

1. Specific wall combinations provided. See load table on page 22. Contact Simpson Strong-Tie for additional wall combinations.
2. See page 10–11 for product data on top walls.

## Balloon-Framing Wall Connection Kit


Model No.	Contents
SSWBF-KT	(2) 1" x 25" Threaded Rods F1554 Grade 36 (4) Heavy Hex Nuts Installation Instructions

1. Two heavy hex nuts included with each wall.

## Wood Block-to-Top Plate Connection

Strong-Wall® Width	Total Connectors	Recommended Connectors
15" Wall	4 (2 Each Side)	Simpson Strong-Tie® LTP4 or A35
18" Wall	4 (2 Each Side)	
21" Wall	6 (3 Each Side)	
24" Wall	6 (3 Each Side)	

1. Alternate connectors with equivalent shear capacity may be specified by the Designer.

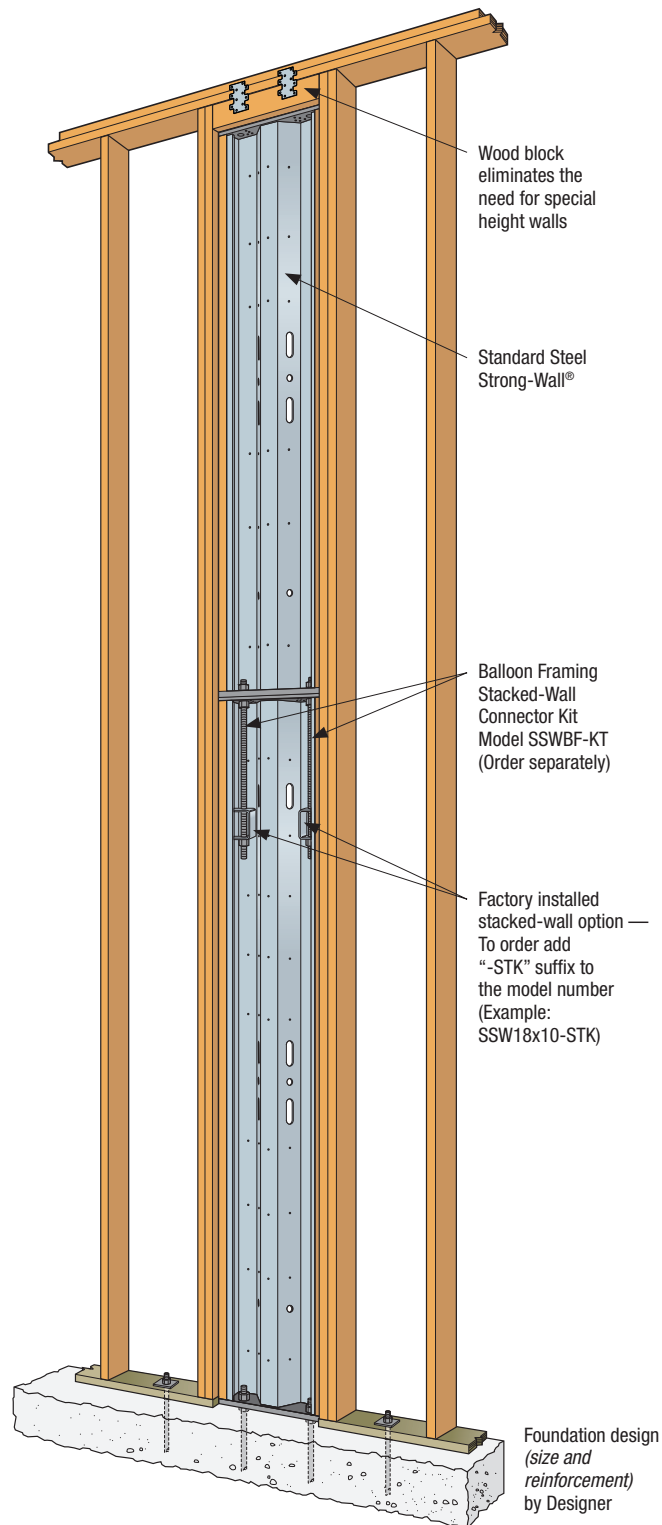

### Stacked-Wall Solution For Balloon Framing

U.S. Patent 8,281,551; 8,689,518  
Canadian Patent 2,489,845




# Balloon Framing on Concrete Foundations


## Installation

- Do not cut the Steel Strong-Wall® or enlarge existing holes, doing so will compromise the performance of the wall.
- Do not use an impact wrench to tighten nuts on the anchor bolts.
- Maximum top block height between the Steel Strong-Wall and top plates is 12". See detail 4/SSW3 on page 75.
- Full height studs are required for balloon-framed wall installation (by Designer). Two 2x6 minimum each side with 10d nails at 16" o.c.

Block Height (H)	CS16 Nailing (0.148 x 1½" Nails)	
	Into Block	Into SSW Nailer Stud
H ≤ 8"	N/A	N/A
8" < H ≤ 10"	(8) 10d x 1½"	(8) 10d x 1½"
10" < H ≤ 12"	(10) 10d x 1½"	(10) 10d x 1½"

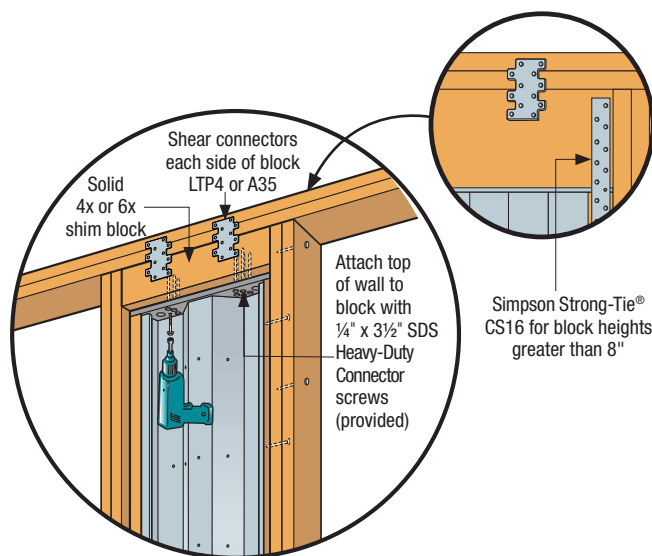


Top-of-Wall Connection

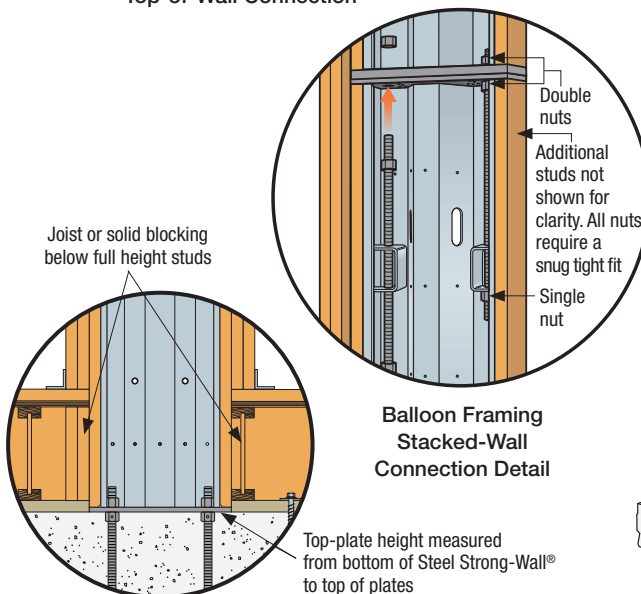

Balloon Framing Stacked-Wall Connection Detail

## Balloon Framing on Concrete Through Wood Floor

Installation for first-story wood-floor system, specify taller wall model to allow for floor framing.

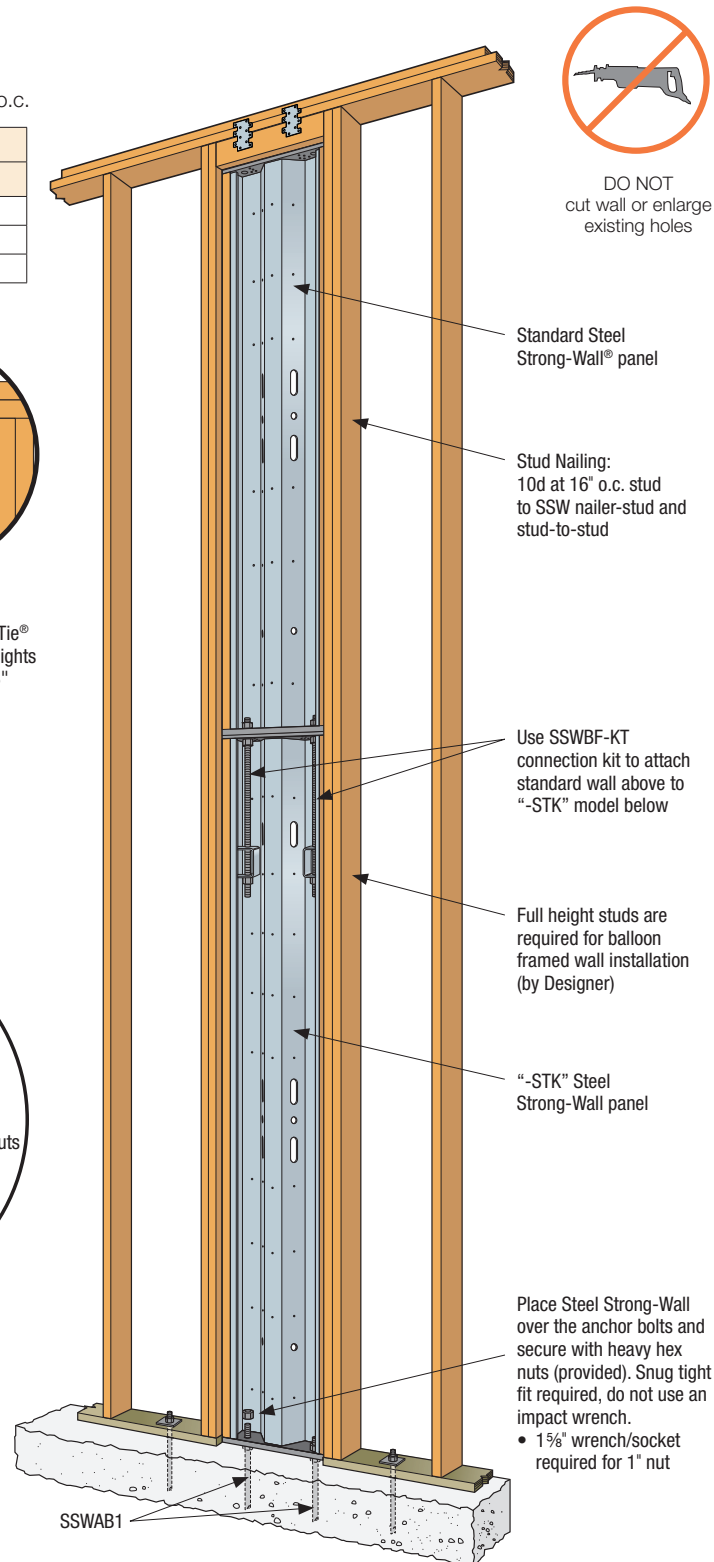

## Balloon Framing Installation

U.S. Patent 8,281,551; 8,689,518  
Canadian Patent 2,489,845

# Balloon Framing on Concrete Foundations

Nominal Wall Height (ft.)	Actual Stacked SSW Height <sup>4</sup> (ft. - in.)	Bottom Wall SSW Model	Top Wall SSW Model	Seismic <sup>2</sup>			Wind		
				Allowable ASD Shear Load V <sup>6</sup> (lb.)	Drift at Allowable Shear (in.)	Anchor Tension at Allowable Shear <sup>8</sup> (lb.)	Allowable ASD Shear Load V <sup>6</sup> (lb.)	Drift at Allowable Shear (in.)	Anchor Tension at Allowable Shear <sup>8</sup> (lb.)
15"-Wide Walls									
15	14 - 5 ¼	SSW15x8-STK <sup>6</sup>	SSW15x7 <sup>6</sup>	—	—	—	705	1.00	12,465
16	15 - 6 ½	SSW15x8-STK <sup>6</sup>	SSW15x8 <sup>6</sup>	—	—	—	645	1.06	12,105
17	16 - 5 ¼	SSW15x10-STK <sup>6</sup>	SSW15x7 <sup>6</sup>	—	—	—	595	1.11	11,820
18	17 - 6 ½	SSW15x10-STK <sup>6</sup>	SSW15x8 <sup>6</sup>	—	—	—	555	1.17	11,655
19	18 - 6 ½	SSW15x10-STK <sup>6</sup>	SSW15x9 <sup>6</sup>	—	—	—	520	1.23	11,505
20	19 - 6 ½	SSW15x10-STK <sup>6</sup>	SSW15x10 <sup>6</sup>	—	—	—	485	1.29	11,260
18"-Wide Walls									
15	14 - 5 ¼	SSW18x8-STK	SSW18x7	890	0.79	12,020	1,130	1.00	16,105
16	15 - 6 ½	SSW18x8-STK	SSW18x8	825	0.84	11,875	1,050	1.07	15,945
17	16 - 5 ¼	SSW18x10-STK	SSW18x7	770	0.89	11,770	980	1.13	15,795
18	17 - 6 ½	SSW18x10-STK	SSW18x8	—	—	—	915	1.20	15,585
19	18 - 6 ½	SSW18x10-STK	SSW18x9	—	—	—	860	1.27	15,440
20	19 - 6 ½	SSW18x10-STK	SSW18x10	—	—	—	810	1.33	15,290
21"-Wide Walls									
15	14 - 5 ¼	SSW21x8-STK	SSW21x7	1,295	0.78	14,605	1,670	1.00	20,000
16	15 - 6 ½	SSW21x8-STK	SSW21x8	1,220	0.84	14,710	1,550	1.07	19,770
17	16 - 5 ¼	SSW21x10-STK	SSW21x7	1,135	0.89	14,520	1,445	1.13	19,550
18	17 - 6 ½	SSW21x10-STK	SSW21x8	1,065	0.95	14,425	1,350	1.20	19,300
19	18 - 6 ½	SSW21x10-STK	SSW21x9	1,000	1.00	14,285	1,270	1.27	19,145
20	19 - 6 ½	SSW21x10-STK	SSW21x10	940	1.05	14,120	1,195	1.33	18,930
24"-Wide Walls									
15	14 - 5 ¼	SSW24x8-STK	SSW24x7	1,680	0.72	16,100	2,295	1.00	23,645
16	15 - 6 ½	SSW24x8-STK	SSW24x8	1,630	0.81	16,790	2,155	1.07	23,730
17	16 - 5 ¼	SSW24x10-STK	SSW24x7	1,545	0.87	16,950	2,005	1.13	23,405
18	17 - 6 ½	SSW24x10-STK	SSW24x8	1,470	0.94	17,115	1,875	1.20	23,130
19	18 - 6 ½	SSW24x10-STK	SSW24x9	1,390	1.00	17,095	1,765	1.27	22,960
20	19 - 6 ½	SSW24x10-STK	SSW24x10	1,310	1.05	16,945	1,660	1.33	22,685

- Allowable shear loads and anchor tension forces are applicable to installation on concrete with minimum  $f'c = 2,500$  psi using the ASD basic (Section 1605.3.1) or the alternative basic (Section 1605.3.2) load combinations. Load values include evaluation of bearing stresses on the foundation and do not require further evaluation by the Designer.
- For seismic designs based on the 2015 IBC using  $R = 6.5$ . For other codes, use the seismic coefficients corresponding to light-frame bearing walls with wood structural panels or sheet steel panels.
- Allowable shear, drift, and anchor tension values apply to the nominal wall heights listed and may be linearly interpolated for intermediate heights.
- Solid shim blocks (12" maximum) shall be used to attain specified nominal wall height. See detail 4/SSW3 on page 75 for additional details.

- Full-height studs are required for balloon framed wall installation, which must be designed for out-of-plane loads in accordance with the applicable code. Two 2x6 minimum are required on each side and fastened together with 10d common nails at 16 inches on center.
- Loads are based on a 1,000 lb. maximum axial load acting on the entire panel in combination with the shear load. For shear loads at 2,000 lb. maximum axial load, multiply allowable shears by 0.91 for SSW15x models; no reduction required for other wall models.
- High-strength anchor bolts are required for anchor tension forces exceeding the allowable load for standard-strength bolts tabulated on pages 29–30. See pages 29–35 for SSWAB anchor bolt information and anchorage solutions.
- Tabulated anchor tension loads assume no resisting axial load. For anchor tension loads at design shear values and including the effect of axial load, refer to the Strong-Wall Shearwall Selector web application or use the equations on page 15. Drifts at lower design shear may be linearly reduced.

## Cumulative Overturning

### Key Consideration in Strong-Wall® Shearwall Specification Process

When specifying a premanufactured shearwall for a project, several factors need to be considered, such as load values, seismic/wind requirements, wall width and height, wall placement, etc. Cumulative Overturning is another critical factor often overlooked in multi-story applications.

#### Calculating Cumulative Overturning for Pre-Manufactured Shearwalls

Designers are accustomed to accounting for cumulative overturning when specifying multi-story, site-built plywood shearwalls. However, when specifying premanufactured shearwalls, Designers typically calculate shear loads based on the building geometry and code loading requirements. A wall is then selected based on its ability to meet or exceed the required shear load using manufacturer-provided allowable shear load tables.

What can get lost when considering shear capacity only is that the shearwall is not only governed by shear, but also by a combination of other limit states, including *drift*, *tension and compression*, *flexure*, *anchor rod tension*, and *concrete or wood bearing stress*. For single-story walls, the allowable shear given in the load tables is the lowest value of the various limit states. However, additional care must be taken in the analysis of multi-story shearwalls to account for the way the loads are distributed over the height of the building.


#### Cumulative Overturning and Stacked-Wall Applications

In multi-story structures, shear and the associated overturning forces due to seismic/wind requirements must be carried down to the foundation by the building's lateral force resisting system. These forces are cumulative over the height of the building, and shear forces applied at the second or third levels of a structure will generate much larger base overturning moments than the same shears applied at the first story. If cumulative overturning is not considered, the design may result in forces several times higher than the capacity of the lower wall, anchor bolts and foundation anchorage.

When specifying stacked shearwall applications, it's imperative to consider cumulative overturning. The load values for Simpson Strong-Tie® stacked Steel Strong-Wall® and Strong-Wall® wood shearwall applications reflect the impact of cumulative overturning and thus appear significantly different than other shearwall manufacturers.

The effects of cumulative overturning are automatically taken into account when designing shearwalls with the Strong-Wall Shearwall Selector web application. For more information on this design tool, visit [strongtie.com/swss](http://strongtie.com/swss).

**To learn more about cumulative overturning and Simpson Strong-Tie® Strong-Wall® shearwall testing, visit [strongtie.com/co](http://strongtie.com/co).**

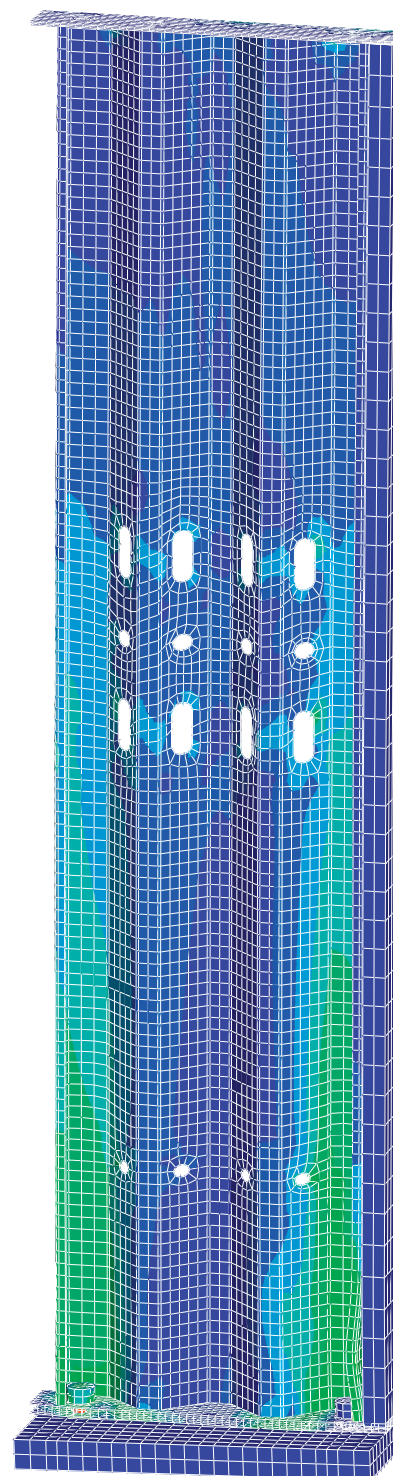

Simpson Strong-Tie® Steel Strong-Wall® shearwall rendered in Finite Element Analysis (FEA). When evaluating the performance of complex structural components, our engineers use this computer simulation to complement our full-scale testing program.


















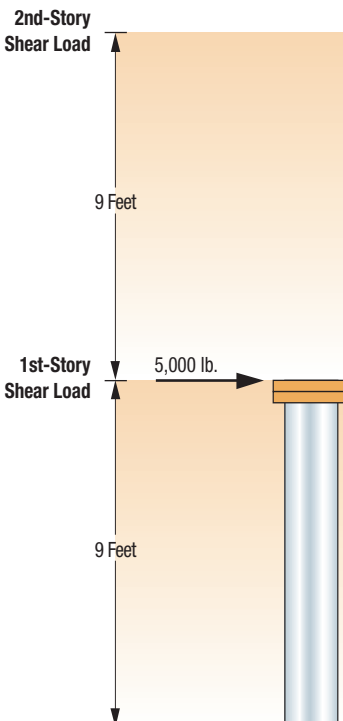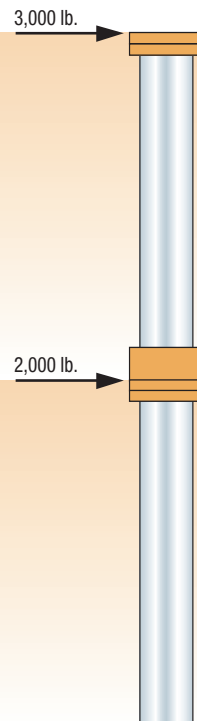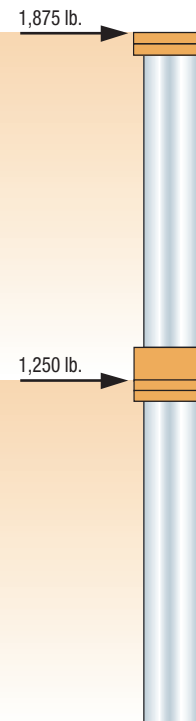

## Cumulative Overturning

### Shear Only vs. Shear and Cumulative Overturning Analysis

The graphic illustration below compares how the total allowable shear load is impacted when the effects of cumulative overturning are included in the analysis. As a point of reference (Figure A), a one-story, nine-foot tall shear wall with a 5,000-lb. lateral load capacity is used. The reference wall has a resulting base overturning moment capacity of 45,000 ft.-lb. and an overturning force of 22,500 lb. assuming a 2 ft. moment arm.

moment arm. As illustrated, if the same base shear is applied over two stories, the overturning at the base of the wall exceeds the one-story application by 60% (Figure B). When proper consideration of cumulative overturning is included in the design, the total allowable shear load on a stacked wall is reduced (Figure C).

	Figure A — One-Story Wall	Figure B — Two-Story Wall	Figure C — Two-Story Wall
	Reference	 Shear Only	 Shear and Cumulative Overturning
			
Total Base Shear Reaction	<div>5,000 lb.</div> <div></div> <div>Maximum Shear Capacity</div>	<div>5,000 lb.</div> <div></div> <div>Adequate Design for Shear</div>	<div>3,125 lb.</div> <div></div> <div>Adequate Design for Shear</div>
Overturning Moment	<div>45,000 ft.-lb.</div> <div></div> <div>Maximum Moment Capacity</div>	<div>72,000 ft.-lb.</div> <div></div> <div>Exceeds Moment by 60%*</div>	<div>45,000 ft.-lb.</div> <div></div> <div>Adequate Design for Moment</div>
Overturning Force (Assumes 2 ft. Moment Arm)	<div>22,500 lb.</div> <div></div> <div>Maximum Overturning Force</div>	<div>36,000 lb.</div> <div></div> <div>Exceeds Overturning Force by 60%*</div>	<div>22,500 lb.</div> <div></div> <div>Adequate Design for Overturning Force</div>

#### \*Example calculations:

$(2\text{nd-Story Shear Load} \times \text{Total Story Height}) + (1\text{st-Floor Shear Load} \times 1\text{st-Story Height}) = \text{Overturning Moment} > \text{Baseline Limit of the Lowest Panel}$   
 $(3,000 \text{ lb.} \times 18') + (2,000 \text{ lb.} \times 9') = 72,000 \text{ ft.-lb.} > 45,000 \text{ ft.-lb.}$

$(\text{Overturning Moment}) \div (\text{Moment Arm}) = \text{Overturning Force} > \text{Baseline Limit of the Lowest Panel}$   
 $(72,000 \text{ ft.-lb.}) \div (2 \text{ ft.}) = 36,000 \text{ lb.} > 22,500 \text{ lb.}$

**Note:** Loads shown are for illustrative purposes only. Redistribution of earthquake loads per building code requirements will compound the effects of cumulative overturning.

# Two-Story Stacked on Concrete Foundations

Simpson Strong-Tie offers a complete stacked-wall solution for two-story applications. This Steel Strong-Wall® Shearwall option combines simplified installation with superior performance.

- Some of the highest loads in the industry and design procedures that account for cumulative overturning, see pages 23–24 for more information.
- Complete concrete-anchorage designs for two-story applications (*foundation design by Designer*)
- No bearing plates to install, walls can now be placed flush against a corner.
- Uses the same anchor bolt template as single-story installation.
- Compression loads transferred by nut/rod — reducing wood crushing under load.

**Material & Finish:** See page 10.


**Codes:** ICC-ES ESR-1679;

City of L.A. RR25625;


State of Florida FL5113

## Top Wall:

### Naming Legend



## Bottom Wall:

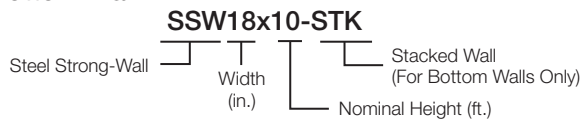

Suggested Example Specification: SSW18x8 over SSW18x10-STK

## Two-Story Stacked-Wall Product Data — Bottom Walls


Model No.	W (in.)	H (in.)	T (in.)	Anchor Bolts		Number of Screws in Top of Wall
				Qty.	Dia. (in.)	
SSW15x8-STK	15	93 1/4	3 1/2	2	1	6
SSW18x8-STK	18	93 1/4	3 1/2	2	1	9
SSW21x8-STK	21	93 1/4	3 1/2	2	1	12
SSW24x8-STK	24	93 1/4	3 1/2	2	1	14
SSW15x9-STK	15	105 1/4	3 1/2	2	1	6
SSW18x9-STK	18	105 1/4	3 1/2	2	1	9
SSW21x9-STK	21	105 1/4	3 1/2	2	1	12
SSW24x9-STK	24	105 1/4	3 1/2	2	1	14
SSW15x10-STK	15	117 1/4	3 1/2	2	1	6
SSW18x10-STK	18	117 1/4	3 1/2	2	1	9
SSW21x10-STK	21	117 1/4	3 1/2	2	1	12
SSW24x10-STK	24	117 1/4	3 1/2	2	1	14
SSW15x11-STK	15	129 1/4	5 1/2	2	1	6
SSW18x11-STK	18	129 1/4	5 1/2	2	1	9
SSW21x11-STK	21	129 1/4	5 1/2	2	1	12
SSW24x11-STK	24	129 1/4	5 1/2	2	1	14
SSW15x12-STK	15	141 1/4	5 1/2	2	1	6
SSW18x12-STK	18	141 1/4	5 1/2	2	1	9
SSW21x12-STK	21	141 1/4	5 1/2	2	1	12
SSW24x12-STK	24	141 1/4	5 1/2	2	1	14
SSW18x13-STK	18	153 1/4	5 1/2	2	1	9
SSW21x13-STK	21	153 1/4	5 1/2	2	1	12
SSW24x13-STK	24	153 1/4	5 1/2	2	1	14

1. See page 11 for product data on top wall.

## Two-Story Stacked-Wall Connection Kit

Wall Width (in.)	Model No.	Contents
15	SSW15-2KT	(1) Shear-Transfer Plate (with #14 self-drilling screws) (2) 1" x 48" Threaded Rods F1554 Grade 36 (6) Heavy Hex Nuts Installation Instructions
18	SSW18-2KT	
21	SSW21-2KT	
24	SSW24-2KT	

1. Two heavy hex nuts included with each wall.

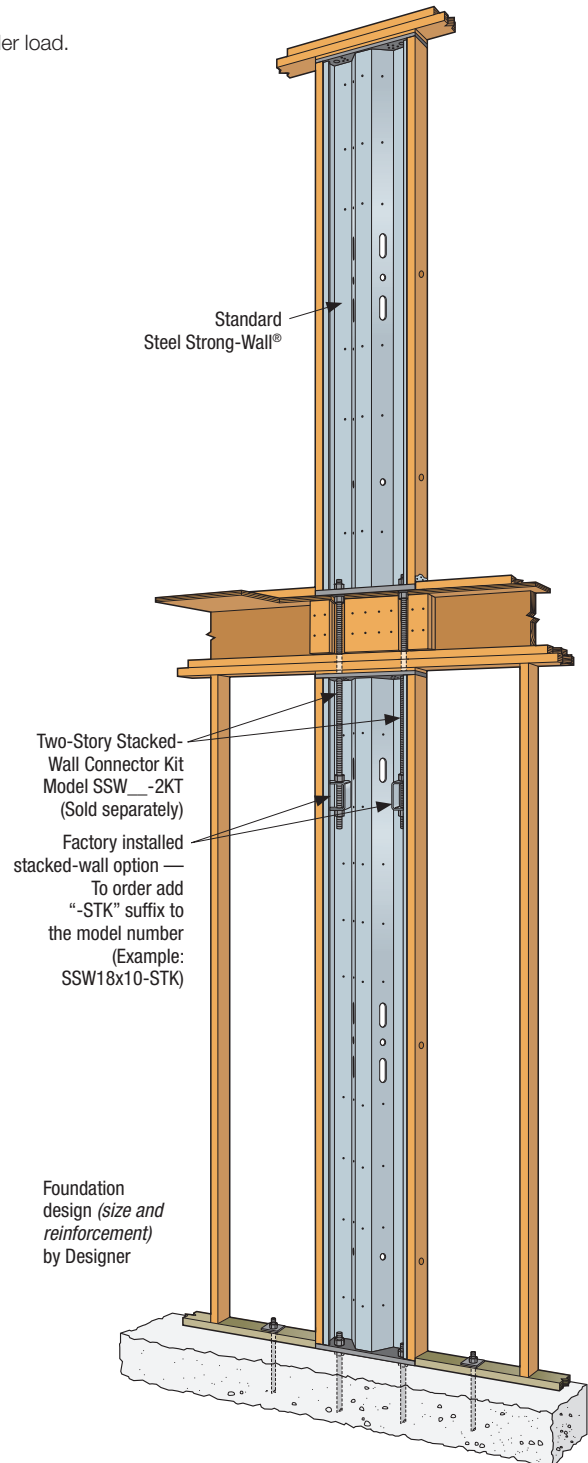

### Two-Story Stacked Installation

U.S. Patent 8,281,551; 8,689,518  
Canadian Patent 2,489,845

# Two-Story Stacked on Concrete Foundations

## Installation Notes

- Do not cut the Steel Strong-Wall® or enlarge existing holes, doing so will compromise the performance of the wall.
- Do not use an impact wrench to tighten nuts on the anchor bolts.
- Maximum shim thickness between the Steel Strong-Wall and top plates is  $\frac{7}{8}$ " using Simpson Strong-Tie® Strong-Drive®  $\frac{1}{4}$ " x  $3\frac{1}{2}$ " SDS Heavy-Duty Connector screws. For additional shim thicknesses, see detail 5/SSW2 on page 67 and detail 9/SSW2 on page 71.

## Shear-Transfer Plate Fasteners

Strong-Wall Width	Fastener Quantity	
	#14 Screws	10d Nails
15" Wall	4	10
18" Wall	6	12
21" Wall	6	16
24" Wall	7	18

SSW Shear-Transfer Plate installs with 10d nails into the rim joist and #14 self-drilling screws into the Strong-Wall® (Sold separately with SSW\_-2KT)

Simpson Strong-Tie® A34 each side (sold separately)

Rim joist

Exterior View of Shear-Transfer Plate

Solid blocking under center and each end of wall

Drill/notch subfloor to allow nut to sit flush with underside of wall (notching of rim joist may also be required)

### Blocking/Connection Detail

(See detail 8/SSW2 on page 70 for perpendicular blocking where required)

Use SSW\_-2KT connection kit to attach standard wall above to "-STK" model below

Shim as necessary for tight fit

Install connecting rods before placing 2nd floor wall

Attach to top plates with  $\frac{1}{4}$ " x  $3\frac{1}{2}$ " SDS Heavy-Duty Connector screws (provided)

All nuts require a snug tight fit

Double nuts

Two-Story Stacked-Wall Connection Detail

### First-Story Installation With Wood Floor System

See detail 7/SSW2 on page 70. Height modification options available, contact Simpson Strong-Tie.

### Two-Story Stacked Installation

U.S. Patent 8,281,551; 8,689,518  
Canadian Patent 2,489,845

Place Steel Strong-Wall® over the anchor bolts and secure with heavy hex nuts (provided). Snug tight fit required, do not use an impact wrench.  
•  $1\frac{1}{8}$ " wrench/socket required for 1" nut

SSWAB1



# Two-Story Stacked on Concrete Foundations

## Second-Story Walls<sup>6</sup>

Second-Story Wall Models	Seismic <sup>2</sup>		Wind	
	Allowable ASD Shear Load V <sup>6</sup> (lb.)	Drift at Allowable Shear (in.)	Allowable ASD Shear Load V <sup>6</sup> (lb.)	Drift at Allowable Shear (in.)
SSW15x7	600	0.21	600	0.21
SSW18x7	1,210	0.24	1,390	0.28
SSW21x7	1,735	0.23	1,815	0.24
SSW24x7	2,330	0.22	2,330	0.22
SSW15x8	550	0.26	550	0.26
SSW18x8	1,130	0.32	1,315	0.37
SSW21x8	1,625	0.30	1,715	0.32
SSW24x8	2,050	0.26	2,050	0.26
SSW15x9	510	0.31	510	0.31
SSW18x9	1,070	0.39	1,220	0.45
SSW21x9	1,520	0.36	1,520	0.36
SSW24x9	1,815	0.30	1,815	0.30
SSW15x10	470	0.37	470	0.37
SSW18x10	1,010	0.47	1,095	0.51
SSW21x10	1,365	0.39	1,365	0.39
SSW24x10	1,630	0.35	1,630	0.35
SSW15x11	440	0.43	440	0.43
SSW18x11	960	0.55	995	0.57
SSW21x11	1,235	0.46	1,235	0.46
SSW24x11	1,480	0.39	1,480	0.39
SSW15x12	405	0.50	405	0.50
SSW18x12	900	0.63	910	0.64
SSW21x12	1,130	0.52	1,130	0.52
SSW24x12	1,355	0.43	1,355	0.43
SSW18x13	830	0.68	840	0.69
SSW21x13	1,045	0.57	1,045	0.57
SSW24x13	1,250	0.48	1,250	0.48

1. Allowable base moment and anchor tension are applicable to installation on concrete foundations with minimum  $f'_c = 2,500$  psi using the ASD basic (Section 1605.3.1) or the alternative basic (Section 1605.3.2) load combinations. Load values include evaluation of anchor rod compression at second story and bearing stresses at foundation.
2. For seismic designs based on the 2015 IBC using  $R = 6.5$ . For other codes, use the seismic coefficients corresponding to light-frame bearing walls with wood structural panels or sheet steel panels.
3. Two-story stacked-wall installations may consist of any height-combination of equal width wall models listed in these tables.
4. Loads are based on a 1,000 lb. maximum uniformly distributed total axial load acting on the second-story panel and a 2,000 lb. maximum uniformly distributed total axial load acting on the first-story panel in combination with the tabulated shear load and base moment.
5. The Designer must verify that the cumulative overturning moment at the base of the first-story Steel Strong-Wall® does not exceed the allowable base moment capacity. See design example on page 24 for procedure.
6. The allowable second-story shear loads assume a maximum floor joist depth of 14". For allowable shear load with up to 18" joists, multiply second-story allowable shear loads by 0.98 for SSW15x models and by 0.94 for other SSW widths. For bottom wall shims greater than  $\frac{7}{8}$ " thick, see detail 9/SSW2 on page 71.
7. Allowable shear, drift, and base moment values may be interpolated for intermediate heights.
8. Minimum ASTM F1554 Grade 36 threaded rods are required at the second-story wall anchorage.
9. High-strength anchor bolts are required at the first-story wall for anchor tension forces exceeding the allowable load for standard-strength bolts tabulated on pages 29–30. See pages 29–35 for SSWAB anchor bolt information and anchorage solutions.
10. Tabulated anchor tension loads assume no resisting axial load. For anchor tension loads at design shear values and including the effect of axial load, refer to the Strong-Wall Selector web application or use the equations on page 15. Drifts at lower design shear or base moment may be linearly reduced.

## First-Story Walls On Concrete Foundations<sup>5,9</sup>

First-Story Wall Models	Seismic <sup>2</sup>			Wind		
	Allowable ASD Base Moment (ft.-lb.)	Drift at Allowable Base Moment (in.)	Anchor Tension at Allowable Base Moment <sup>10</sup> (lb.)	Allowable ASD Base Moment (ft.-lb.)	Drift at Allowable Base Moment (in.)	Anchor Tension at Allowable Base Moment <sup>10</sup> (lb.)
SSW15x8-STK	9,665	0.35	11,385	9,665	0.35	11,385
SSW18x8-STK	19,270	0.41	19,520	22,690	0.49	24,875
SSW21x8-STK	27,665	0.39	23,360	30,775	0.43	27,240
SSW24x8-STK	37,805	0.37	27,435	39,670	0.39	29,370
SSW15x9-STK	9,490	0.37	11,130	9,490	0.38	11,130
SSW18x9-STK	18,815	0.47	18,890	22,685	0.57	24,870
SSW21x9-STK	27,585	0.46	23,265	31,310	0.52	27,970
SSW24x9-STK	37,585	0.44	27,215	40,390	0.47	30,150
SSW15x10-STK	9,225	0.45	10,755	9,225	0.45	10,755
SSW18x10-STK	18,175	0.53	18,030	22,585	0.65	24,690
SSW21x10-STK	29,750	0.50	25,905	31,485	0.55	28,210
SSW24x10-STK	37,470	0.50	27,100	40,925	0.55	30,740
SSW15x11-STK	9,025	0.50	10,475	9,025	0.50	10,475
SSW18x11-STK	17,610	0.58	17,295	22,115	0.73	23,880
SSW21x11-STK	26,765	0.58	22,325	30,860	0.67	27,355
SSW24x11-STK	37,430	0.57	27,060	40,260	0.61	30,005
SSW15x12-STK	8,675	0.57	9,990	8,675	0.57	9,990
SSW18x12-STK	17,070	0.63	16,605	21,600	0.80	23,030
SSW21x12-STK	26,015	0.63	21,490	30,195	0.73	26,475
SSW24x12-STK	37,080	0.63	26,710	39,545	0.67	29,235
SSW18x13-STK	17,050	0.68	16,580	21,155	0.85	22,315
SSW21x13-STK	25,350	0.68	20,765	29,505	0.79	25,590
SSW24x13-STK	36,140	0.68	25,790	38,795	0.73	28,450

See footnotes above.

## Two-Story Stacked on Concrete Foundations

### Two-Story Design Example

#### Example: Standard Two-Story Wall Design

##### Given:

Wind,  $f_c = 2,500$  psi

$V_{2\text{nd-story wall}} = 650$  lb.

$V_{1\text{st-story wall}} = 650$  lb.

$V_{\text{total}} = 650 \text{ lb.} + 650 \text{ lb.} = 1,300$  lb.

$M_{\text{allow}} = \text{Allowable ASD Base Moment (ft.-lb.)}$   
 (See Two-Story Stacked Tables)

$V_{\text{allow}} = \text{Allowable ASD Shear Load V (lb.)}$   
 (See Two-Story Stacked Tables)

#### Step 1 – Select First-Story Wall (See tables on page 27)

$M_{\text{base}} = (650 \text{ lb.} \times 18 \text{ ft.}) + (650 \text{ lb.} \times 9 \text{ ft.}) = 17,550 \text{ ft.-lb.}$

Using First-Story Wall Table, select a 9-foot wall with  $M_{\text{allow}} \geq M_{\text{base}}$

Select SSW18x9-STK


$M_{\text{allow}} = 22,685 \text{ ft.-lb.} > 17,550 \text{ ft.-lb.}$  **OK**

#### Step 2 – Check Second-Story Wall

Using the Second-Story Wall Table on page 27, check the capacity of an 8-foot wall with the same width as the First-Story Wall selected in Step 1:

Select SSW18x8

$V_{\text{allow}} = 1,315 \text{ lb.} > 650 \text{ lb.}$  **OK**

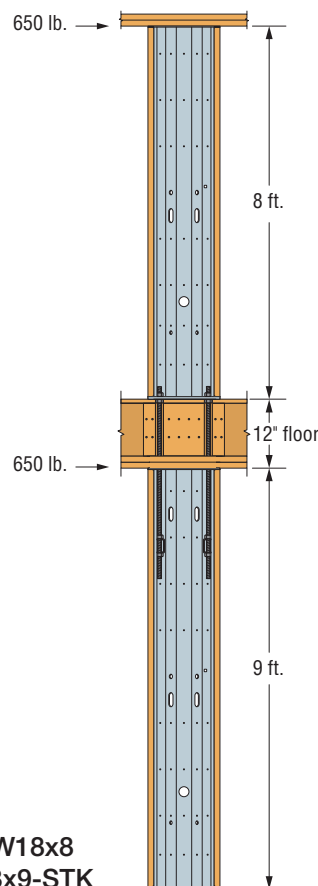



**>>> Use SSW18x8  
over SSW18x9-STK**

## Cold-Formed Steel on Concrete Foundations

The Steel Strong-Wall® provides high-capacity, narrow- wall solutions for cold-formed steel (CFS) framing. Wall models for this application, designated by the S/SSW model prefix, install easily in CFS framing, and preattached steel studs allow easy attachment of interior and exterior finishes. Simpson Strong-Tie offers Steel Strong-Wall solutions for standard CFS applications on concrete, first-story floor systems, and two-story stacked applications on concrete.

#### The Cold-Formed Steel Connectors Catalog

All of the design, specification and installation information you need on our Steel Strong-Wall for CFS applications is contained in the *Cold-Formed Steel Connectors* catalog. In addition to this resource, or to learn more, visit [strongtie.com/cfs](http://strongtie.com/cfs).

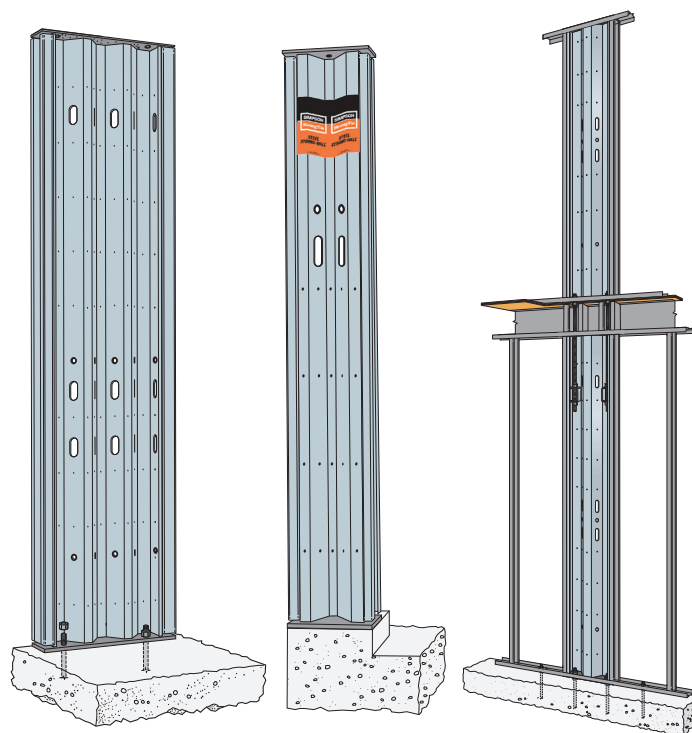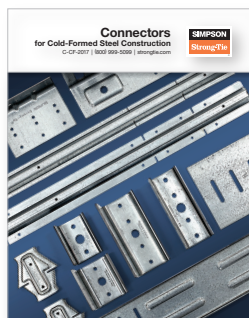

**Cold-Formed Steel Applications**  
 (Standard, Raised Floor and Two-Story)


# Anchorage Solutions

## SSWAB Anchor Bolts

SSWAB anchor bolts in 3/4" and 1" diameters offer flexibility to meet specific project demands. Inspection is easy; the head is stamped with a "No Equal" symbol for identification, bolt length, bolt diameter, and optional "HS" for High Strength if specified.

**Material:** ASTM F1554 Grade 36; High Strength (HS) ASTM A449


*An additional nut for template installation is provided with each SSWAB. It may also be used for SSW installation.*

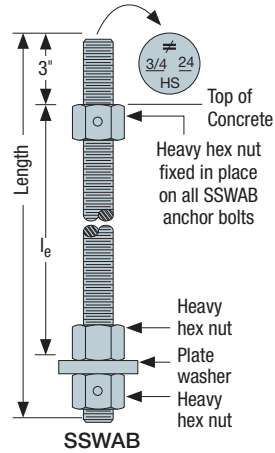

Steel Strong-Wall® Width (in.)	Model No.	Dia. (in.)	Total Length (in.)	le (in.)
12	SSWAB3/4x24	3/4	24	19
	SSWAB3/4x24HS	3/4	24	19
	SSWAB3/4x30	3/4	30	25
	SSWAB3/4x30HS	3/4	30	25
	SSWAB3/4x36HS	3/4	36	31
15, 18, 21, 24	SSWAB1x24	1	24	19
	SSWAB1x24HS	1	24	19
	SSWAB1x30	1	30	25
	SSWAB1x30HS	1	30	25
	SSWAB1x36HS	1	36	31


## SSWHSR Extension Kit

SSWHSR allows for anchorage in tall stemwall applications where full embedment of an SSWAB into the footing is required. The head is stamped for identification like an SSWAB. Kit includes ASTM A449 high-strength rod with heavy hex nut fixed in place and high strength coupler nut. Do not use in place of SSWAB.

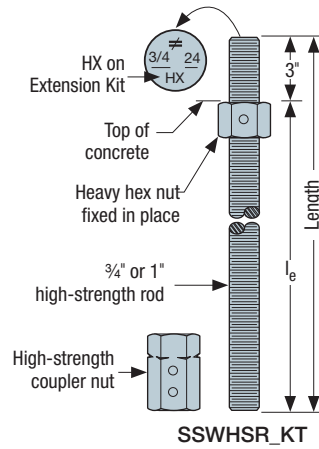

Steel Strong-Wall® Width (in.)	Model No.	Dia. (in.)	Total Length (in.)	le (in.)
12	SSWHSR3/4x2KT	3/4	24	21
	SSWHSR3/4x3KT	3/4	36	33
15, 18, 21, 24	SSWHSR1x2KT	1	24	21
	SSWHSR1x3KT	1	36	33

$$\text{Total } l_e = \text{SSWHSR } l_e + \text{SSWAB } l_e + 3''$$

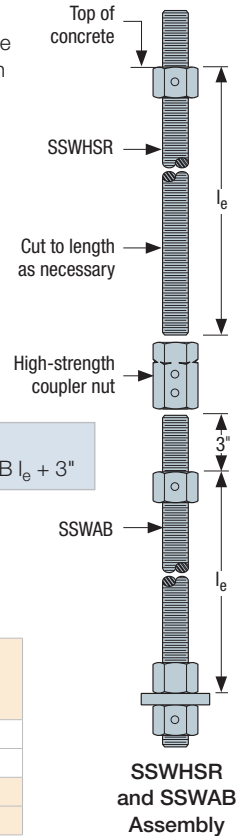

## Steel Strong-Wall® Anchorage Solutions — 2,500 psi Concrete<sup>1,2,6</sup>

Design Criteria	Concrete Condition	Anchor Strength <sup>3</sup>	SSWAB 3/4" Anchor Bolt			SSWAB 1" Anchor Bolt		
			ASD Allowable Tension (lb.)	W (in.)	de (in.)	ASD Allowable Tension (lb.)	W (in.)	de (in.)
Seismic <sup>4</sup>	Cracked	Standard	8,800	22	8	16,100	33	11
			9,600	24	8	17,100	35	12
		High Strength	18,500	36	12	33,000	51	17
			19,900	38	13	35,300	54	18
	Uncracked	Standard	8,800	19	7	15,700	28	10
			9,600	21	7	17,100	30	10
		High Strength	18,300	31	11	32,300	44	15
			19,900	33	11	35,300	47	16
Wind <sup>5</sup>	Cracked	Standard	5,100	14	6	6,200	16	6
			7,400	18	6	11,400	24	8
			9,600	22	8	17,100	32	11
		High Strength	11,400	24	8	21,100	36	12
			13,600	27	9	27,300	42	14
			15,900	30	10	31,800	46	16
			19,900	35	12	35,300	50	17
			19,900	35	12	35,300	50	17
	Uncracked	Standard	5,000	12	6	6,400	14	6
			7,800	16	6	12,500	22	8
			9,600	19	7	17,100	28	10
		High Strength	12,500	22	8	21,900	32	11
			14,300	24	8	26,400	36	12
			17,000	27	9	31,500	40	14
			19,900	30	10	35,300	43	15

- See pages 32–33 for foundation illustrations showing W and de dimensions.
- Anchorage designs conform to ACI 318-14 and 318-11 Appendix D with no supplementary reinforcement and cracked or uncracked concrete as noted.
- Anchor strength indicates required grade of SSWAB anchor bolt. Standard or High Strength (HS).
- Seismic indicates Seismic Design Category C through F. Detached 1 and 2 family dwellings in SDC C may use wind anchorage solutions. Seismic anchorage designs conform to ACI 318-14 Section 17.2.3.4.3 and ACI 318-11 Section D.3.3.4.
- Wind includes Seismic Design Category A and B.
- Foundation dimensions are for anchorage only. Foundation design (size and reinforcement) by Designer. The registered design professional may specify alternate embedment, footing size or anchor bolt.



# Anchorage Solutions

## Steel Strong-Wall® Anchorage Solutions — 3,500 psi Concrete<sup>1,2,6</sup>

Design Criteria	Concrete Condition	Anchor Strength <sup>3</sup>	SSWAB ¾" Anchor Bolt			SSWAB 1" Anchor Bolt		
			ASD Allowable Tension (lb.)	W (in.)	d <sub>e</sub> (in.)	ASD Allowable Tension (lb.)	W (in.)	d <sub>e</sub> (in.)
Seismic <sup>4</sup>	Cracked	Standard	9,000	20	7	15,700	29	10
			9,600	21	7	17,100	31	11
		High Strength	18,200	32	11	32,900	46	16
			19,900	34	12	35,300	48	16
	Uncracked	Standard	8,800	17	6	15,700	25	9
			9,600	19	7	17,100	27	9
		High Strength	18,600	28	10	32,600	40	14
			19,900	30	10	35,300	42	14
Wind <sup>5</sup>	Cracked	Standard	6,000	14	6	7,300	16	6
			7,300	16	6	13,500	24	8
			9,600	20	7	17,100	29	10
		High Strength	11,800	22	8	22,700	34	12
			13,500	24	8	27,400	38	13
			17,000	28	10	32,300	42	14
			19,900	32	11	35,300	45	15
	Uncracked	Standard	6,000	12	6	7,500	14	6
			7,500	14	6	12,800	20	7
			9,600	17	6	17,100	25	9
		High Strength	12,800	20	7	21,300	28	10
			14,800	22	8	26,000	32	11
			16,900	24	8	31,300	36	12
			19,900	27	9	35,300	39	13

## Steel Strong-Wall® Anchorage Solutions — 4,500 psi Concrete<sup>1,2,6</sup>

Design Criteria	Concrete Condition	Anchor Strength <sup>3</sup>	SSWAB ¾" Anchor Bolt			SSWAB 1" Anchor Bolt		
			ASD Allowable Tension (lb.)	W (in.)	d <sub>e</sub> (in.)	ASD Allowable Tension (lb.)	W (in.)	d <sub>e</sub> (in.)
Seismic <sup>4</sup>	Cracked	Standard	8,700	18	6	16,000	27	9
			9,600	20	7	17,100	29	10
		High Strength	17,800	29	10	32,100	42	14
			19,900	32	11	35,300	45	15
	Uncracked	Standard	9,100	16	6	15,700	23	8
			9,600	17	6	17,100	25	9
		High Strength	17,800	25	9	32,500	37	13
			19,900	27	9	35,300	39	13
Wind <sup>5</sup>	Cracked	Standard	5,400	12	6	6,800	14	6
			8,300	16	6	11,600	20	7
			9,600	18	6	17,100	26	9
		High Strength	11,600	20	7	21,400	30	10
			13,400	22	8	25,800	34	12
			17,300	26	9	31,000	38	13
			19,900	29	10	35,300	42	14
	Uncracked	Standard	6,800	12	6	6,800	12	6
			8,500	14	6	12,400	18	6
			9,600	16	6	17,100	23	8
		High Strength	12,400	18	6	21,600	26	9
			14,500	20	7	26,700	30	10
			16,800	22	8	32,200	34	12
			19,900	25	9	35,300	36	12

- See pages 32–33 for foundation illustrations showing W and d<sub>e</sub> dimensions.
- Anchorage designs conform to ACI 318-14 and ACI 318-11 Appendix D with no supplementary reinforcement and cracked or uncracked concrete as noted.
- Anchor strength indicates required grade of SSWAB anchor bolt. Standard or High Strength (HS).

- Seismic indicates Seismic Design Category C through F. Detached 1 and 2 family dwellings in SDC C may use wind anchorage solutions. Seismic anchorage designs conform to ACI 318-14 Section 17.2.3.4.3 and ACI 318-11 Section D.3.3.4.
- Wind includes Seismic Design Category A and B.
- Foundation dimensions are for anchorage only. Foundation design (size and reinforcement) by Designer. The registered design professional may specify alternate embedment, footing size or anchor bolt.


## Anchorage Solutions

### Steel Strong-Wall® Shear Anchorage


Foundation shear reinforcement to resist shear forces from Strong-Wall® shearwalls located at the edge of concrete is shown in the table below. The SSW12 and SSW15 used in wind applications do not require shear reinforcement when the shearwall design shear force is less than the anchorage allowable shear load shown in the table below.

Model	$L_t$ or $L_h$ (in.)	Seismic <sup>3</sup>		Wind <sup>4</sup>		ASD Allowable Shear Load $V^6$ (lb.)			
		Shear Reinforcement	Minimum Curb/ Stemwall Width (in.)	Shear Reinforcement	Minimum Curb/ Stemwall Width (in.)				
						6" Minimum Curb/Stemwall		8" Minimum Curb/Stemwall	
						Uncracked	Cracked	Uncracked	Cracked
SSW12	9	(1) #3 Tie	6	See Note 6	—	1,230	880	1,440	1,030
SSW15	12	(2) #3 Ties	6	See Note 6	—	1,590	1,135	1,810	1,295
SSW18	14	(1) #3 Hairpin	8 <sup>5</sup>	(1) #3 Hairpin	6	Hairpin reinforcement achieves maximum allowable shear load of the Steel Strong-Wall®			
SSW21	15	(2) #3 Hairpins	8 <sup>5</sup>	(1) #3 Hairpin	6				
SSW24	17	(2) #3 Hairpins	8 <sup>5</sup>	(1) #3 Hairpin	6				


1. Shear anchorage designs conform to ACI 318-14 and 318-11 and assume minimum  $f'_c = 2,500$  psi concrete. See pages 29–30 for tension anchorage.
2. Shear reinforcement is not required for panels installed on a wood floor, interior foundation applications (*panel installed away from edge of concrete*), or braced-wall panel applications.
3. Seismic indicates Seismic Design Category C through F. Detached 1 and 2 family dwellings in SDC C may use wind anchorage solutions. Seismic shear reinforcement designs conform to ACI 318-14 Section 17.2.3.5.3 and ACI 318-11 Section D.3.3.5.
4. Wind includes Seismic Design Category A and B.
5. Where noted minimum curb/stemwall width is 6" when standard-strength SSWAB is used.
6. Use (1) #3 tie for SSW12 and SSW15 when the Steel Strong-Wall® design shear force exceeds the tabulated anchorage allowable shear load.
7. #4 grade 40 shear reinforcement may be substituted for SSW shear anchorage solutions.
8. The registered design professional may specify alternate shear anchorage.

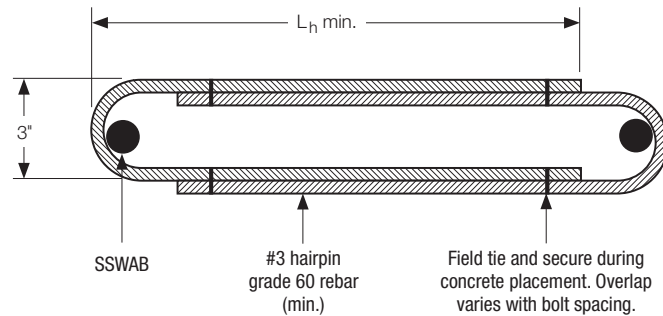

Hairpin Shear Reinforcement

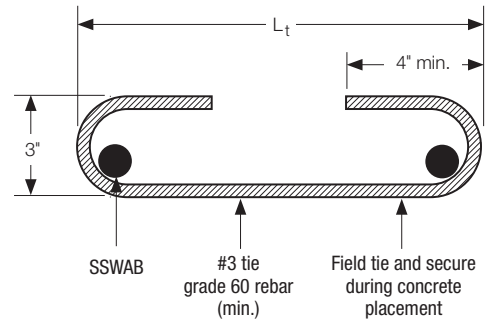


Tie Shear Reinforcement

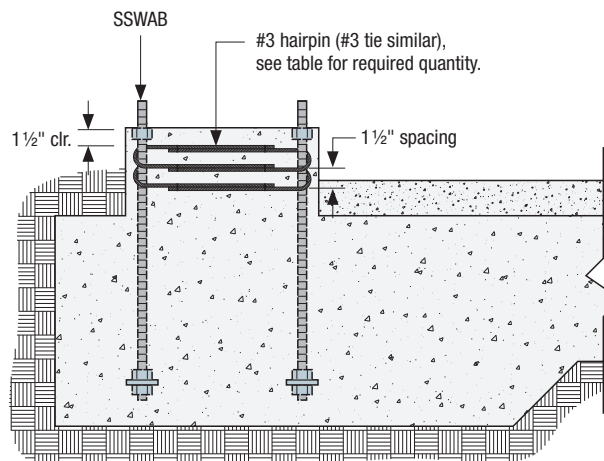



Hairpin Installation  
(Garage curb shown, other footing types similar)

# Anchorage Solutions

## Curb or Stemwall Installation

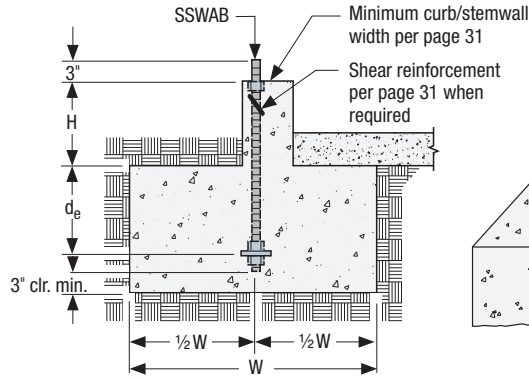


Curb or Stemwall Section View

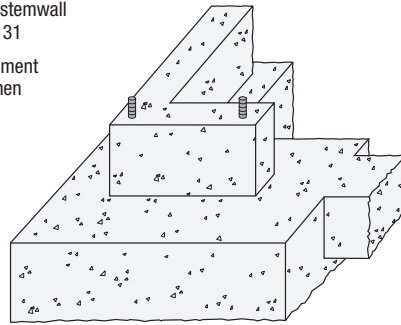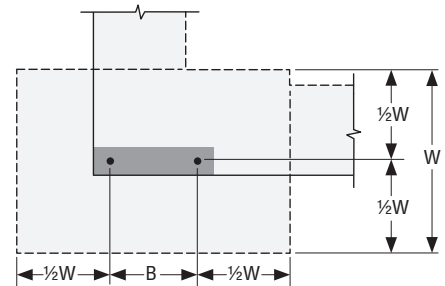
Perspective View  
(Slab not shown for clarity)

Footing Plan


## Slab-on-Grade Installation

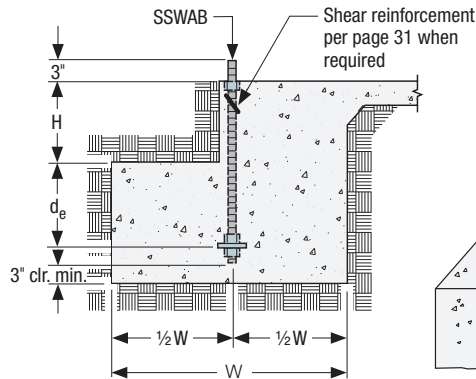

Slab-on-Grade Section View

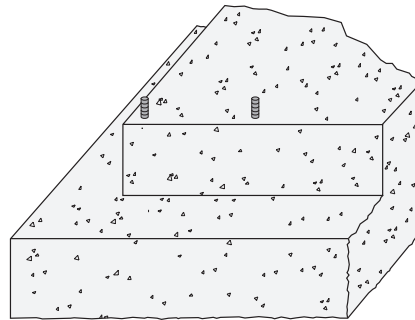


Perspective View

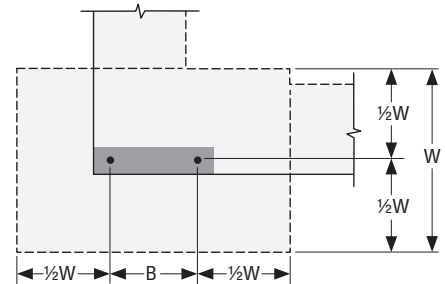


Footing Plan


## Brick Ledge Installation

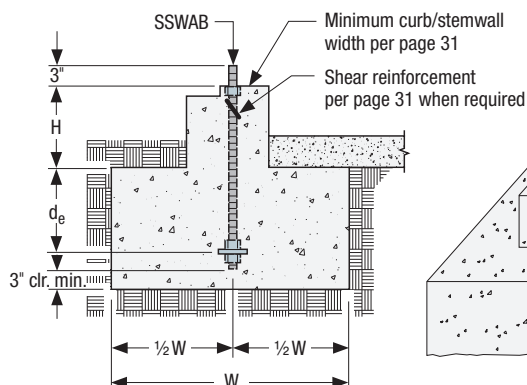

Brick Ledge Section View

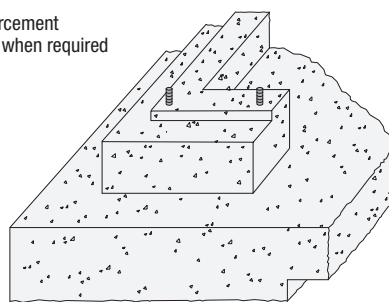

Perspective View

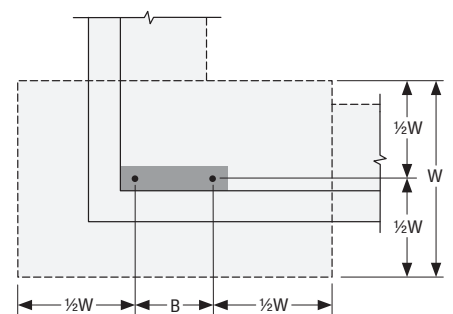

Footing Plan

### Anchorage Solutions General Notes


1. The Designer may specify alternate embedment, footing size or bolt grade.
2. Footing dimensions and rebar requirements are for anchorage only.

Foundation design  
(size and reinforcement) by Designer.




# Anchorage Solutions

## Interior Installation

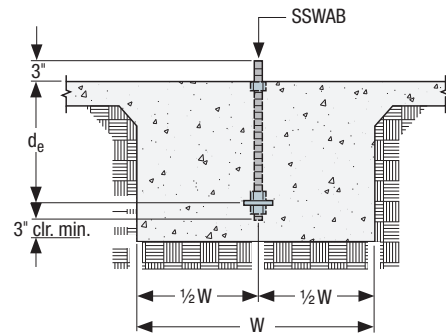

Interior Section View

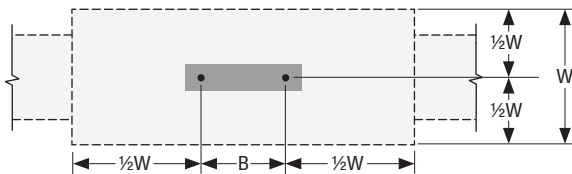


Footing Plan

### Anchorage Solutions General Notes


1. The Designer may specify alternate embedment, footing size or bolt grade.
2. Footing dimensions and rebar requirements are for anchorage only.

## Stemwall Extension Installation

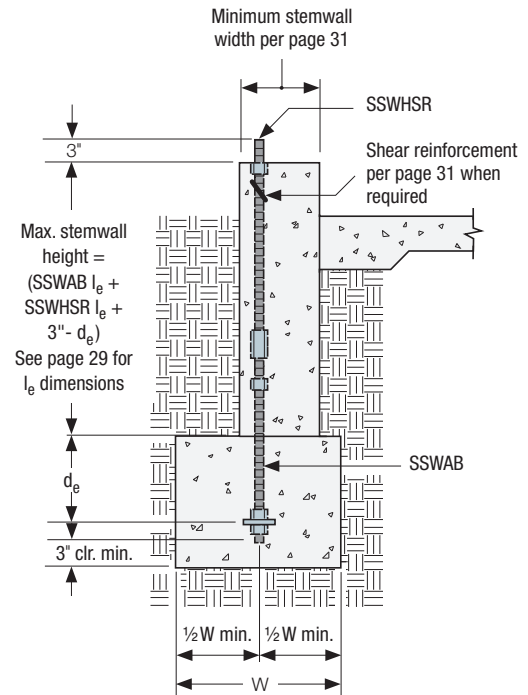Section at Stemwall  
SSWAB and SSWHSR  
Extension Application

## Steel Strong-Wall® Anchor Bolt Layout

Wall Model	Distance From End of Wall to Center of SSWABs (A) (in.)	Distance From Center to Center of SSWABs (B) (in.)	Distance From Exterior Face of Wall to Center of All SSWABs (C) (in.)
SSW12	2 <sup>9</sup> / <sub>16</sub>	6 <sup>7</sup> / <sub>8</sub>	2
SSW15	2 <sup>7</sup> / <sub>8</sub>	9 <sup>1</sup> / <sub>4</sub>	1 <sup>7</sup> / <sub>8</sub>
SSW18	2 <sup>7</sup> / <sub>8</sub>	12 <sup>1</sup> / <sub>4</sub>	1 <sup>7</sup> / <sub>8</sub>
SSW21	2 <sup>7</sup> / <sub>8</sub>	15 <sup>1</sup> / <sub>4</sub>	1 <sup>7</sup> / <sub>8</sub>
SSW24	2 <sup>7</sup> / <sub>8</sub>	18 <sup>1</sup> / <sub>4</sub>	1 <sup>7</sup> / <sub>8</sub>

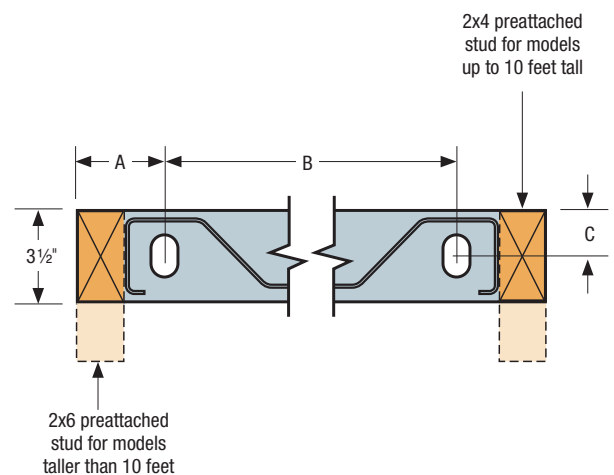


# Anchor Reinforcement Solutions on Grade Beams

Simpson Strong-Tie now provides grade beam anchorage solutions for the Steel Strong-Wall®, which have been calculated to conform to ACI 318-14. Through funding from the Structural Engineers Association of Northern California, initial testing at Scientific Construction Laboratories Inc. confirmed the need to comply with ACI 318 requirements to prevent plastic hinging at anchor locations. Follow-up testing at the Simpson Strong-Tie Tyrell Gilb Research Laboratory was then used to confirm these findings and validate performance. The testing consisted of specimens with closed tie anchor reinforcement, non-closed u-stirrups and control specimens without anchor reinforcement. Flexural and shear reinforcement were designed to resist amplified anchorage forces and compared to test beams designed for non-amplified strength level forces. The test program has proven the performance of the anchor reinforcement details developed by Simpson Strong-Tie.


## Significant Findings From Testing:

Grade beam flexural and shear capacity is critical to anchor performance and must be designed to exceed the demands created by the attached structure. In wind load applications, this demand includes the factored demand from the Steel Strong-Wall (SSW) shearwall. In seismic applications, testing and analysis have shown that in order to achieve the anchor performance expected by ACI 318 anchorage design methodologies, the concrete member design strength needs to resist the amplified anchor design demand from ACI 318-14 Section 17.2.3.4.3 and ACI 318-11 Appendix D Section D.3.3.4.3. To help designers achieve this, Simpson Strong-Tie recommends designers apply the seismic design moment listed in the table below at the SSW location when evaluating the grade beam design strength under seismic loads. The tabulated moment correlates to the lowest of the anchor tension design limits defined in the sections listed above as they relate to each SSW model.

Closed tie anchor reinforcement is critical to maintain the integrity of the reinforced core where the anchor is located. Testing with u-stirrups that did not include complete closed ties showed premature splitting failure of the grade beam.

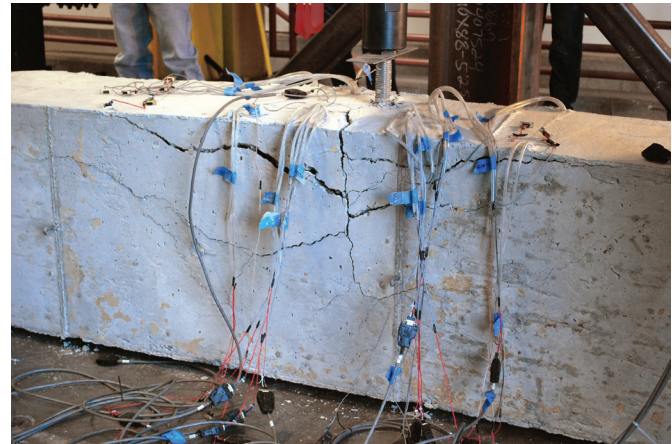

Grade Beam Testing

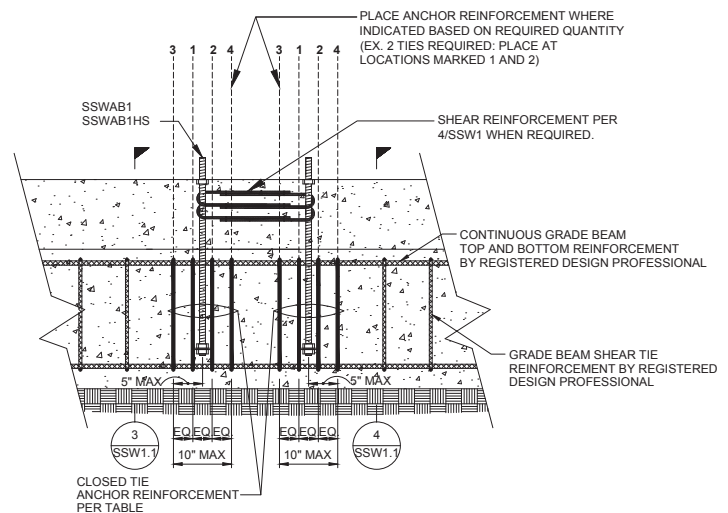

## SSW Grade Beam Anchorage Detail

See page 65 for additional grade beam anchor reinforcement details and requirements

## Steel Strong-Wall Grade Beam Anchorage Solutions

Steel Strong-Wall Model	Anchor Bolt Model No.	Anchor Diameter (in.)	Anchor Reinforcement for Wind and Seismic		Amplified LRFD Applied Design Seismic Moment (ft.-lb.)	
			Standard-Strength SSWAB	High-Strength SSWABHS	Standard-Strength SSWAB	High-Strength SSWABHS
SSW12	SSWAB1	1	(2) #4 Closed Ties / Wall	(5) #4 Closed Ties / Wall	16,700	23,000
SSW15			(4) #4 Closed Ties / Wall	(7) #4 Closed Ties / Wall	37,000	44,000
SSW18			(2) #4 Closed Ties / Anchor	(4) #4 Closed Ties / Anchor	48,700	61,000
SSW21					60,300	77,000
SSW24					72,000	87,000

- Anchor reinforcement conforms to ACI 318-14 Section 17.2.4.9 and ACI 318-11, section D.5.2.9. Full-scale testing was used to validate anchor reinforcement configuration and placement.
- Minimum concrete compressive strength,  $f'_c = 2,500$  psi.
- Closed-tie anchor reinforcement to be ASTM A615 Grade 60 (min.) #4 rebar.
- Grade beam longitudinal and tie reinforcement shall be specified by the registered design professional for flexure and shear loading. Design should consider project specific design loads and allowable soil pressure.
- Simpson Strong-Tie recommends using the tabulated minimum LRFD-applied seismic design moment to ensure grade-beam design flexure and shear strength is adequate to prevent plastic hinge formation under demands associated with anchorage forces corresponding to ACI 318-14 Section 17.2.3.4.3 and ACI 318-11, Section D.3.3.4.3.
- Designer may use reduced moment due to applied SSW lateral load. Minimum moment shall be the lesser of the tabulated moment or the amplified LRFD design moment for seismic: (ASD design demand Shear/0.7)  $\times \Omega_o \times$  SSW height for grade beam design.
- Minimum grade beam design moment for wind and seismic in Seismic Design Category A and B and detached one- and two-family dwellings in SDC C: (ASD design demand Shear/0.6)  $\times$  SSW height.
- Closed tie may be single piece hoop or two piece assembly with a u-stirrup with 135 degree hooks and a top cross tie cap. See detail 6/SSW1.1.
- See details for grade-beam anchor reinforcement placement, installation and spacing requirements. Closed-tie anchor reinforcement quantity is per wall for the 12" and 15" wall models, and per anchor for the 18", 21" and 24" models.


# Anchor Bolt Templates

Simpson Strong-Tie now offers anchor bolt stabilizers that may be used with all anchor template models. The bolt stabilizer enables the Steel Strong-Wall anchorage to be installed without being tied to the footing rebar cage by helping to eliminate movement of the anchor bolts during concrete placement. Two bolt stabilizers are used for each SSW anchor assembly; one at the embedded plate washer and the other above the template. Half-inch diameter dowels (not supplied) are then driven down through the bolt stabilizers and into the ground to ensure plumb installation of the anchors and prevent movement during concrete placement. Immediately following concrete placement, the dowels are removed and reused in other locations.


## Steel Strong-Wall® Anchor Bolt Templates

Steel Strong-Wall Model	Width (in.)	Anchor Bolt Stabilizer Model	Steel Strong-Wall Template Model			
			Reversible	Panel Form	Brick Ledge	Extended Leg
SSW12	12	SSWBS12	SSWT12	SSWTPF12	SSWTBL12	SSWTEL12
SSW15	15	SSWBS15	SSWT15	SSWTPF15	SSWTBL15	SSWTEL15
SSW18	18	SSWBS18	SSWT18	SSWTPF18	SSWTBL18	SSWTEL18
SSW21	21	SSWBS21	SSWT21	SSWTPF21	SSWTBL21	SSWTEL21
SSW24	24	SSWBS24	SSWT24	SSWTPF24	SSWTBL24	SSWTEL24


1. The height of the garage curb above the garage slab is critical for rough header opening at garage return walls.
2. See Garage Header Rough Opening Height table on page 16.
3. Templates are recommended and are required in some jurisdictions.
4. Foundation design by Designer.
5. Reversible, panel form and brick ledge templates are the same for 4"- or 6"-thick walls.

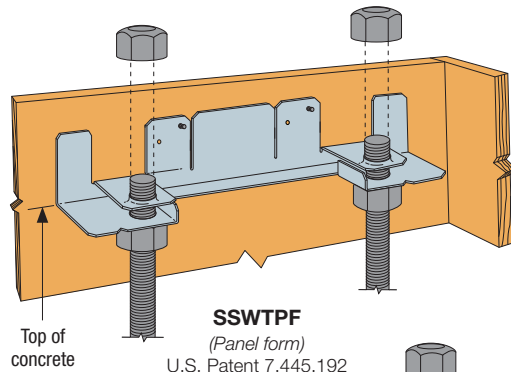


\*SSWT templates are reversible.  
Use the same template for interior or exterior applications.

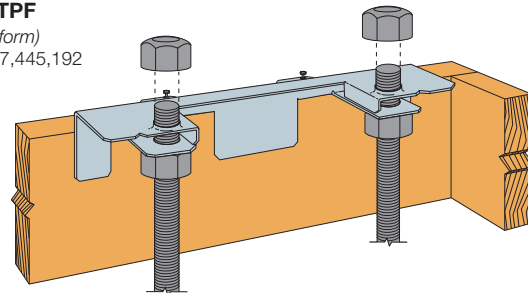

**SSWT Exterior Installation\***  
(May be used for steel form systems)  
U.S. Patent 7,445,192


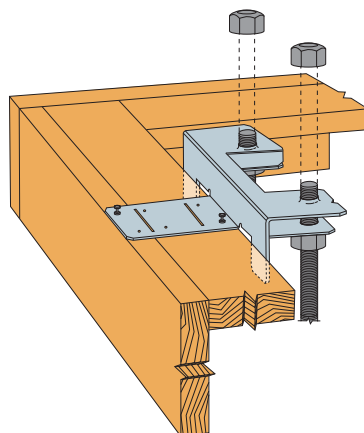


**SSWTBL**  
(Brick ledge)  
U.S. Patent 7,445,192

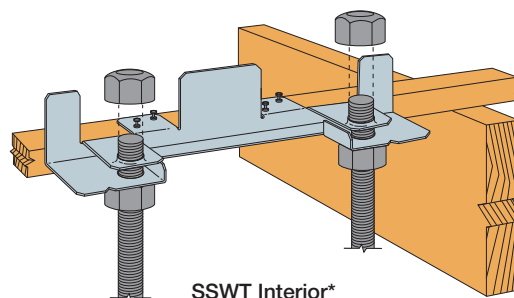


**SSWT Interior\***  
**Installation**  
U.S. Patent 7,445,192

An additional nut for template installation is provided with each SSWAB. It may also be used for SSW installation.

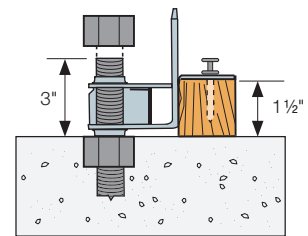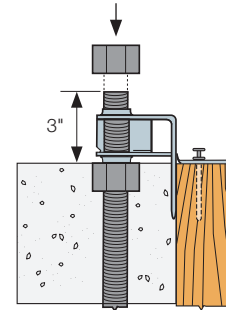

**Anchor Bolt Height**

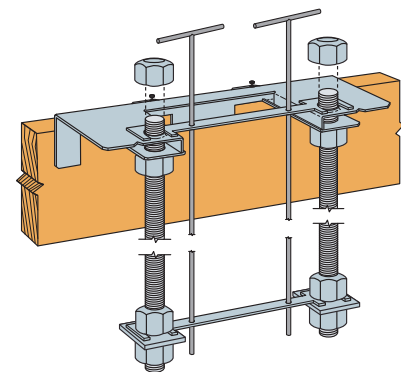

**SSWTEL with Anchor Bolt Stabilizers**  
(Extended Leg)  
Allows for placement of Steel Strong-Wall flush with inside face of 2x6 framed exterior wall  
U.S. Patent 7,445,192

(Note: Anchor bolt stabilizers are sold separately. Optional T-shape dowel by others.)



# Strong-Wall® Wood Shearwall Features



Strong-Wall® Wood Shearwall



Code Listed

## Delivering Easy-To-Install, Code-Listed Solutions

The Simpson Strong-Tie® Strong-Wall® Wood Shearwall is a specially designed, prefabricated, engineered-wood panel that helps structures resist lateral forces such as those created by earthquakes and high winds. The Strong-Wall® Wood Shearwall has been evaluated to the 2015 International Building Code® (IBC) and can help you resist these forces efficiently and confidently with the following features:

- **Code Listed** — ICC-ES ESR-2652, City of L.A. RR 25730, and State of Florida FL5113 evaluated to the 2015 IRC/IBC
- **Field Adjustable** — Can be field-trimmed and drilled
- **Stronger Wall** — Narrow panel widths have significantly higher allowable loads than the original Wood Strong-Wall
- **More Applications** — Suitable for residential, multi-family, and light-frame commercial construction and in balloon-framing applications up to 20 ft.
- **Easy Access** — Newly designed front, side and back access holdowns allow for easier anchor bolt installation and inspection
- **Easy to Install** — Reusable templates locate the required holddown anchor bolts accurately in the foundation
- **Support and Service** — Simpson Strong-Tie provides unmatched engineering technical support and experienced field representation





Engineering Technical Support



Field Adjustable



# Strong-Wall® Wood Shearwall Applications

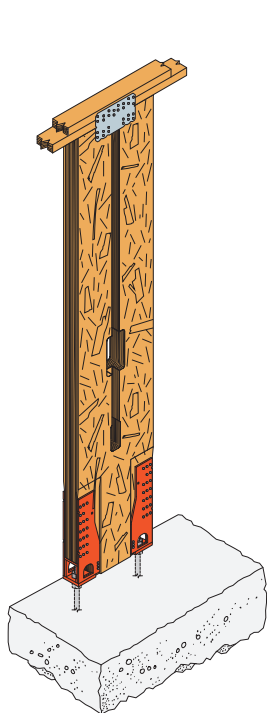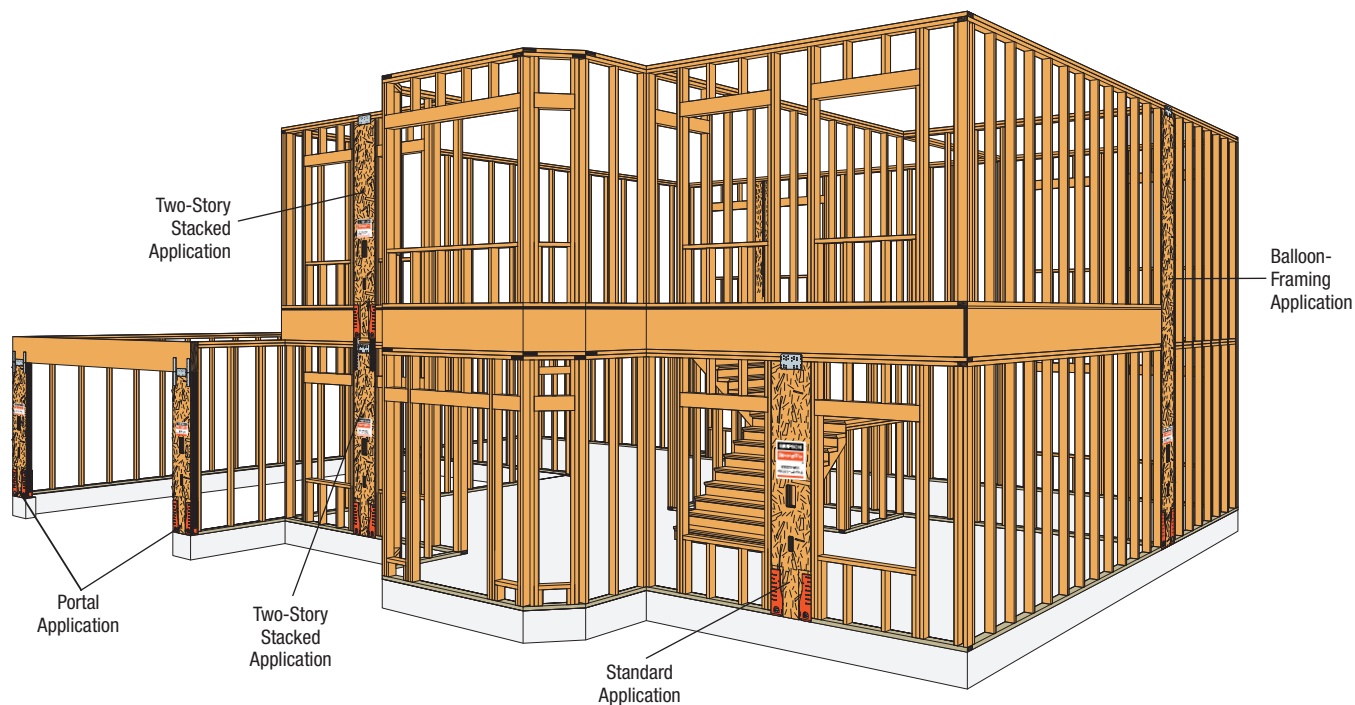


## Standard and Balloon-Framing Applications

- Narrow wall spaces
- Wall heights up to 20'



## Portal Applications

- Narrow wall spaces
- Garages
- Large windows and doors
- Increased capacities when used in a portal

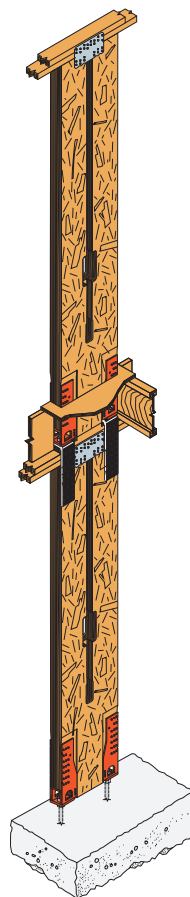

## Two-Story Stacked Application

- Narrow wall spaces
- Multi-story installation kit (MSK) required (order separately)
- Total assembled heights up to 24'

## Product Storage

Protect product from sun and water



**CAUTION:**  
Wrap is slippery when wet or icy  
Use support blocks at 10' on-center to keep bundles out of mud and water

## Product and Kit Descriptions

### Standard Product Description

All Strong-Wall® Wood Shearwalls are supplied with top-of-wall shear transfer plates, nuts, washers, and installation instructions. Additionally, shearwalls 100 inches or less in height are supplied with four portal straps.

Strong-Wall® Wood Shearwall



## Product and Kit Descriptions


### Alternative Top Connection Kit

Required for alternative top connections using a single WSW-TOW plate installed from only one side with Strong-Drive® Connector screws.

### Strong-Wall® Wood Shearwall Alternative Connection Kit

Model No.	Contents
WSW-TOW12KT	(20) #10 x 1½" SD Connector Screws (2) ¼" x 6" SDS Heavy-Duty Connector Screws
WSW-TOW18KT	(28) #10 x 1½" SD Connector Screws (4) ¼" x 6" SDS Heavy-Duty Connector Screws
WSW-TOW24KT	(40) #10 x 1½" SD Connector Screws (8) ¼" x 6" SDS Heavy-Duty Connector Screws

1. Use kit fasteners to attach (1) of the (2) WSW-TOWXXKT plates included with the Strong-Wall Wood shearwall. Plate may be installed on either panel face.

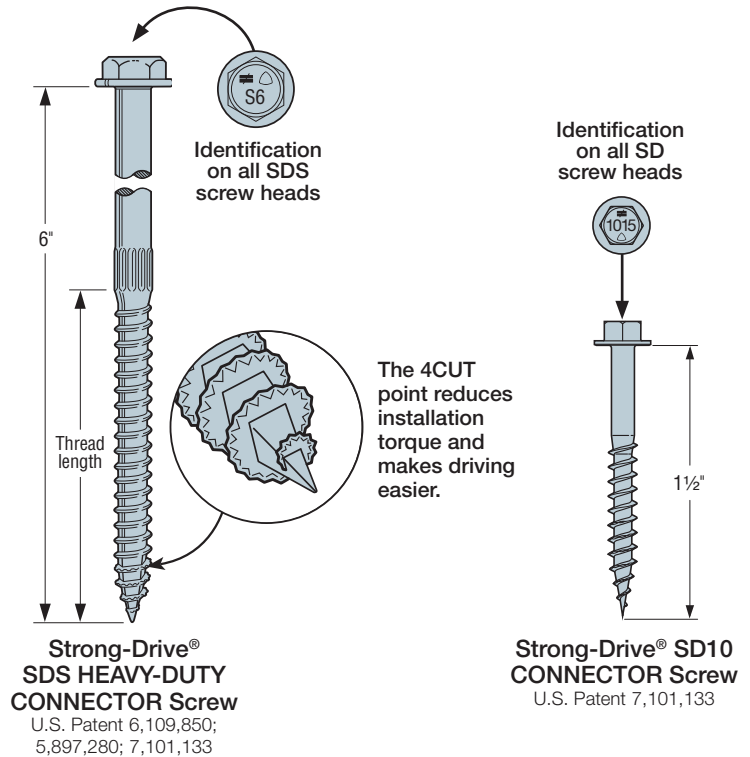


### Portal Kits

**(Included with all panels 100" or less in height)**

Required for portal-frame applications. Kit includes four portal straps and comes standard with all panels that are 100" or less in height. Order the kit separately if using panels that are more than 100" tall in a portal application.


**Model No.:** WSW-PK

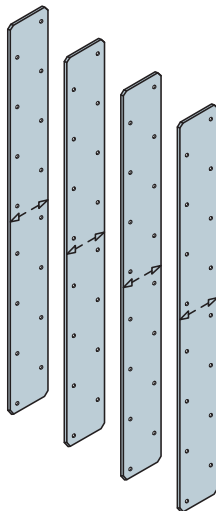

### Multi-Story Kits (MSK)

Required for two-story stacked applications. Kit includes two holdowns with preattached bolts and a bearing block. See pages 48–49 for two-story stacked details.

**Model No.:** WSW-MSK18KT and WSW-MSK24KT

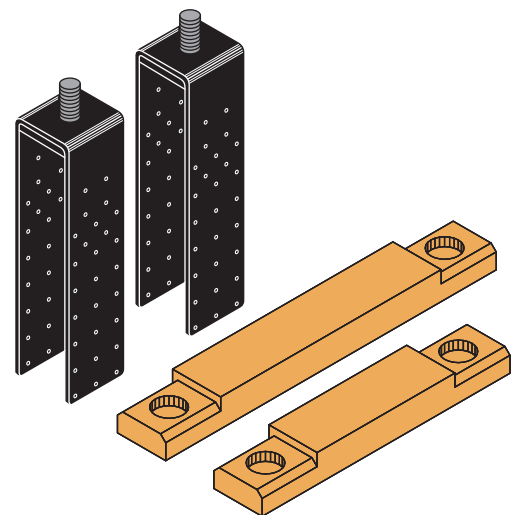




# Standard and Balloon Framing on Concrete Foundations

## Strong-Wall® Wood Shearwall Product Data

Model No.	W (in.)	H (in.)	Anchor Bolts		Total Wall Weight (lb.)
			Quantity	Diameter (in.)	
WSW12x7	12	78	2	$\frac{7}{8}$	100
WSW18x7	18	78	2	$\frac{7}{8}$	145
WSW12x7.5	12	85½	2	$\frac{7}{8}$	110
WSW18x7.5	18	85½	2	$\frac{7}{8}$	155
WSW12x8	12	93¼	2	$\frac{7}{8}$	115
WSW18x8	18	93¼	2	$\frac{7}{8}$	165
WSW24x8	24	93¼	2	1	225
WSW12x9	12	105¼	2	$\frac{7}{8}$	130
WSW18x9	18	105¼	2	$\frac{7}{8}$	185
WSW24x9	24	105¼	2	1	245
WSW12x10	12	117¼	2	$\frac{7}{8}$	140
WSW18x10	18	117¼	2	$\frac{7}{8}$	205
WSW24x10	24	117¼	2	1	270
WSW12x11	12	129¼	2	$\frac{7}{8}$	150
WSW18x11	18	129¼	2	$\frac{7}{8}$	220
WSW24x11	24	129¼	2	1	295
WSW12x12	12	141¼	2	$\frac{7}{8}$	165
WSW18x12	18	141¼	2	$\frac{7}{8}$	240
WSW24x12	24	141¼	2	1	320
WSW18x13	18	153¼	2	$\frac{7}{8}$	255
WSW24x13	24	153¼	2	1	345
WSW24x14	24	168	2	1	375
WSW24x16	24	192	2	1	425
WSW18x20	18	240	2	$\frac{7}{8}$	385
WSW24x20	24	240	2	1	520


- For heights not listed, order the next tallest panel and trim to fit. Minimum trimmed height for all panels is 74½".
- All panels come with two preattached holdowns, two standard hex nuts, two flat washers, two WSW-TOW top-connection plates (width based on panel model), and installation instructions.
- All panels are 3½" thick.

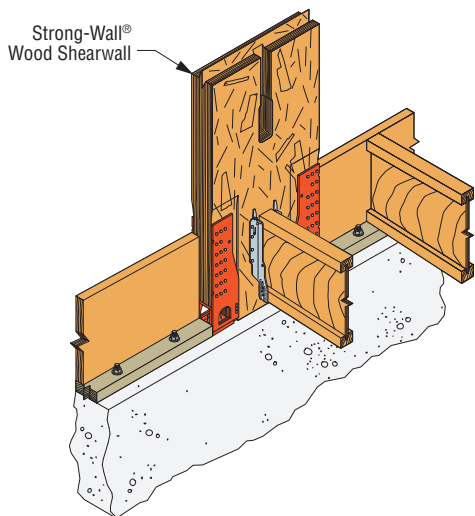

### First-Story Installation with Wood Floor System

Specify panel height from top of foundation to underside of the top plates or beam.

WSW designed to provide ⅛" gap between LSL at base of WSW and concrete. Ensure concrete is level and smooth beneath panel. Grind or fill as necessary.

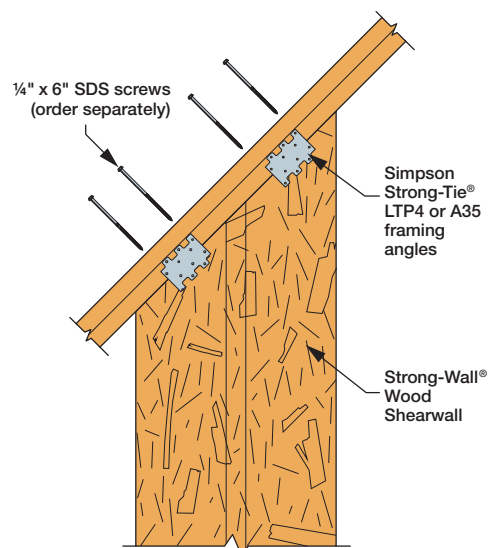

### Rake Wall Application

Verify panel is plumb. Use metal shims (Model No. WSW-CS1) at the base if required.

Place Strong-Wall® Wood Shearwall over the anchor bolts and secure with hex nuts and structural washers (provided). Snug tight fit required.

- 1⅝" wrench required for ⅞" nut.
- 1½" wrench required for 1" nut.

Foundation design (size and reinforcement) by Designer.

### Standard Installation



# Standard and Balloon Framing on Concrete Foundations

Simpson Strong-Tie® Strong-Wall® Wood Shearwalls combine design flexibility with performance. Field trimmable, they can be customized to accommodate varying heights or rake walls. They are evaluated to the 2015 IRC/IBC and are listed by ICC-ES in ESR-2652 and the City of LA in RR 25730.



## Installation

- All panels may be field trimmed to a minimum of 74½". Trim height from top of panel only, do not trim from sides or bottom. Drilling holes in the Strong-Wall® Wood Shearwalls is not allowed except as shown on page 88.
- Anchor-bolt nuts should be snug tight.
- Maximum shim thickness between the shearwall and top plates or header is 7⁄8". For additional shim thicknesses, see details 9/WSW2 on page 87.
- Walls may also be used in 2x6 wall framing. Install the panel flush to the outside face of the framing and add furring to the opposite side. See details 6/WSW2 on page 85 and 4/WSW4 on page 93.
- Standard top-of-wall connections install with nails.

**Codes:** ICC-ES ESR-2652, City of L.A. RR 25730 and State of Florida FL5113


## Strong-Wall® Wood Shearwall Naming Legend

**WSW18x8-93**

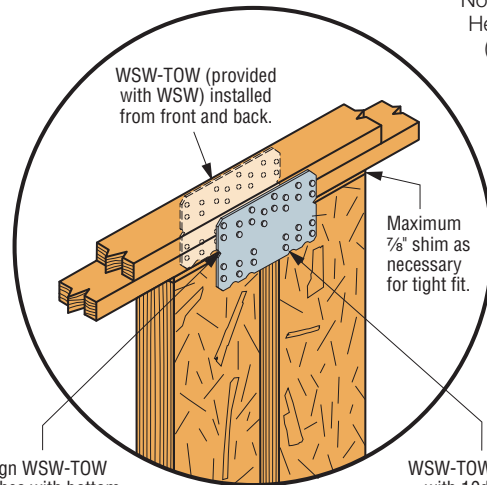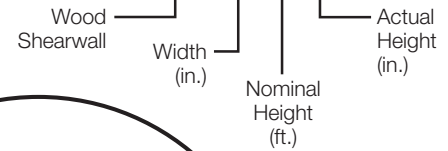


## Standard Top Connection

Also applicable for portal applications with a header.

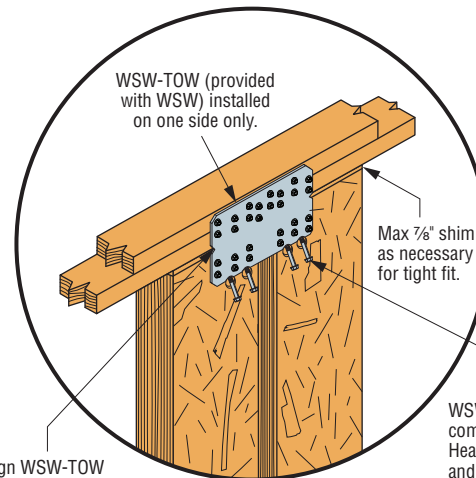


## Alternative Top Connection

Also applicable for portal applications with a header.

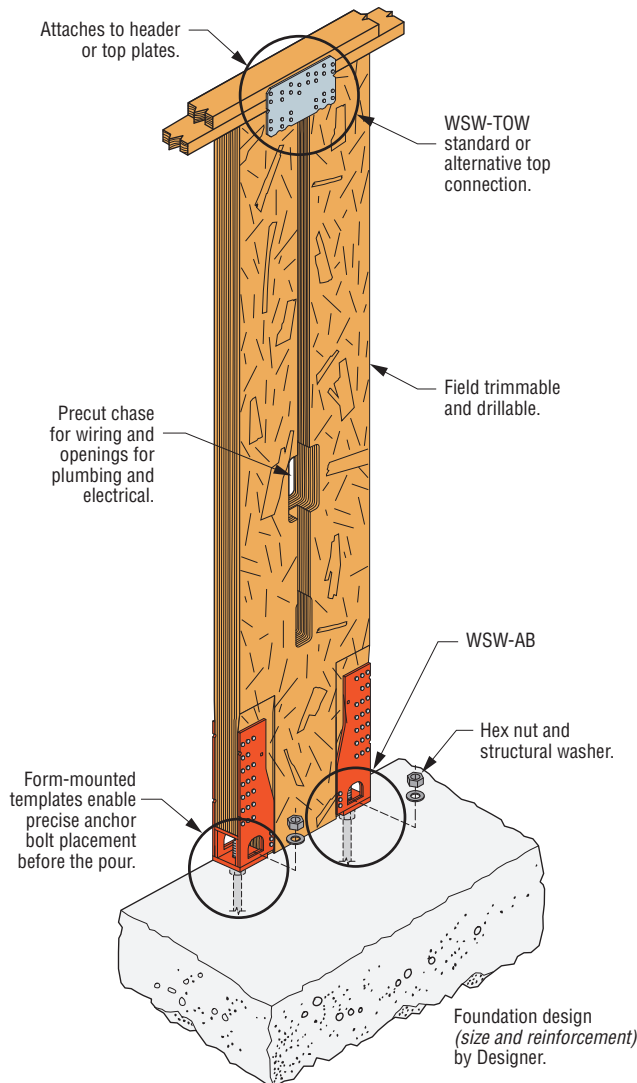

Standard Installation

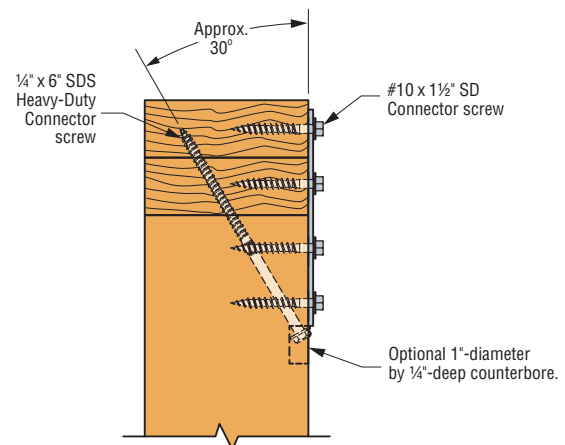

Alternative Top Connection  
Side View

# Standard and Balloon Framing on Concrete Foundations

## Strong-Wall® Wood Shearwall Standard Application on Concrete Foundation

Strong-Wall Wood Shearwall Model <sup>9</sup>	Allowable Vertical Load, P (lb.) <sup>4</sup>	2,500 psi Concrete						3,000 psi Concrete					
		Seismic <sup>3</sup>			Wind			Seismic <sup>3</sup>			Wind		
		Allowable ASD Shear Load, V (lb.)	Drift at Allowable Shear, Δ (in.) <sup>10</sup>	Anchor Tension at Allowable Shear, T (lb.) <sup>11</sup>	Allowable ASD Shear Load, V (lb.)	Drift at Allowable Shear, Δ (in.) <sup>10</sup>	Anchor Tension at Allowable Shear, T (lb.) <sup>11</sup>	Allowable ASD Shear Load, V (lb.)	Drift at Allowable Shear, Δ (in.) <sup>10</sup>	Anchor Tension at Allowable Shear, T (lb.) <sup>11</sup>	Allowable ASD Shear Load, V (lb.)	Drift at Allowable Shear, Δ (in.) <sup>10</sup>	Anchor Tension at Allowable Shear, T (lb.) <sup>11</sup>
WSW12x7	1,000	1,065	0.31	10,285	1,380	0.43	13,375	1,065	0.31	10,285	1,380	0.43	13,375
	4,000	1,065	0.31	10,285	1,380	0.43	13,375	1,065	0.31	10,285	1,380	0.43	13,375
	7,500	1,065	0.31	10,285	1,380	0.43	13,370	1,065	0.31	10,285	1,380	0.43	13,375
WSW18x7	1,000	2,475	0.31	13,865	2,980	0.40	16,675	2,475	0.31	13,865	3,225	0.43	18,040
	4,000	2,475	0.31	13,865	2,710	0.36	15,160	2,475	0.31	13,865	3,225	0.43	18,040
	7,500	2,475	0.31	13,865	2,395	0.32	13,395	2,475	0.31	13,865	2,910	0.39	16,280
WSW24x7 <sup>9</sup>	1,000	5,515	0.29	22,710	5,515	0.32	22,710	5,515	0.29	22,710	5,515	0.32	22,710
	4,000	5,515	0.29	22,710	5,400	0.31	22,240	5,515	0.29	22,710	5,515	0.32	22,710
	7,500	5,515	0.29	22,710	4,950	0.29	20,390	5,515	0.29	22,710	5,515	0.32	22,710
WSW12x8	1,000	960	0.39	11,125	1,245	0.53	14,420	960	0.39	11,125	1,245	0.53	14,420
	4,000	960	0.39	11,125	1,245	0.53	14,420	960	0.39	11,125	1,245	0.53	14,420
	7,500	960	0.39	11,125	1,155	0.49	13,370	960	0.39	11,125	1,245	0.53	14,420
WSW18x8	1,000	2,430	0.39	16,245	2,490	0.42	16,675	2,430	0.39	16,245	2,925	0.50	19,560
	4,000	2,430	0.39	16,245	2,265	0.38	15,160	2,430	0.39	16,245	2,695	0.46	18,045
	7,500	2,430	0.39	16,245	2,000	0.34	13,395	2,430	0.39	16,245	2,435	0.41	16,280
WSW24x8	1,000	4,945	0.37	24,355	4,840	0.40	23,830	4,945	0.37	24,355	5,515	0.45	27,150
	4,000	4,945	0.37	24,355	4,515	0.37	22,240	4,945	0.37	24,355	5,360	0.44	26,395
	7,500	4,945	0.37	24,355	4,140	0.34	20,390	4,945	0.37	24,355	4,985	0.41	24,540
WSW12x9	1,000	790	0.43	10,310	1,020	0.60	13,335	790	0.43	10,310	1,020	0.60	13,335
	4,000	790	0.43	10,310	1,020	0.60	13,335	790	0.43	10,310	1,020	0.60	13,335
	7,500	790	0.43	10,310	1,020	0.60	13,335	790	0.43	10,310	1,020	0.60	13,335
WSW18x9	1,000	1,920	0.43	14,505	2,210	0.53	16,675	1,920	0.43	14,505	2,515	0.60	18,980
	4,000	1,920	0.43	14,505	2,010	0.48	15,160	1,920	0.43	14,505	2,390	0.57	18,045
	7,500	1,920	0.43	14,505	1,775	0.42	13,395	1,920	0.43	14,505	2,155	0.51	16,280
WSW24x9	1,000	4,190	0.43	23,275	4,290	0.46	23,830	4,190	0.43	23,275	5,035	0.54	27,985
	4,000	4,190	0.43	23,275	4,000	0.43	22,240	4,190	0.43	23,275	4,750	0.51	26,395
	7,500	4,190	0.43	23,275	3,670	0.40	20,390	4,190	0.43	23,275	4,415	0.48	24,540
WSW12x10	1,000	630	0.50	9,175	810	0.67	11,810	630	0.50	9,175	810	0.67	11,810
	4,000	630	0.50	9,175	810	0.67	11,810	630	0.50	9,175	810	0.67	11,810
	7,500	630	0.50	9,175	810	0.67	11,810	630	0.50	9,175	810	0.67	11,810
WSW18x10	1,000	1,715	0.49	14,440	1,980	0.59	16,675	1,715	0.49	14,440	2,225	0.67	18,715
	4,000	1,715	0.49	14,440	1,800	0.54	15,160	1,715	0.49	14,440	2,145	0.64	18,045
	7,500	1,715	0.49	14,440	1,590	0.48	13,395	1,715	0.49	14,440	1,935	0.58	16,280
WSW24x10	1,000	3,675	0.48	22,740	3,850	0.54	23,830	3,675	0.48	22,740	4,520	0.63	27,985
	4,000	3,675	0.48	22,740	3,590	0.50	22,240	3,675	0.48	22,740	4,265	0.60	26,395
	7,500	3,675	0.48	22,740	3,295	0.46	20,390	3,675	0.48	22,740	3,965	0.55	24,540
WSW12x11	1,000	575	0.55	9,190	735	0.73	11,810	575	0.55	9,190	735	0.73	11,810
	4,000	575	0.55	9,190	735	0.73	11,810	575	0.55	9,190	735	0.73	11,810
	7,500	575	0.55	9,190	735	0.73	11,810	575	0.55	9,190	735	0.73	11,810
WSW18x11	1,000	1,510	0.53	14,010	1,800	0.67	16,675	1,510	0.53	14,010	1,975	0.73	18,335
	4,000	1,510	0.53	14,010	1,635	0.61	15,160	1,510	0.53	14,010	1,945	0.72	18,045
	7,500	1,510	0.53	14,010	1,445	0.54	13,395	1,510	0.53	14,010	1,755	0.65	16,280
WSW24x11	1,000	3,295	0.53	22,485	3,490	0.58	23,830	3,295	0.53	22,485	4,100	0.69	27,985
	4,000	3,295	0.53	22,485	3,260	0.55	22,240	3,295	0.53	22,485	3,865	0.65	26,395
	7,500	3,295	0.53	22,485	2,985	0.50	20,390	3,295	0.53	22,485	3,595	0.60	24,540

See footnotes on page 43.

# Standard and Balloon Framing on Concrete Foundations

## Strong-Wall® Wood Shearwall Standard Application on Concrete Foundation (cont.)

Strong-Wall Wood Shearwall Model <sup>9</sup>	Allowable Vertical Load, P (lb.) <sup>4</sup>	2,500 psi Concrete						3,000 psi Concrete					
		Seismic <sup>3</sup>			Wind			Seismic <sup>3</sup>			Wind		
		Allowable ASD Shear Load, V (lb.)	Drift at Allowable Shear, Δ (in.) <sup>10</sup>	Anchor Tension at Allowable Shear, T (lb.) <sup>11</sup>	Allowable ASD Shear Load, V (lb.)	Drift at Allowable Shear, Δ (in.) <sup>10</sup>	Anchor Tension at Allowable Shear, T (lb.) <sup>11</sup>	Allowable ASD Shear Load, V (lb.)	Drift at Allowable Shear, Δ (in.) <sup>10</sup>	Anchor Tension at Allowable Shear, T (lb.) <sup>11</sup>	Allowable ASD Shear Load, V (lb.)	Drift at Allowable Shear, Δ (in.) <sup>10</sup>	Anchor Tension at Allowable Shear, T (lb.) <sup>11</sup>
WSW12x12	1,000	485	0.62	8,540	625	0.80	10,915	485	0.62	8,540	625	0.80	10,915
	4,000	485	0.62	8,540	625	0.80	10,915	485	0.62	8,540	625	0.80	10,915
	7,500	485	0.62	8,540	625	0.80	10,915	485	0.62	8,540	625	0.80	10,915
WSW18x12	1,000	1,340	0.58	13,580	1,645	0.75	16,675	1,340	0.58	13,580	1,755	0.80	17,770
	4,000	1,340	0.58	13,580	1,495	0.68	15,160	1,340	0.58	13,580	1,755	0.80	17,770
	7,500	1,340	0.58	13,580	1,320	0.60	13,395	1,340	0.58	13,580	1,605	0.73	16,280
WSW24x12	1,000	2,920	0.58	21,795	3,195	0.66	23,830	2,920	0.58	21,795	3,750	0.77	27,985
	4,000	2,920	0.58	21,795	2,980	0.61	22,240	2,920	0.58	21,795	3,540	0.73	26,395
	7,500	2,920	0.58	21,795	2,735	0.56	20,390	2,920	0.58	21,795	3,290	0.68	24,540
WSW18x13	1,000	1,190	0.63	13,065	1,515	0.85	16,675	1,190	0.63	13,065	1,555	0.87	17,100
	4,000	1,190	0.63	13,065	1,380	0.77	15,160	1,190	0.63	13,065	1,555	0.87	17,100
	7,500	1,190	0.63	13,065	1,220	0.68	13,395	1,190	0.63	13,065	1,480	0.83	16,280
WSW24x13	1,000	2,590	0.64	20,970	2,945	0.74	23,830	2,590	0.64	20,970	3,445	0.87	27,865
	4,000	2,590	0.64	20,970	2,750	0.69	22,240	2,590	0.64	20,970	3,260	0.82	26,395
	7,500	2,590	0.64	20,970	2,520	0.63	20,390	2,590	0.64	20,970	3,035	0.76	24,540
WSW18x14 <sup>9</sup>	1,000	960	0.69	11,580	1,245	0.93	14,995	960	0.69	11,580	1,245	0.93	14,995
	4,000	960	0.69	11,580	1,245	0.93	14,995	960	0.69	11,580	1,245	0.93	14,995
WSW24x14	1,000	2,175	0.69	19,300	2,685	0.89	23,830	2,175	0.69	19,300	2,815	0.93	24,970
	4,000	2,175	0.69	19,300	2,505	0.83	22,240	2,175	0.69	19,300	2,815	0.93	24,970
WSW18x16 <sup>9</sup>	1,000	830	0.79	11,420	1,085	1.07	14,945	830	0.79	11,420	1,085	1.07	14,945
	4,000	830	0.79	11,420	1,085	1.07	14,945	830	0.79	11,420	1,085	1.07	14,945
WSW24x16	1,000	1,810	0.80	18,330	2,350	1.04	23,830	1,810	0.80	18,330	2,400	1.07	24,355
	4,000	1,810	0.80	18,330	2,195	0.97	22,240	1,810	0.80	18,330	2,400	1.07	24,355
WSW18x18 <sup>9</sup>	1,000	650	0.90	10,105	855	1.20	13,225	650	0.90	10,105	855	1.20	13,225
	4,000	650	0.90	10,105	855	1.20	13,225	650	0.90	10,105	855	1.20	13,225
WSW24x18 <sup>9</sup>	1,000	1,420	0.92	16,220	1,890	1.20	21,555	1,420	0.92	16,220	1,890	1.20	21,555
	4,000	1,420	0.92	16,220	1,890	1.20	21,555	1,420	0.92	16,220	1,890	1.20	21,555
WSW18x20	1,000	545	1.03	9,385	700	1.33	12,020	545	1.03	9,385	700	1.33	12,020
	4,000	545	1.03	9,385	700	1.33	12,020	545	1.03	9,385	700	1.33	12,020
WSW24x20	1,000	1,180	1.02	14,940	1,510	1.33	19,140	1,180	1.02	14,940	1,510	1.33	19,140
	4,000	1,180	1.02	14,940	1,510	1.33	19,140	1,180	1.02	14,940	1,510	1.33	19,140

- Allowable shear loads are applicable to installations on concrete with specified compressive strengths as listed using the ASD basic (IBC Section 1605.3.1) or the alternative basic (IBC Section 1605.3.2) load combinations.
- Load values include evaluation of bearing stresses on concrete foundations and do not require further evaluation by the Designer. For installations on masonry foundations, bearing capacity shall be evaluated by the Designer.
- Seismic design based on 2015 IBC using R = 6.5. For other codes, use the seismic coefficients corresponding to light-frame bearing walls with wood structural panels or sheet-steel panels.
- Allowable vertical load denotes the total maximum concentric vertical load permitted on the panel acting in combination with the allowable shear loads.
- Allowable shear, drift and anchor tension values may be interpolated for intermediate height or vertical loads. For panels 74½"-78" tall, use the values for a 78"-tall panel.
- High-strength anchor bolts are required for anchor tension forces exceeding the allowable load for standard-strength bolts tabulated on pages 53-54. See pages 52-59 for WSW-AB anchor bolt information and anchorage solutions.
- All panels taller than 18' require a 2x6 minimum full-height stud attached to each side. Attach using 10d common nails at 16" o.c.
- See page 44 for allowable out-of-plane and axial capacities.
- WSW24x7 must be trimmed from a WSW24x8 shearwall. WSW18x14, 16, and 18, and WSW24x18 shearwalls are trimmed from a 20 ft.-tall panel.
- Drifts at lower design shear may be linearly reduced.
- Tabulated anchor tension values assume no resisting vertical load. Anchor tension loads at design shear values and including the effect of vertical load may be determined using the following equation:  

$$T = [(V \times H) / B] - P/2$$
, where:  
 T = Anchor tension load (lb.)  
 V = Design shear load (lb.)  
 P = Applied vertical load (lb.)  
 H = Panel height (in.)  
 B = Moment arm (in.); 8.06" for WSW12, 13.94" for WSW18, 18.94" for WSW24.

# Standard and Balloon Framing on Concrete Foundations

## Strong-Wall® Wood Shearwall Allowable Out-of-Plane Loads for Single-Story Walls on Concrete Foundations (PSF)

Panel Attachment	Strong-Wall Wood Shearwall Model	Nominal Height of Shearwall (ft.)											
		7	7½	8	9	10	11	12	13	14	16	18	20
Top Plates	WSW12	255	235	215	190	155	115	60	N/A	N/A	N/A	N/A	N/A
	WSW18	230	210	195	170	155	115	90	70	55	35	25	20
	WSW24	250	225	210	185	155	115	90	70	55	35	25	20
Header	WSW12	280	255	205	150	110	85	60	N/A	N/A	N/A	N/A	N/A
	WSW18	185	170	155	140	110	85	70	N/A	N/A	N/A	N/A	N/A
	WSW24	140	130	120	105	95	85	70	N/A	N/A	N/A	N/A	N/A

1. Loads shown are at ASD level in pounds per square foot (PSF) of wall with no further increase allowed.
2. Loads consider a maximum deflection limit of H/240.
3. Allowable out-of-plane loads can be applied in combination with the panel allowable vertical loads shown on pages 42–43.
4. Allowable values for header panel attachment assume a maximum header depth of 14". Use a load reduction factor of 0.88 and 0.78 for 16"- and 18"-deep headers respectively.
5. Allowable values shown for header panel attachment require the use of the portal kit to resist header rotation.
6. N/A = Not Applicable.

## Strong-Wall® Wood Shearwall Axial Capacities for Single-Story Walls on Concrete Foundations (lb.)

Strong-Wall Wood Shearwall Model	Nominal Height of Shearwall (ft.)											
	7	7½	8	9	10	11	12	13	14	16	18	20
WSW12	32,400	27,700	23,700	19,000	15,400	12,800	10,800	N/A	N/A	N/A	N/A	N/A
WSW18	40,900	40,900	40,900	33,100	26,900	22,300	18,800	16,000	13,300	10,200	8,100	6,600
WSW24	58,000	56,200	48,100	38,400	31,300	25,900	21,800	18,600	15,500	11,900	9,400	7,600

1. Allowable ASD vertical load is the lesser of the WSW panel buckling capacity and concrete bearing capacity beneath the holdowns assuming a minimum specified concrete compressive strength  $f'_c = 2,500$  psi.
2. Allowable vertical loads assume concentric point load or uniformly distributed load without lateral loads present. For combined lateral and vertical loads, see pages 42–43.
3. Tabulated loads apply to single-story panels on concrete foundations.
4. N/A = Not Applicable.



# Garage Portal Systems on Concrete Foundations

The Strong-Wall® Wood Shearwall garage portal system provides higher shear capacity with reduced concrete anchorage requirements. Portal walls may be used in single- or double-portal applications and shall be installed with a minimum 3½" x 9¼" single- or multiple-ply header depending upon loading and span requirements.

**Codes:** ICC-ES ESR-2652, City of L.A. RR25730

For product data and naming scheme information, see pages 40–41.

## Garage Header Rough Opening Height

Model No.	H Curb (in.)	Rough Opening Height (in.)
WSW12x7 WSW18x7 WSW24x7	5½	6'-11½" <sup>1</sup>
	6	7'-0"
WSW12x7.5 WSW18x7.5 WSW24x7.5	0	7'-1½"
WSW12x8 WSW18x8 WSW24x8	5½	8'-2¾" <sup>2</sup>
	6	8'-3¼" <sup>2</sup>

1. If required rough opening height exceeds table value, specify next taller panel and trim as necessary. The Strong-Wall Wood Shearwalls may be trimmed to a minimum height of 74½".
2. Furring down garage header may be required for correct rough opening height.
3. WSW24x7 and WSW24x7.5 must be trimmed from a WSW24x8 shearwall.


### Installation

- Portal-frame connection kit is required for portal-frame applications.
- All panels may be trimmed to a minimum of 74½". Trim height from top of panel only, do not trim from sides or bottom. Drilling holes in the Strong-Wall Wood Shearwalls is not allowed except as shown on page 88.
- Anchor-bolt nuts should be snug tight.
- Maximum shim thickness between Strong-Wall Wood Shearwalls and the top plates or header is ⅞".
- Standard top-of-wall connections install with nails.
- Walls may also be used in 2x6 wall framing. Install the panel flush to the outside face of the framing and add furring to the opposite side.
- Walls may be installed with solid or multi-ply headers, see page 93 Detail 4, 5/WSW4 for fastening and furring requirements.

### Portal Frame Connection Kit

Model No.	Contents
WSW-PK	4 (10 Gauge) WSW-PS Straps

1. Portal-frame connection kit comes with panels that are 100" or less in height. The kit must be ordered separately for panels over 100" tall.

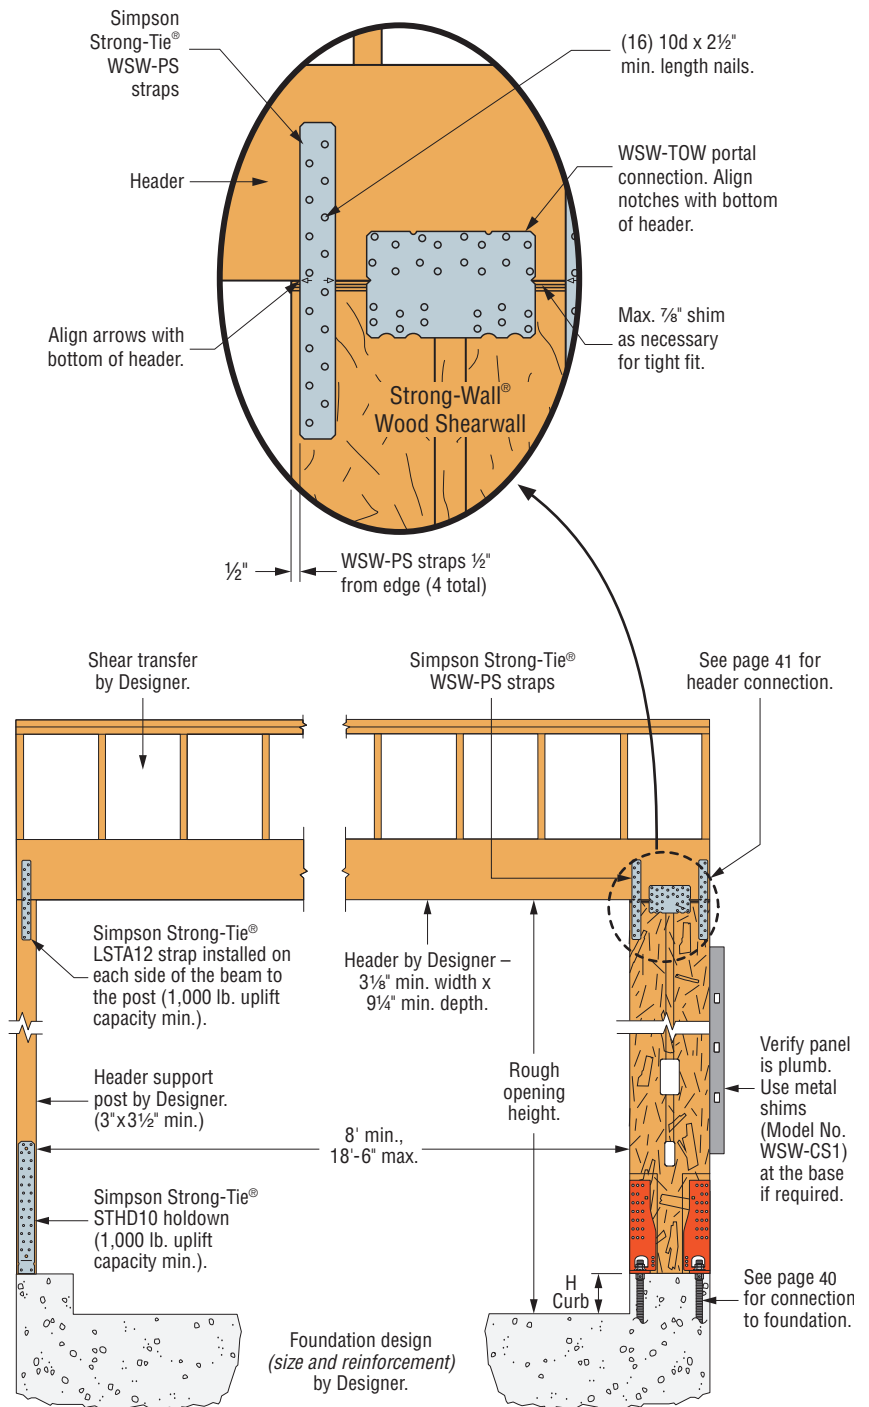

Single Portal Installation

# Garage Portal Systems on Concrete Foundations

## Portal Design Information

A portal frame under lateral loads causes the portal header to experience internal stresses in addition to those created by the primary loads (live, dead and snow). These additional stresses are called induced forces and must be considered when designing portal headers. To account for the induced forces from lateral loads, a concentrated end moment equal to the top-of-panel moment must be placed at the end of the header that is connected to the WSW panel. For WSW12 and WSW18 panels, the moment induced into the portal header must be taken as 20% and 10%, respectively, of the total lateral moment at the base. The total lateral moment is calculated as the design shear times the panel height. For headers with typical residential uniform loads, the induced moment and shear forces from a portal-frame system do not control the design. This is due to the 1.60 load duration factor ( $C_D$ ) used in design and the induced stresses from wind and seismic loads.


The lateral and vertical loads shown on page 47 for portal frames assume that the header size falls within the portal-frame parameters listed in the table.

### Strong-Wall® Wood Shearwall Portal Header Design Parameters

Header Design Parameter	Allowable Range
Width	3 1/8" – 5 1/2"
Depth	9 1/4" – 18"
Clear Span	8' – 18' 6"
K	90 lb./in. – 4,000 lb./in.

1. Single- or multiple-ply header members may be used.
2. Secondary moment, shear and axial forces shall be considered in header design.
3. Header design shall be by Designer and assume gravity loads only induce simple span moments in beam.
4. Header stiffness (K) for use in WSW portal system may be determined using the following equation:  

$$K = (E \times b \times d^3) / 12L^3$$
 where:  
 E = Header modulus of elasticity (psi)  
 b = Header width (in.)  
 d = Header depth (in.)  
 L = Header clear span (in.)

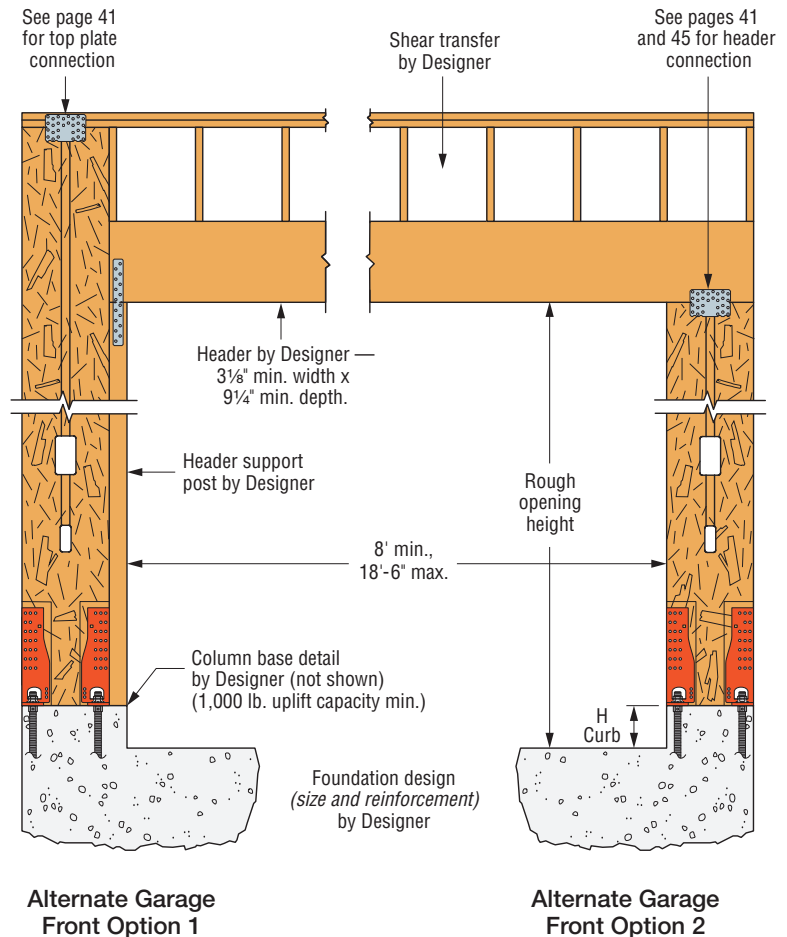

## Alternative Garage Front Options

These alternative garage-front options may be used for applications when the Strong-Wall® Wood Shearwall is installed at the full height (option 1) or without the additional Portal-Frame Kit (option 2), when higher capacity or reduced concrete anchorage is not needed. Refer to the Standard Application on Concrete Foundations on pages 42–44 for product data and allowable load values.

**For Garage Wall Option 2, the Designer shall design for:**

1. Shear transfer
2. Out-of-plane loading effect
3. Increased overturning and drift due to additional height

# Garage Portal Systems on Concrete Foundations

## Strong-Wall® Wood Shearwall Single-Wall Garage Portal System on Concrete Foundation

Strong-Wall Wood Shearwall Model	Allowable Vertical Load, P (lb.) <sup>5</sup>	2,500 psi Concrete						3,000 psi Concrete					
		Seismic <sup>3</sup>			Wind			Seismic <sup>3</sup>			Wind		
		Allowable ASD Shear Load, V (lb.)	Drift at Allowable Shear, Δ (in.) <sup>9</sup>	Anchor Tension at Allowable Shear, T (lb.) <sup>10</sup>	Allowable ASD Shear Load, V (lb.)	Drift at Allowable Shear, Δ (in.) <sup>9</sup>	Anchor Tension at Allowable Shear, T (lb.) <sup>10</sup>	Allowable ASD Shear Load, V (lb.)	Drift at Allowable Shear, Δ (in.) <sup>9</sup>	Anchor Tension at Allowable Shear, T (lb.) <sup>10</sup>	Allowable ASD Shear Load, V (lb.)	Drift at Allowable Shear, Δ (in.) <sup>9</sup>	Anchor Tension at Allowable Shear, T (lb.) <sup>10</sup>
WSW12x7	1,000	1,645	0.38	12,750	2,135	0.53	16,525	1,645	0.38	12,750	2,135	0.53	16,525
	4,000	1,645	0.38	12,750	1,955	0.49	15,150	1,645	0.38	12,750	2,135	0.53	16,525
	7,500	1,645	0.38	12,750	1,730	0.43	13,370	1,645	0.38	12,750	2,100	0.52	16,255
WSW18x7	1,000	3,225	0.38	16,235	3,310	0.42	16,675	3,225	0.38	16,235	3,350	0.43	16,880
	4,000	3,225	0.38	16,235	3,010	0.38	15,160	3,225	0.38	16,235	3,350	0.43	16,880
	7,500	3,225	0.38	16,235	2,660	0.34	13,395	3,225	0.38	16,235	3,230	0.41	16,280
WSW12x7.5	1,000	1,520	0.41	12,900	1,965	0.57	16,670	1,520	0.41	12,900	1,970	0.57	16,720
	4,000	1,520	0.41	12,900	1,785	0.51	15,150	1,520	0.41	12,900	1,970	0.57	16,720
	7,500	1,520	0.41	12,900	1,575	0.45	13,370	1,520	0.41	12,900	1,915	0.55	16,255
WSW18x7.5	1,000	2,955	0.41	16,300	3,020	0.45	16,675	2,955	0.41	16,300	3,350	0.50	18,500
	4,000	2,955	0.41	16,300	2,745	0.41	15,160	2,955	0.41	16,300	3,270	0.48	18,045
	7,500	2,945	0.41	16,260	2,425	0.36	13,395	2,955	0.41	16,300	2,950	0.44	16,280
WSW12x8	1,000	1,310	0.44	12,110	1,695	0.60	15,690	1,310	0.44	12,110	1,695	0.60	15,690
	4,000	1,310	0.44	12,110	1,635	0.58	15,150	1,310	0.44	12,110	1,695	0.60	15,690
	7,500	1,310	0.44	12,110	1,445	0.51	13,370	1,310	0.44	12,110	1,695	0.60	15,690
WSW18x8	1,000	2,610	0.44	15,730	2,770	0.49	16,675	2,610	0.44	15,730	3,250	0.58	19,560
	4,000	2,610	0.44	15,730	2,520	0.45	15,160	2,610	0.44	15,730	2,995	0.53	18,045
	7,500	2,610	0.44	15,730	2,225	0.40	13,395	2,610	0.44	15,730	2,705	0.48	16,280

- Allowable shear loads are applicable to installations on concrete with specified compressive strengths as listed using the ASD basic (IBC Section 1605.3.1) or the alternative basic (IBC Section 1605.3.2) load combinations.
- Load values include evaluation of bearing stresses on concrete foundations and do not require further evaluation by the Designer. For installations on masonry foundations, bearing capacity shall be evaluated by the Designer.
- Seismic design based on 2015 IBC using R = 6.5. For other codes, use the seismic coefficients corresponding to light-frame bearing walls with wood structural panels or sheet-steel panels.
- Allowable values shown apply to Single-Wall Garage Portal Systems. The allowable shear load for a Double-Wall Garage Portal System, which consists of two walls with a header continuous across both panels, may be taken as twice the table value.
- Allowable vertical load denotes the total maximum concentric vertical load permitted on the panel acting in combination with the allowable shear loads.
- Allowable shear, drift and anchor tension values may be interpolated for intermediate height or vertical loads. For panels 74½"–78" tall, use the values for a 78"-tall panel.
- High-strength anchor bolts are required for anchor tension forces exceeding the allowable load for standard-strength bolts tabulated on pages 53–54. See pages 52–59 for WSW-AB anchor bolt information and anchorage solutions.
- See page 44 for allowable out-of-plane and axial capacities.
- Drifts at lower design shear may be linearly reduced.
- Tabulated anchor tension values assume no resisting vertical load. Anchor tension loads at design shear values and including the effect of vertical load may be determined using the following equation:  

$$T = [(k \times V \times H) / B] - P/2$$
, where:  
 T = Anchor tension load (lb.)  
 V = Design shear load (lb.)  
 P = Applied vertical load (lb.)  
 H = Panel height (in.)  
 B = Moment arm (in.); 8.06" for WSW12, 13.94" for WSW18  
 k = Portal factor; 0.80 for WSW12 panels 93¼" or less in height,  
 0.90 for WSW18 panels 93¼" or less in height,  
 1.00 for all other panels.

## Two-Story Stacked on Concrete Foundations

The same Strong-Wall® Wood Shearwall models used for standard applications on concrete may be used in stacked wall applications. See Product data tables below for models that may be used in this application.

**Codes:** ICC-ES ESR-2652, City of L.A. RR 25730

For product naming scheme information, see page 41.

### Two-Story Stacked WSW Product Data — Upper Wall

Model No.	W (in.)	H (in.)	Total Wall Weight (lb.)
WSW18x9	18	105¼	185
WSW24x9	24	105¼	245
WSW18x10	18	117¼	205
WSW24x10	24	117¼	270
WSW18x11	18	129¼	220
WSW24x11	24	129¼	295
WSW18x12	18	141¼	240
WSW24x12	24	141¼	320

1. Order WSW-MSKXXXKT separately for two-story stacked applications.
2. See product data table on page 40 for footnotes.
3. The width of the upper wall should match the width of the lower wall.


### Two-Story Stacked WSW Product Data — Bottom Wall

Model No.	W (in.)	H (in.)	Anchor Bolts		Total Wall Weight (lb.)
			Qty.	Dia. (in.)	
WSW18x8	18	93¼	2	7/8	165
WSW24x8	24	93¼	2	1	225
WSW18x9	18	105¼	2	7/8	185
WSW24x9	24	105¼	2	1	245
WSW18x10	18	117¼	2	7/8	205
WSW24x10	24	117¼	2	1	270
WSW18x11	18	129¼	2	7/8	220
WSW24x11	24	129¼	2	1	295
WSW18x12	18	141¼	2	7/8	240
WSW24x12	24	141¼	2	1	320

1. See product data table on page 40 for footnotes.

### Multi-Story Connection Kit

Model No.	Contents
WSW-MSK18KT	(2) Holdowns with preattached bolts (2) Standard hex nuts and flat washers (1) LSL bearing block Installation instructions
WSW-MSK24KT	

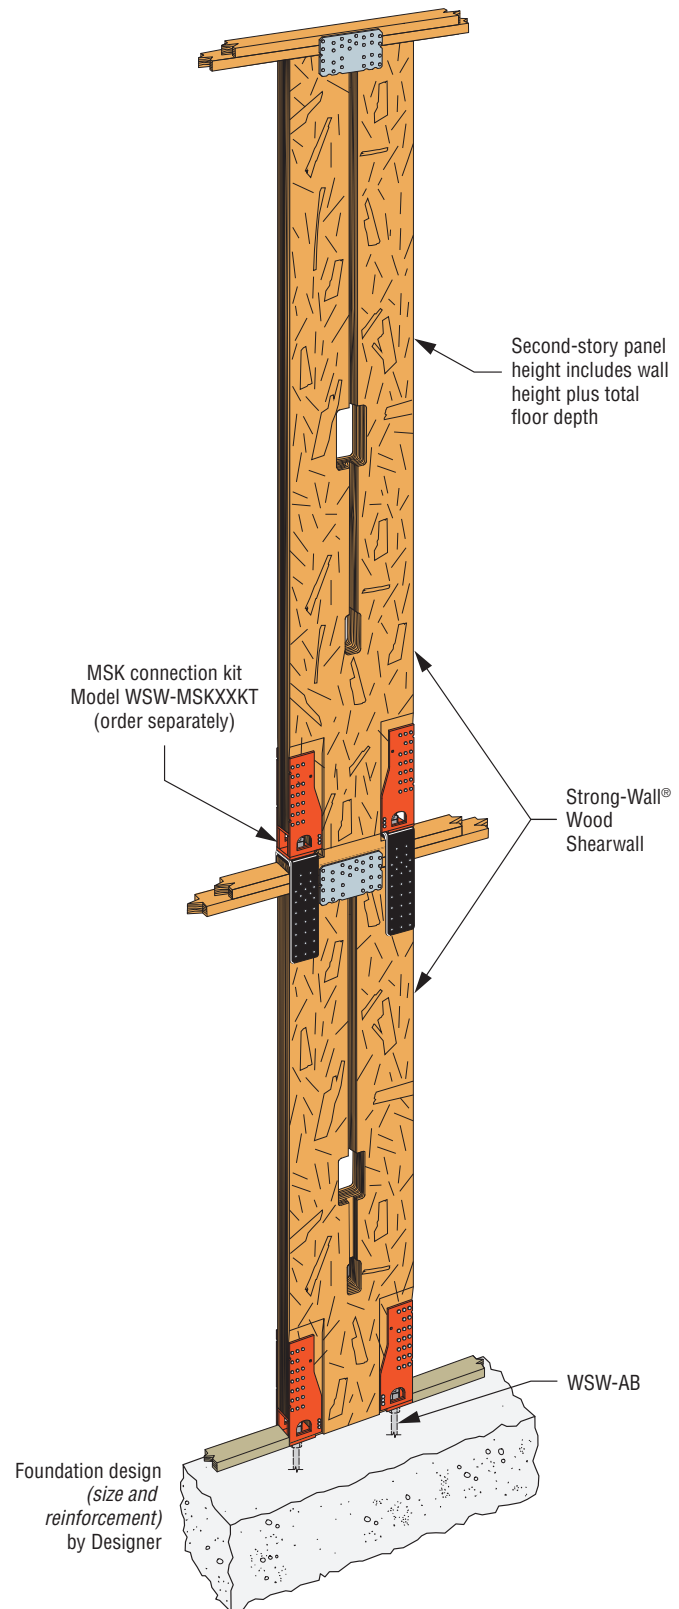


Two-Story Stacked Installation



# Two-Story Stacked on Concrete Foundations


## Installation

- All panels may be trimmed to a minimum of 74½". Trim height from top of panel only, do not trim from sides or bottom. Drilling holes in the Strong-Wall® Wood Shearwalls is not allowed except as shown on page 88.
- Anchor-bolt nuts should be snug tight.
- Maximum shim thickness between the shearwall and the top plates or header is ⅞".
- Walls may also be used in 2x6 wall framing. Install the panel flush to the outside face of the framing and add furring to the opposite side.
- Standard top-of-wall connections install with nails.
- The second-story panel must be the same width as the first-story panel.
- When specifying the height of the second-story panels, add the total floor height, including sheathing, to the wall height, then subtract 2". See  $h_3$  definition on page 51.

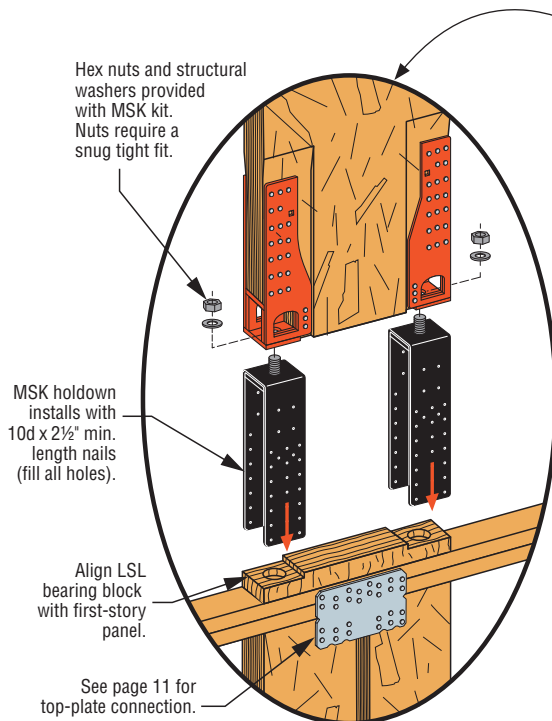


**Two-Story Stacked MSK Connection Details**


Foundation design  
(size and reinforcement)  
by Designer.

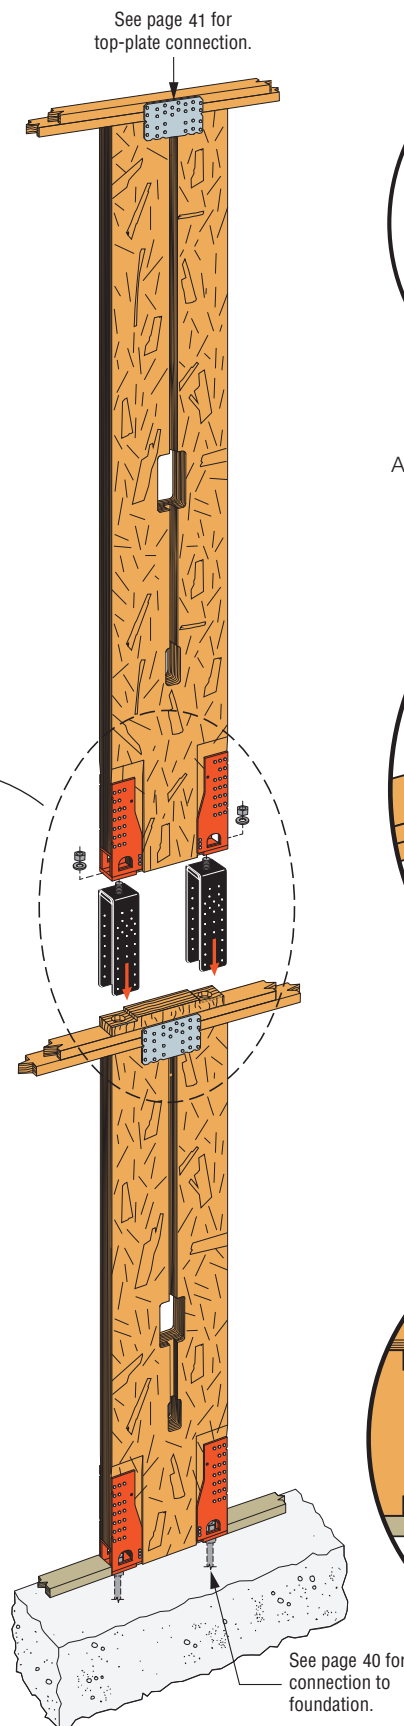


**Two-Story Stacked Installation**

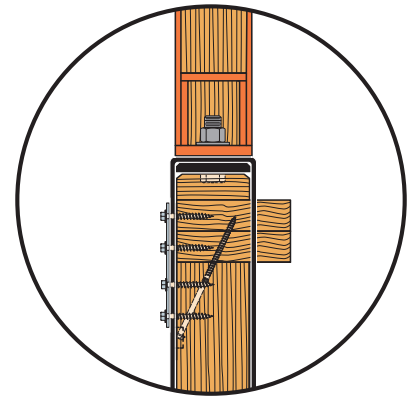

**2x6 Framing Installation**  
Alternative top connection recommended.  
See pages 85 and 90 for details.

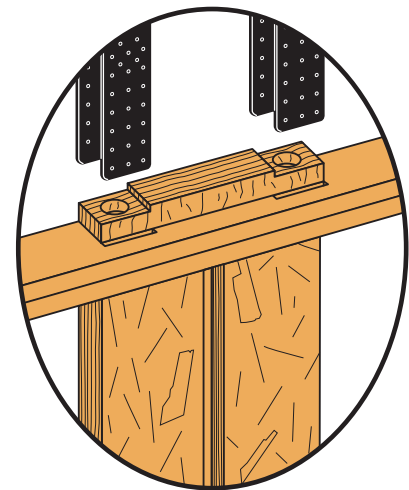

**2x6 Framing Installation**  
Cut slots (¼" wide max.) in the top plates to allow the MSK holdown to pass through. Do not notch the double top plates.

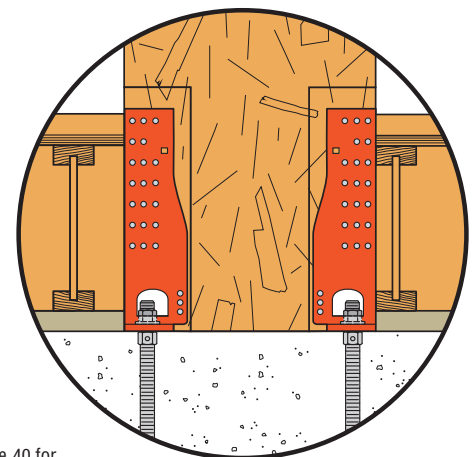

**First-Story Installation with Wood Floor System**  
Specify panel height from top of foundation to underside of top plates.

## Two-Story Stacked on Concrete Foundations

### Strong-Wall® Wood Shearwall Second-Story Walls — Stacked Application on Concrete Foundation<sup>6,7</sup>

Model No.	Allowable Vertical Load, P (lb.) <sup>4</sup>	Seismic <sup>3</sup>		Wind	
		Allowable ASD Shear Load, V (lb.)	Drift at Allowable Shear, Δ (in.)	Allowable ASD Shear Load, V (lb.)	Drift at Allowable Shear, Δ (in.)
WSW18x9	2,000	1,225	0.42	1,345	0.48
WSW24x9	2,000	2,165	0.41	2,380	0.46
WSW18x10	2,000	1,125	0.47	1,235	0.53
WSW24x10	2,000	1,990	0.46	2,190	0.52
WSW18x11	2,000	1,020	0.52	1,120	0.59
WSW24x11	2,000	1,815	0.51	1,995	0.59
WSW18x12	2,000	920	0.57	1,010	0.64
WSW24x12	2,000	1,640	0.57	1,805	0.65

See notes below.

### Strong-Wall® Wood Shearwall First-Story Walls — Stacked Application on Concrete Foundation<sup>9,11</sup>

Model No.	Allowable Vertical Load, P (lb.) <sup>4</sup>	Stiffness Factor, Kx10 <sup>9</sup> (lb.-in. <sup>2</sup> )	2,500 psi Concrete				3,000 psi Concrete			
			Seismic <sup>3</sup>		Wind		Seismic <sup>3</sup>		Wind	
			Allowable ASD Base Moment (lb.-in.)	Anchor Tension at Allowable ASD Base Moment (lb.) <sup>10</sup>	Allowable ASD Base Moment (lb.-in.)	Anchor Tension at Allowable ASD Base Moment (lb.) <sup>10</sup>	Allowable ASD Base Moment (lb.-in.)	Anchor Tension at Allowable ASD Base Moment (lb.) <sup>10</sup>	Allowable ASD Base Moment (lb.-in.)	Anchor Tension at Allowable ASD Base Moment (lb.) <sup>10</sup>
WSW18x8	4,000	9.7	206,550	14,820	184,730	13,255	206,550	14,820	218,020	15,645
WSW24x8	4,000	19.4	413,565	21,840	423,540	22,365	413,565	21,840	455,060	24,030
WSW18x9	4,000	10.3	200,500	14,385	184,715	13,255	200,500	14,385	217,975	15,640
WSW24x9	4,000	21.5	411,000	21,705	423,525	22,365	411,000	21,705	452,050	23,870
WSW18x10	4,000	11.6	202,255	14,510	184,670	13,250	202,255	14,510	217,970	15,640
WSW24x10	4,000	22.6	389,855	20,585	423,505	22,365	389,855	20,585	429,135	22,660
WSW18x11	4,000	12.5	197,755	14,190	184,700	13,250	197,755	14,190	217,785	15,625
WSW24x11	4,000	24.8	389,045	20,545	423,550	22,365	389,045	20,545	428,465	22,625
WSW18x12	4,000	12.8	189,275	13,580	184,755	13,255	189,275	13,580	208,345	14,950
WSW24x12	4,000	26.5	380,670	20,100	418,805	22,115	380,670	20,100	418,805	22,115

- Allowable ASD base moments and anchor tension values are applicable to installations on concrete with specified compressive strengths as listed using the ASD basic (IBC Section 1605.3.1) or the alternative basic (IBC Section 1605.3.2) load combinations.
- Load values include evaluation of bearing stresses on concrete foundations and do not require further evaluation by the Designer. For installations on masonry foundations, bearing capacity shall be evaluated by the Designer.
- Seismic design based on 2015 IBC using R = 6.5. For other codes, use the seismic coefficients corresponding to light-frame bearing walls with wood structural panels or sheet-steel panels.
- Allowable vertical load denotes the total maximum vertical load permitted on the panel acting in combination with the allowable shear load and base moment.
- Allowable shear, drift, base moment and anchor tension values may be interpolated for intermediate height or vertical loads.
- Two-story stacked panel combinations may consist of any height combination of equal width panels listed in these tables.
- A multi-story kit (MSK) is required to attach the second-story panel to the first-story panel.
- High-strength anchor bolts are required for anchor tension forces exceeding the allowable load for standard-strength bolts tabulated on pages 53–54. See pages 52–59 for WSW-AB anchor bolt information and anchorage solutions.
- The Designer must verify that the cumulative overturning moment at the base of the first-story panel does not exceed the allowable base moment

capacity as shown in the example on page 51. The overturning base moment shall be determined using the following equation:

$M_{OT} = (V_1 \times h_1) + (V_2 \times h_2)$ , where:

$M_{OT}$  = Overturning base moment (lb.-in.)

$V_1$  = Applied shear load to first-story panel (lb.)

$V_2$  = Applied shear load to second-story panel (lb.)

$h_1$  = Height of first-story panel (in.);

$h_2$  = Total assembly Height ( $h_1$  + Height of second-story panel + 5) (in.)

Tabulated anchor tension values assume no resisting vertical load. Anchor tension loads at design shear values and including the effect of vertical load may be determined using the following equation:

$T = M_{OT} / B - P/2$ , where:

$T$  = Anchor tension load (lb.)

$P$  = Applied vertical load (lb.)

$M_{OT}$  = Overturning moment (lb.-in.), see Footnote 9

$B$  = Moment arm (in.); 13.94" for WSW18, 18.94" for WSW24

- First-story panel drift must comply with code drift limits; evaluate drift at the top of the first-story panel using the following equation:

$\Delta = h_1^2 / K \times [(3 \times V_2 \times h_3) + (2 \times V_{base} \times h_1)]$ , where:

$\Delta$  = First-story panel drift (in.)

$K$  = Stiffness factor for first-story panel (lb.-in.<sup>2</sup>)

$h_1$  = First-story panel height (in.)

$h_3$  = Second-story panel height (in.)

$V_2$  = Applied shear load to second-story panel (lb.)

$V_{base}$  = Sum of applied shear loads to first-story panel and second-story panel. (lb.)

# Two-Story Stacked on Concrete Foundations

## Designing for Cumulative Overturning Forces

In multi-story structures, shear and the associated overturning forces due to seismic and wind requirements must be carried down to the foundation by the building's lateral-force resisting system. These forces are cumulative over the height of the building, and shear forces applied at the second or third levels of a structure will generate much larger base overturning moments than the same shears applied at the first story. If cumulative overturning is not considered, the design may result in forces several times higher than the capacity of the lower wall, anchor bolts and foundation anchorage.

When specifying two-story stacked applications, analysis should be performed by following these steps.

1. Analyze the structure to determine the shear forces at each floor. The detail to the right illustrates the forces developed in a two-story stacked application. Then calculate the cumulative overturning moment ( $M_{OT}$ ), based on the story heights and applied shear forces at each story, as follows:  
 $M_{OT} = (V_1 \times h_1) + (V_2 \times h_2)$
2. Select the first-story panel and ensure that the allowable base moment exceeds the overturning moment ( $M_{OT}$ ).
3. Check the applicable second-story panel with the same width as the first-story panel and verify that the allowable second-story shear force exceeds the applied second-story shear force.
4. Check the first-story panel drift.

## Drift Equation for First-Story Shearwalls

The first-story panel drift must comply with code drift limits. Evaluate drift at the top of the first-story panel using the following equation:

$$\Delta = \frac{(h_1^2)}{K} (3V_2h_3 + 2V_{base}h_1) \text{ where:}$$

$\Delta$  = First-story panel drift (in.)

$K$  = Stiffness factor for first-story panel (lb.-in.<sup>2</sup>)

$h_1$  = First-story panel height (in.)

$h_3$  = Second-story panel height (in.)

$V_1$  = Applied shear load to first-story panel (lb.)

$V_2$  = Applied shear load to second-story panel (lb.)

$V_{base} = V_1 + V_2$  (lb.)

## Given

Seismic,  $f'_c = 2,500$  psi

First-story wall height = 9 ft.

Second-story wall height = 8 ft.


Joist height =  $11\frac{7}{8}$  ft.

First-story panel shear,  $V_1 = 1,200$  lb.

Second-story panel shear,  $V_2 = 1,000$  lb.

## Solution

1. Calculate the overturning moment;  
 $M_{OT} = (1,200 \text{ lb.} \times 105.25 \text{ in.}) + (1,000 \text{ lb.} \times 213.25 \text{ in.}) = 339,550 \text{ lb.-in.}$
2. Select WSW24x9 at the first-story;  
 $M_{allow} = 411,000 \text{ lb.-in.} > M_{OT}$  **OK**
3. Check the capacity of the second-story WSW24x9;  
 $V_{allow} = 2,165 \text{ lb.} > V_2$  **OK**
4. Verify that the first-story drift does not exceed ASD code drift limit,  
 $\Delta_{allow} = 0.7 (0.025H / C_d) = H / 228.6$   
 $\Delta_{allow} = 105.25 \text{ in.} / 228.6 = 0.46 \text{ in.}$   
 $\Delta = \frac{(105.25)^2}{21.5 \times 10^9} [(3 \times 1,000 \text{ lb.} \times 103") + (2 \times 2,200 \text{ lb.} \times 105.25")]$   
 $\Delta = 0.40 \text{ in.} < \Delta_{allow}$  **OK**

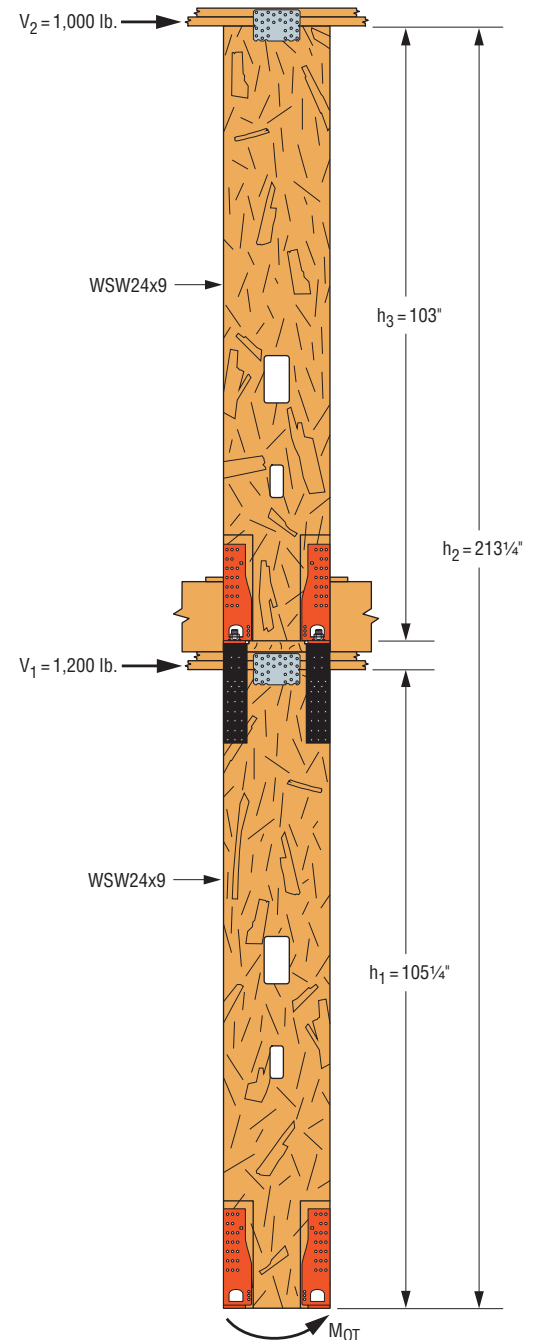

## Anchorage Solutions



### WSW-AB Anchor Bolts

WSW-AB anchor bolts in  $\frac{7}{8}$ " and 1" diameters offer flexibility to meet specific project demands. Inspection is easy; the head is stamped with a No-Equal symbol for identification, bolt length, bolt diameter, and optional "HS" for "High Strength" if specified.

**Material:** ASTM F1554 Grade 36;  
High Strength (HS) ASTM A449

*An additional nut for template installation is provided with each WSW-AB.*


Strong-Wall Wood Shearwall Width (in.)	Model No.	Dia. (in.)	Total Length (in.)	$l_e$ (in.)
12 and 18	WSW-AB $\frac{7}{8}$ x24	$\frac{7}{8}$	24	20
	WSW-AB $\frac{7}{8}$ x24HS	$\frac{7}{8}$	24	20
	WSW-AB $\frac{7}{8}$ x30	$\frac{7}{8}$	30	26
	WSW-AB $\frac{7}{8}$ x30HS	$\frac{7}{8}$	30	26
	WSW-AB $\frac{7}{8}$ x36HS	$\frac{7}{8}$	36	32
24	WSW-AB1x24	1	24	20
	WSW-AB1x24HS	1	24	20
	WSW-AB1x30	1	30	26
	WSW-AB1x30HS	1	30	26
	WSW-AB1x36HS	1	36	32

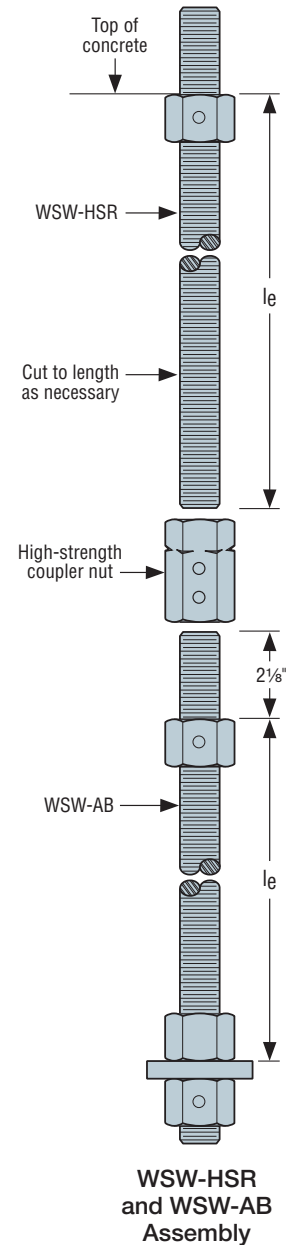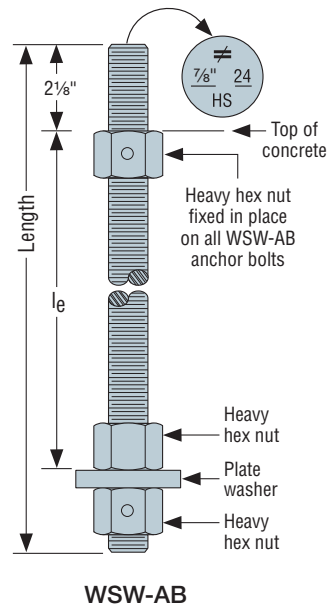

### WSW-HSR Extension Kit

WSW-HSR allows for anchorage in tall stemwall applications where full embedment of a WSW-AB into the footing is required. The head is stamped for identification like a WSW-AB. Kit includes ASTM A449 high-strength rod with heavy hex nut fixed in place and high-strength coupler nut. Do not use in place of WSW-AB.

Strong-Wall Wood Shearwall Width (in.)	Model No.	Dia. (in.)	Total Length (in.)	$l_e$ (in.)
12 and 18	WSW-HSR $\frac{7}{8}$ x24KT	$\frac{7}{8}$	24	22
	WSW-HSR $\frac{7}{8}$ x36KT	$\frac{7}{8}$	36	34
24	WSW-HSR1x24KT	1	24	22
	WSW-HSR1x36KT	1	36	34

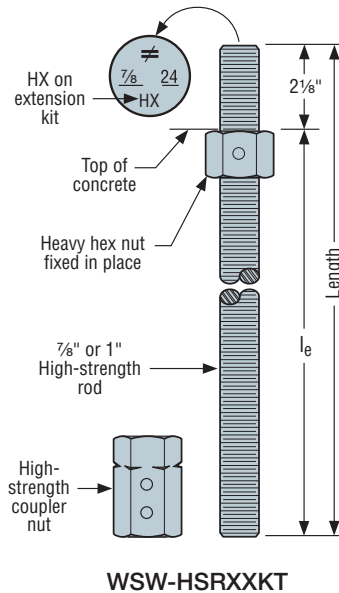

$$\text{Total } l_e = \text{WSW-HSR } l_e + \text{WSW-AB } l_e + 2\frac{1}{8}"$$



# Anchorage Solutions

## Strong-Wall® Wood Shearwall Tension Anchorage Solutions — 2,500 psi Concrete<sup>1,5,6</sup>

Design Criteria	Concrete Condition	Anchor Strength <sup>2</sup>	WSW-AB $\frac{7}{8}$ Anchor Bolt			WSW-AB1 Anchor Bolt		
			ASD Allowable Tension (lb.)	W (in.)	d <sub>e</sub> (in.)	ASD Allowable Tension (lb.)	W (in.)	d <sub>e</sub> (in.)
Seismic <sup>3</sup>	Cracked	Standard	11,900	27	9	16,100	33	11
			13,100	29	10	17,100	35	12
		High Strength	24,900	43	15	33,000	51	17
			27,100	46	16	35,300	54	18
	Uncracked	Standard	12,500	24	8	15,700	28	10
			13,100	25	9	17,100	30	10
		High Strength	25,300	38	13	32,300	44	15
			27,100	40	14	35,300	47	16
Wind <sup>4</sup>	Cracked	Standard	5,100	14	6	6,200	16	6
			8,700	20	7	11,400	24	8
			13,100	27	9	17,100	32	11
		High Strength	15,900	30	10	21,100	36	12
			18,400	33	11	27,300	42	14
			23,100	38	13	31,800	46	16
			27,100	42	14	35,300	50	17
			27,100	42	14	35,300	50	17
	Uncracked	Standard	5,000	12	6	6,400	14	6
			9,300	18	6	12,500	22	8
			13,100	23	8	17,100	28	10
		High Strength	15,200	25	9	21,900	32	11
			19,900	30	10	26,400	36	12
			24,000	34	12	31,500	40	14
			27,100	37	13	35,300	43	15
			27,100	37	13	35,300	43	15

See footnotes on page 54.

## Strong-Wall® Wood Shearwall Tension Anchorage Solutions — 3,000 psi Concrete<sup>1,5,6</sup>

Design Criteria	Concrete Condition	Anchor Strength <sup>2</sup>	WSW-AB $\frac{7}{8}$ Anchor Bolt			WSW-AB1 Anchor Bolt		
			ASD Allowable Tension (lb.)	W (in.)	d <sub>e</sub> (in.)	ASD Allowable Tension (lb.)	W (in.)	d <sub>e</sub> (in.)
Seismic <sup>3</sup>	Cracked	Standard	12,300	26	9	16,000	31	11
			13,100	28	10	17,100	33	11
		High Strength	25,200	41	14	32,700	48	16
			27,100	43	15	35,300	51	17
	Uncracked	Standard	12,000	22	8	16,300	27	9
			13,100	24	8	17,100	28	10
		High Strength	25,300	36	12	32,700	42	14
			27,100	38	13	35,300	44	15
Wind <sup>4</sup>	Cracked	Standard	5,000	13	6	5,600	14	6
			8,800	19	7	10,200	21	7
			13,100	25	9	17,100	30	10
		High Strength	15,700	28	10	20,100	33	11
			19,200	32	11	25,300	38	13
			23,200	36	12	32,300	44	15
			27,100	40	14	35,300	47	16
			27,100	40	14	35,300	47	16
	Uncracked	Standard	5,500	12	6	6,200	13	6
			8,500	16	6	12,800	21	7
			13,100	22	8	17,100	26	9
		High Strength	16,600	25	9	21,800	30	10
			19,700	28	10	25,200	33	11
			24,000	32	11	31,700	38	13
			27,100	35	12	35,300	41	14
			27,100	35	12	35,300	41	14

See footnotes on page 54.

# Anchorage Solutions

## Strong-Wall® Wood Shearwall Tension Anchorage Solutions — 4,500 psi Concrete<sup>1,5,6</sup>

Design Criteria	Concrete Condition	Anchor Strength <sup>2</sup>	WSW-AB <sup>7/8</sup> Anchor Bolt			WSW-AB1 Anchor Bolt		
			ASD Allowable Tension (lb.)	W (in.)	d <sub>e</sub> (in.)	ASD Allowable Tension (lb.)	W (in.)	d <sub>e</sub> (in.)
Seismic <sup>3</sup>	Cracked	Standard	12,600	23	8	16,000	27	9
			13,100	24	8	17,100	29	10
		High Strength	24,800	36	12	32,100	42	14
			27,100	38	13	35,300	45	15
	Uncracked	Standard	12,700	20	7	15,700	23	8
			13,100	21	7	17,100	25	9
		High Strength	24,600	31	11	32,500	37	13
			27,100	34	12	35,300	39	13
Wind <sup>4</sup>	Cracked	Standard	5,400	12	6	6,800	14	6
			8,300	16	6	11,600	20	7
			13,100	22	8	17,100	26	9
		High Strength	15,300	24	8	21,400	30	10
			19,300	28	10	25,800	34	12
			23,600	32	11	31,000	38	13
			27,100	36	12	35,300	42	14
	Uncracked	Standard	6,800	12	6	6,800	12	6
			9,400	15	6	12,400	18	6
			13,100	19	7	17,100	23	8
		High Strength	16,800	22	8	21,600	26	9
			20,300	25	9	26,700	30	10
			24,100	28	10	32,200	34	12
			27,100	31	11	35,300	36	12

1. Anchorage designs conform to ACI 318-14 and ACI 318-11 Appendix D with no supplementary reinforcement for cracked and uncracked concrete as noted.
2. Anchor strength indicates required grade of WSW-AB anchor bolt. Standard (ASTM F1554 Grade 36) or high strength (HS) (ASTM A449).
3. Seismic indicates Seismic Design Categories C through F. Detached one- and two-family dwellings in SDC C may use wind anchorage solutions. Seismic anchorage designs conform to ACI 318-14 Section 17.2.3.4.3 and ACI 318-11 Section D.3.3.4.
4. Wind includes Seismic Design Categories A and B and detached one- and two-family dwellings in SDC C.
5. Foundation dimensions are for anchorage only. Foundation design (size and reinforcement) by others. The registered design professional may specify alternative embedment, footing size or anchor bolt.
6. Refer to slab on grade, curb, stemwall and interior footing details for w and d<sub>e</sub> as shown on pages 56–57.

## Anchor Bolt Solutions


### Strong-Wall® Wood Shearwall Shear Anchorage

Foundation shear reinforcement to resist shear forces from Strong-Wall® Wood Shearwalls located at the edge of concrete is shown in the table below. The WSW12 used in wind applications does not require shear reinforcement when the panel design shear force is less than the anchorage allowable shear load shown in the table below.


#### Strong-Wall® Wood Shearwall Shear Anchorage Solutions

Strong-Wall Wood Shearwall Model	$L_t$ or $L_h$ (in.)	Seismic <sup>3</sup>		Wind <sup>4</sup>			
		Shear Reinforcement	Minimum Curb/Stemwall Width (in.)	Shear Reinforcement	Minimum Curb/Stemwall Width (in.)	ASD Allowable Shear Load, V (lb.) <sup>6</sup>	
						Uncracked	Cracked
WSW12	10¼	(1) #3 Hairpin	8 <sup>5</sup>	See Note 6	6	1,035	740
WSW18	15	(1) #3 Hairpin	8 <sup>5</sup>	(1) #3 Hairpin	6	Hairpin reinforcement achieves maximum allowable shear load of the Strong-Wall® WSW.	
WSW24	19	(2) #3 Hairpin	8 <sup>5</sup>	(1) #3 Hairpin	6		


1. Shear anchorage designs conform to ACI 318-14 and assume minimum 2,500 psi concrete. See pages 53–54 for tension anchorage.
2. Shear reinforcement is not required for interior foundation applications (panel installed away from edge of concrete), or braced-wall panel applications.
3. Seismic indicates Seismic Design Categories C through F. Detached one- and two-family dwellings in SDC C may use wind anchorage solutions. Seismic shear reinforcement designs conform to ACI 318-14 Section 17.2.3.5.3.
4. Wind includes Seismic Design Categories A and B.
5. Minimum curb/stemwall width is 6" when standard-strength anchor bolt is used.
6. Use (1) #3 tie for WSW12 when panel design shear force exceeds tabulated anchorage allowable shear load.
7. #4 grade 40 shear reinforcement may be substituted for WSW shear anchorage solutions.
8. The registered design professional may specify alternative shear anchorage.

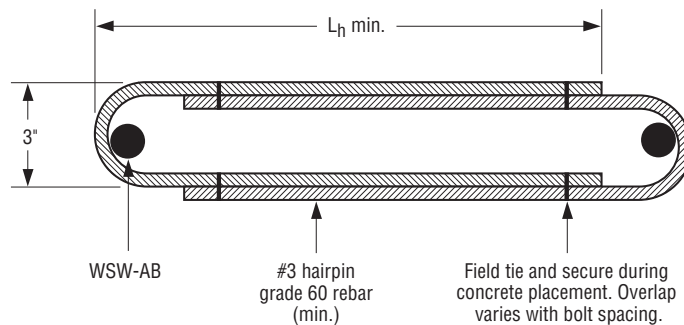

**Hairpin Shear Reinforcement**

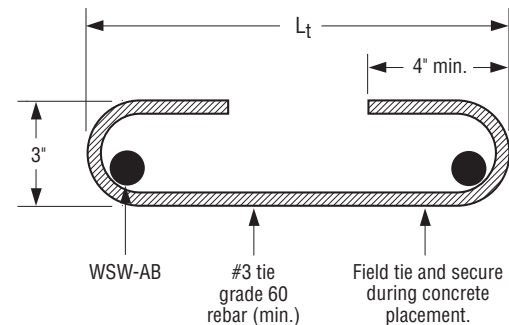


**Tie Shear Reinforcement**

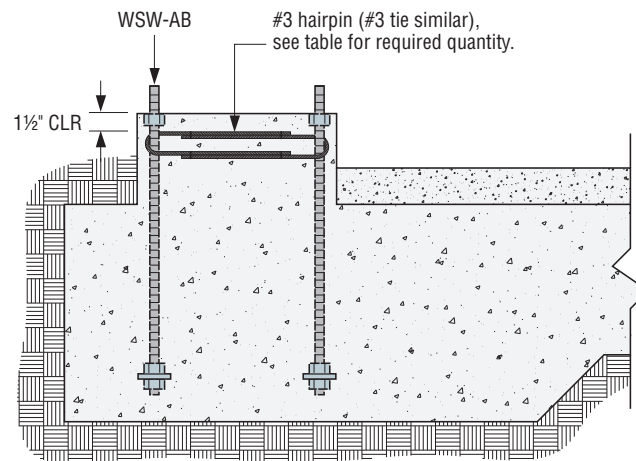



**Hairpin Installation**  
(Garage curb shown, other footing types similar)

# Anchorage Solutions

## Curb or Stemwall Installation

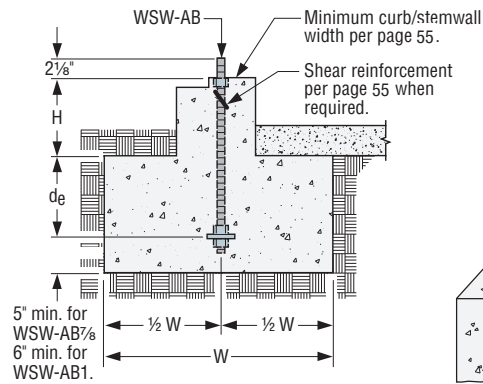


Curb or Stemwall Section View

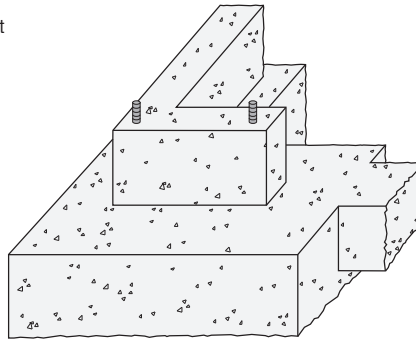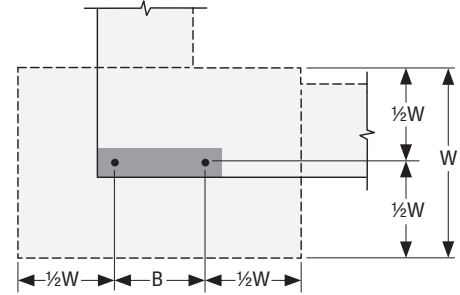
Perspective View  
(Slab not shown for clarity)

Footing Plan


## Slab-on-Grade Installation

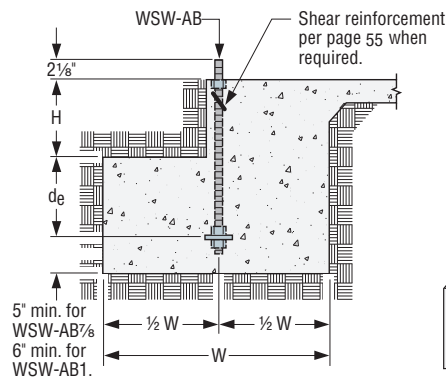

Slab-on-Grade Section View

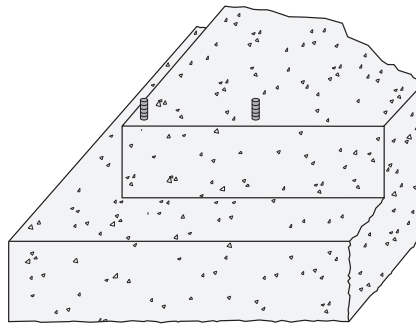


Perspective View

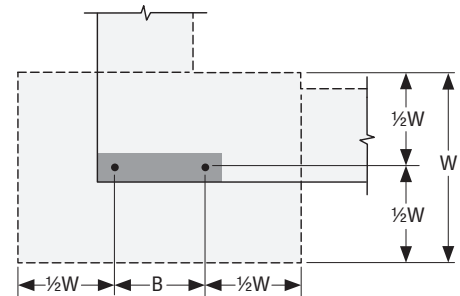


Footing Plan


## Brick Ledge Installation

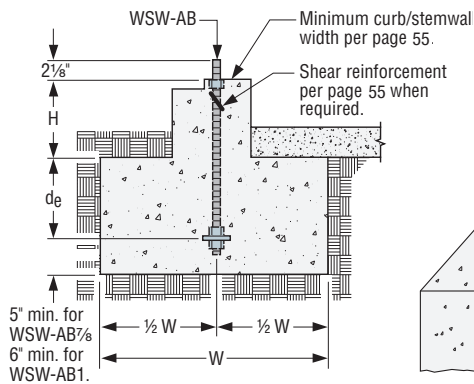

Brick Ledge Section View

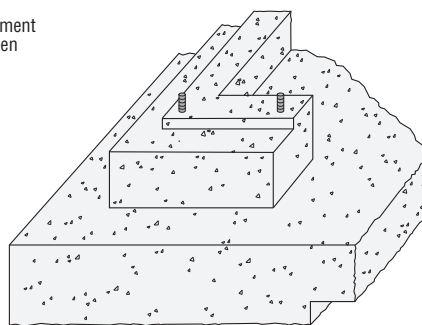

Perspective View

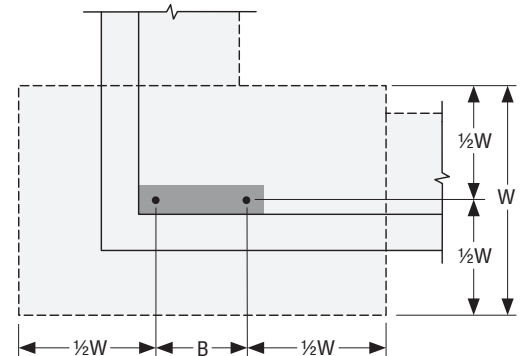

Footing Plan

### Anchorage Solutions General Notes

1. The Designer may specify alternate embedment, footing size or bolt grade.
2. Footing dimensions and rebar requirements are for anchorage only.

Foundation design  
(size and reinforcement) by Designer.





## Anchorage Solutions


### Anchor Reinforcement Solutions on Grade Beams

Simpson Strong-Tie now provides grade-beam anchorage solutions for the Strong-Wall® Wood Shearwall (WSW), which have been calculated to conform to ACI 318-14. Through funding from the Structural Engineers Association of Northern California, initial testing at Scientific Construction Laboratories Inc. confirmed the need to comply with ACI 318 requirements to prevent plastic hinging at anchor locations. Follow-up testing at the Simpson Strong-Tie Tyrell Gilb Research Laboratory was then used to confirm these findings and validate performance. The testing consisted of specimens with closed-tie anchor reinforcement, specimens with non-closed u-stirrups, and control specimens without anchor reinforcement. Flexural and shear reinforcement were designed to resist amplified anchorage forces and compared to test beams designed for non-amplified strength level forces. The test program has proven the performance of the anchor reinforcement details developed by Simpson Strong-Tie.

#### Significant Findings from Testing:

Grade-beam flexural and shear capacity is critical to anchor performance and must be designed to exceed the demands created by the attached structure. In wind load applications, this demand includes the factored demand from the Strong-Wall Wood Shearwall (WSW). In seismic applications, testing and analysis have shown that in order to achieve the anchor performance expected by ACI 318 anchorage design methodologies, the concrete member design strength needs to resist the amplified anchor design demand from ACI 318-14 Section 17.2.3.4.3 and ACI 318-11 Appendix D Section D.3.3.4.3. To help Designers achieve this, Simpson Strong-Tie recommends Designers apply the seismic design moment listed in the table below at the WSW location when evaluating the grade-beam design strength under seismic loads. The tabulated moment correlates to the lowest of the anchor-tension design limits defined in the sections listed above as they relate to each WSW model.

Closed-tie anchor reinforcement is critical to maintain the integrity of the reinforced core where the anchor is located. Testing with u-stirrups that did not include complete closed ties showed premature splitting failure of the grade beam.

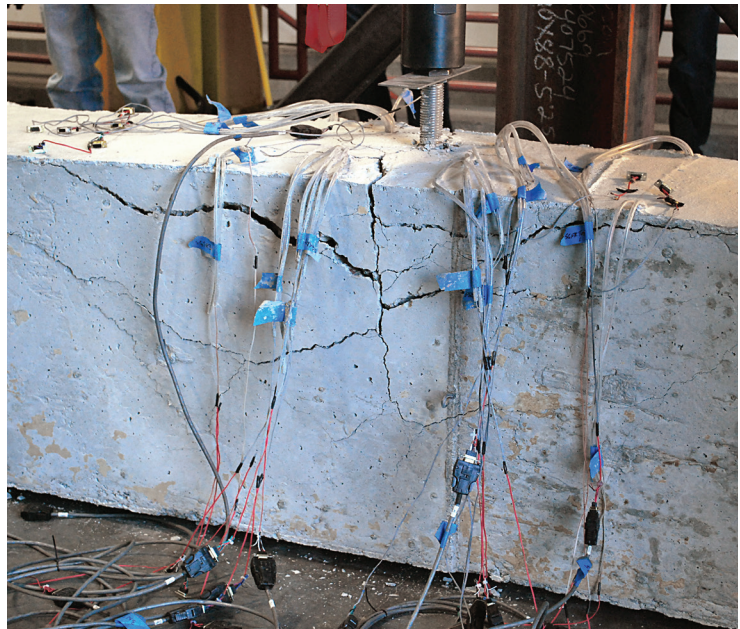

Grade-Beam Testing

#### Strong-Wall® Wood Shearwall Grade-Beam Anchorage Solutions

Strong-Wall Wood Shearwall Model	Anchor Bolt Model No.	Anchor Diameter (in.)	Anchor Reinforcement for Wind and Seismic <sup>3,8,9</sup>		Amplified LRFD Applied Design Seismic Moment (ft.-lb.) <sup>4,5,6,7</sup>	
			Standard-Strength WSW-AB	High-Strength WSW-ABHS	Standard-Strength WSW-AB	High-Strength WSW-ABHS
WSW12	WSW-AB $\frac{7}{8}$ WSW-AB $\frac{7}{8}$ HS	$\frac{7}{8}$	(4) #4 Closed Ties / Wall	(6) #4 Closed Ties / Wall	24,700	24,700
WSW18					44,100	50,600
WSW24	WSW-AB1 WSW-AB1HS	1	(2) #4 Closed Ties / Anchor	(4) #4 Closed Ties / Anchor	75,600	93,600

- Anchor reinforcement conforms to ACI 318-14 Section 17.4.2.9 and ACI 318-11 Section D.5.2.9. Full-scale testing was used to validate anchor reinforcement configuration and placement.
- Minimum concrete compressive strength,  $f'_c = 2,500$  psi.
- Closed-tie anchor reinforcement to be ASTM A615 Grade 60 (min.) #4 rebar.
- Grade-beam longitudinal and tie reinforcement shall be specified by the registered design professional for flexure and shear loading. Design should consider project-specific design loads and allowable soil pressure.
- Simpson Strong-Tie recommends using the tabulated minimum amplified LRFD applied seismic design moment to ensure grade-beam design flexure and shear strength is adequate to prevent plastic hinge formation under demands associated with anchorage forces corresponding to ACI 318-14 Section 17.2.3.4.3 and ACI 318-11 Section D.3.3.4.3.

- Designer may use reduced moment due to applied WSW lateral load. Minimum moment shall be the lesser of the tabulated moment or the amplified LRFD design moment for seismic: (ASD design demand shear/0.7)  $\times \Omega_0 \times$  WSW wall height for grade-beam design.
- Minimum grade-beam design moment for wind and seismic in Seismic Design Category A and B and detached one- and two-family dwellings in SDC C: (ASD design demand shear/0.6)  $\times$  WSW wall height.
- Closed tie may be single-piece hoop or two-piece assembly with a u-stirrup with standard 135° hooks and a top cross-tie cap. See detail 6/WSW1.1.
- See details for grade-beam anchor reinforcement placement, installation and spacing requirements. Closed-tie anchor reinforcement quantity is per wall for the 12"- and 18"-wall models, and per anchor for the 24" model.





# Anchor-Bolt Templates

Simpson Strong-Tie has developed a reusable anchor-bolt template for common foundation types for the Strong-Wall® Wood Shearwalls. The templates help to accurately locate the newly-designed WSW-AB preassembled anchor bolts, which simplifies installation and greatly reduces the chances of voids in the concrete.



## Strong-Wall® Wood Shearwall Anchor-Bolt Templates

Strong-Wall Wood Shearwall Model No.	Width (in.)	Strong-Wall Wood Shearwall Template Model		
		Reversible	Panel Form	Brick Ledge
WSW12	12½	WSW-RT12	WSW-RTPF12	WSW-RTBL12
WSW18	18	WSW-RT18	WSW-RTPF18	WSW-RTBL18
WSW24	24	WSW-RT24	WSW-RTPF24	WSW-RTBL24

1. Templates are recommended and are required in some jurisdictions.
2. Foundation design by the Designer.

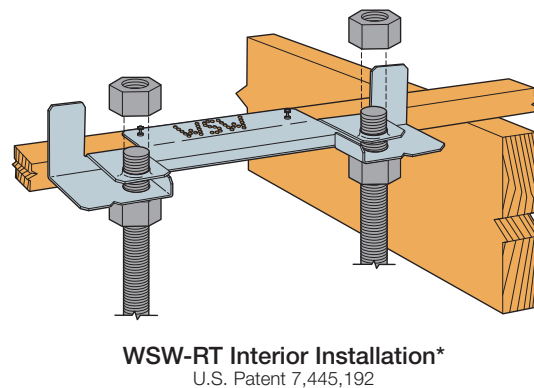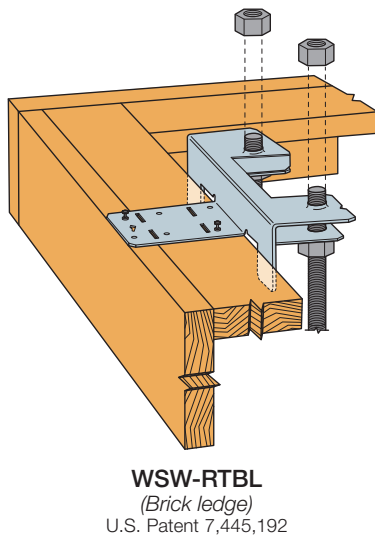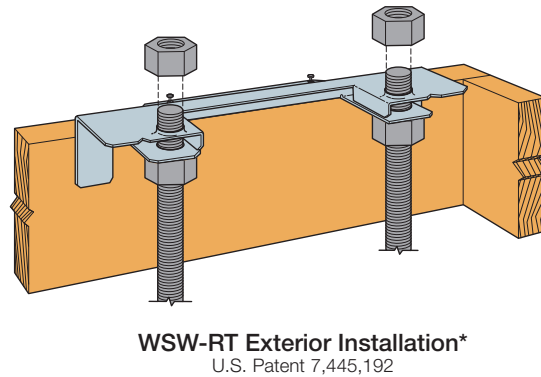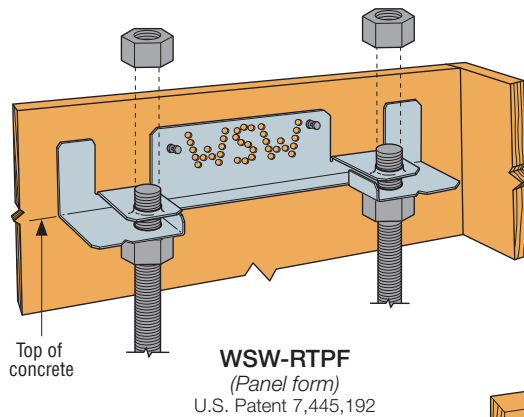


An additional nut for template installation is provided with each WSW-AB.

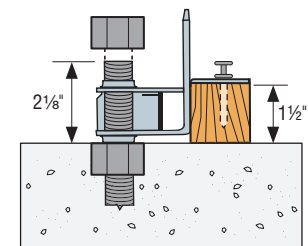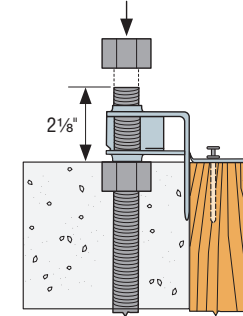

**Anchor Bolt Height**

\*WSW-RT templates are reversible. Use the same template for interior or exterior applications.

# Anchorage and Installation Details

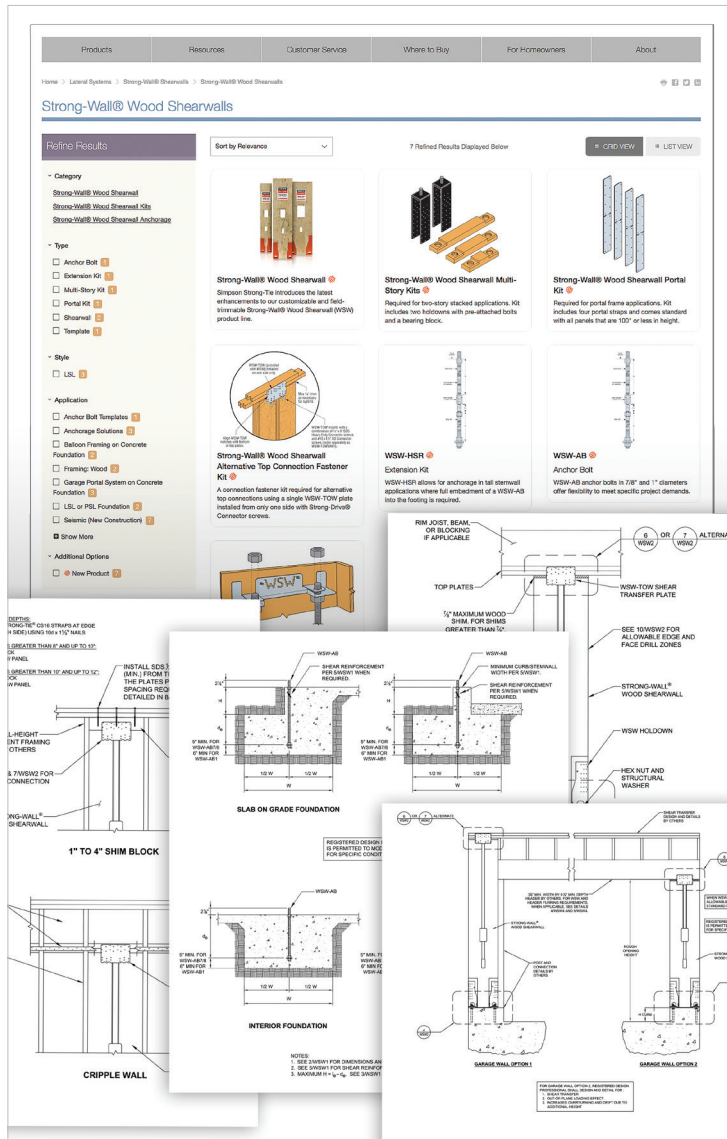

Simpson Strong-Tie offers complete structural details in order to make the specification and installation easier for all Strong-Wall® shearwalls. Versions of these details are available three ways:


- Full-size 24" x 36" detail sheets may be downloaded at [strongtie.com](http://strongtie.com) in DWG, DXF and PDF formats.
- Call (800) 999-5099: Full-size, printed sheets may be requested from our regional branches at no charge.
- In this catalog: Smaller versions are shown here for easy reference. Details are numbered to coincide with full-size sheets, although some have been left out to eliminate redundancy.

## In This Section:


- Steel Strong-Wall® Anchorage and Installation Details Pages 61–76 (Sheets SSW1, SSW1.1, SSW2, SSW3 and SSW4)
- Strong-Wall® Wood Shearwall, Anchorage and Installation Details Pages 77–93 (Sheets WSW1, WSW1.1, WSW2, WSW3 and WSW4)



# Anchorage Details

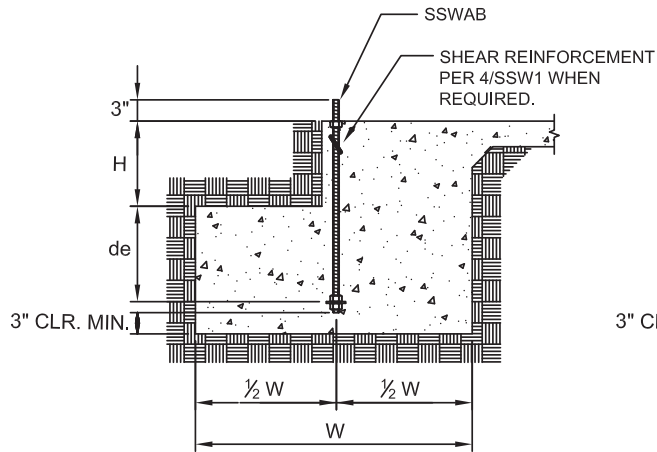


SLAB ON GRADE FOUNDATION

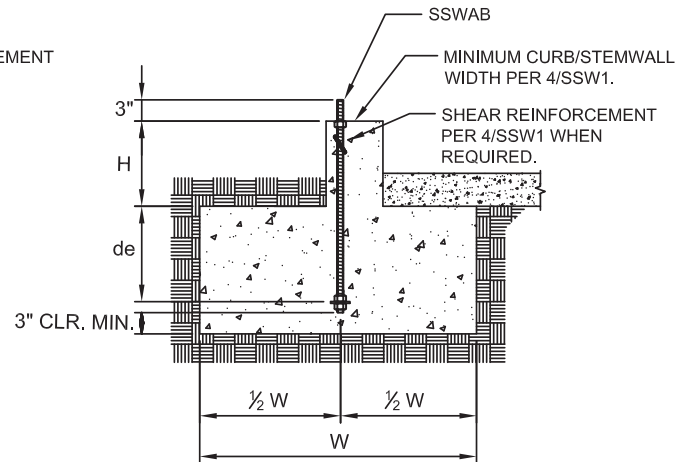


CURB OR STEMWALL FOUNDATION

REGISTERED DESIGN PROFESSIONAL  
IS PERMITTED TO MODIFY DETAILS  
FOR SPECIFIC CONDITIONS.

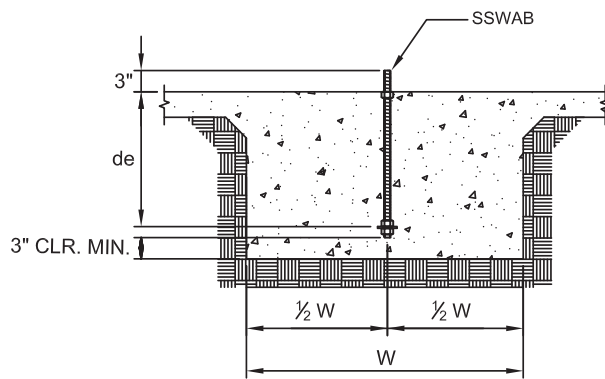

INTERIOR FOUNDATION

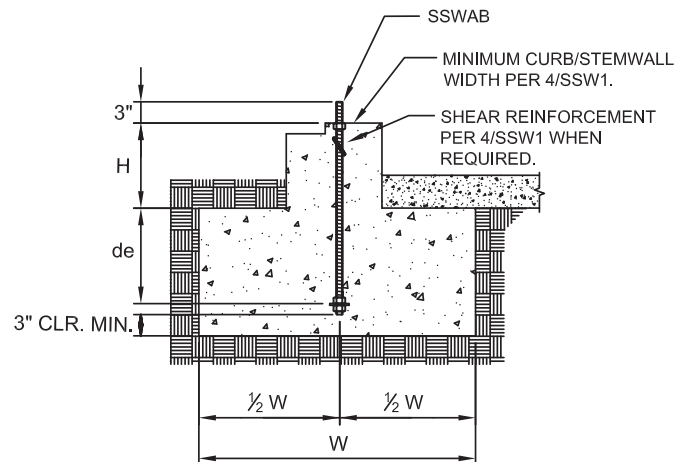


BRICK LEDGE FOUNDATION

## NOTES:

1. SEE 2/SSW1 AND 3/SSW1 FOR DIMENSIONS AND ADDITIONAL NOTES.
2. SEE 4/SSW1 FOR SHEAR REINFORCEMENT WHEN REQUIRED.
3. MAXIMUM  $H = l_e - d_e$ . SEE 5/SSW1 AND 6/SSW1 FOR  $l_e$ .

# Anchorage Details

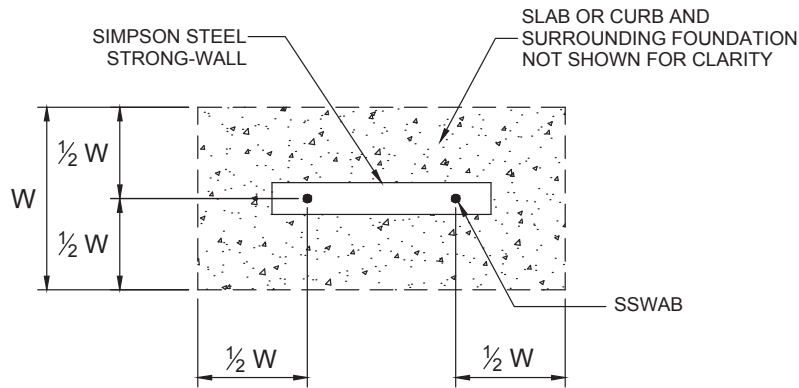

SEE TABLE BELOW FOR DIMENSIONS

FOUNDATION PLAN VIEW

STEEL STRONG-WALL ANCHORAGE SOLUTIONS FOR 2500 PSI CONCRETE								
DESIGN CRITERIA	CONCRETE CONDITION	ANCHOR STRENGTH	SSWAB 3/4" ANCHOR BOLT			SSWAB 1" ANCHOR BOLT		
			ASD ALLOWABLE UPLIFT (lbs)	W (in)	de (in)	ASD ALLOWABLE UPLIFT (lbs)	W (in)	de (in)
SEISMIC	CRACKED	STANDARD	8,800	22	8	16,100	33	11
			9,600	24	8	17,100	35	12
		HIGH STRENGTH	18,500	36	12	33,000	51	17
			19,900	38	13	35,300	54	18
	UNCRAKED	STANDARD	8,800	19	7	15,700	28	10
			9,600	21	7	17,100	30	10
		HIGH STRENGTH	18,300	31	11	32,300	44	15
			19,900	33	11	35,300	47	16
WIND	CRACKED	STANDARD	5,100	14	6	6,200	16	6
			7,400	18	6	11,400	24	8
			9,600	22	8	17,100	32	11
		HIGH STRENGTH	11,400	24	8	21,100	36	12
			13,600	27	9	27,300	42	14
			15,900	30	10	31,800	46	16
			19,900	35	12	35,300	50	17
			UNCRAKED	STANDARD	5,000	12	6	6,400
	7,800	16			6	12,500	22	8
	9,600	19			7	17,100	28	10
	HIGH STRENGTH	12,500		22	8	21,900	32	11
		14,300		24	8	26,400	36	12
		17,000		27	9	31,500	40	14
		19,900		30	10	35,300	43	15

## NOTES:

- ANCHORAGE DESIGNS CONFORM TO ACI 318-14 AND ACI 318-11 APPENDIX D WITH NO SUPPLEMENTARY REINFORCEMENT FOR CRACKED OR UNCRACKED CONCRETE AS NOTED.
- ANCHOR STRENGTH INDICATES REQUIRED GRADE OF SSWAB ANCHOR BOLT. STANDARD (ASTM F1554 GRADE 36) OR HIGH STRENGTH (HS) (ASTM A449).
- SEISMIC INDICATES SEISMIC DESIGN CATEGORY C THROUGH F. DETACHED 1 AND 2 FAMILY DWELLINGS IN SDC C MAY USE WIND ANCHORAGE SOLUTIONS. SEISMIC ANCHORAGE DESIGNS CONFORM TO ACI 318-14 SECTION 17.2.3.4.3 AND ACI 318-11 SECTION D.3.3.4.
- WIND INCLUDES SEISMIC DESIGN CATEGORY A AND B AND DETACHED 1 AND 2 FAMILY DWELLINGS IN SDC C.
- FOUNDATION DIMENSIONS ARE FOR ANCHORAGE ONLY. FOUNDATION DESIGN (SIZE AND REINFORCEMENT) BY OTHERS. THE REGISTERED DESIGN PROFESSIONAL MAY SPECIFY ALTERNATE EMBEDMENT, FOOTING SIZE OR ANCHOR BOLT.
- REFER TO 1/SSW1 FOR de.

# Anchorage Details

STEEL STRONG-WALL ANCHORAGE SOLUTIONS FOR 3500 PSI CONCRETE								
DESIGN CRITERIA	CONCRETE CONDITION	ANCHOR STRENGTH	SSWAB 3/4" ANCHOR BOLT			SSWAB 1" ANCHOR BOLT		
			ASD ALLOWABLE UPLIFT (lbs)	W (in)	de (in)	ASD ALLOWABLE UPLIFT (lbs)	W (in)	de (in)
SEISMIC	CRACKED	STANDARD	9,000	20	7	15,700	29	10
			9,600	21	7	17,100	31	11
		HIGH STRENGTH	18,200	32	11	33,000	46	16
			19,900	34	12	35,300	48	16
	UNCRAKED	STANDARD	8,800	17	6	15,700	25	9
			9,600	19	7	17,100	27	9
		HIGH STRENGTH	18,600	28	10	32,600	40	14
			19,900	30	10	35,300	42	14
WIND	CRACKED	STANDARD	6,000	14	6	7,300	16	6
			7,300	16	6	13,500	24	8
			9,600	20	7	17,100	29	10
			11,800	22	8	22,700	34	12
		HIGH STRENGTH	13,500	24	8	27,400	38	13
			17,000	28	10	32,300	42	14
			19,900	32	11	35,300	45	15
			6,000	12	6	7,500	14	6
	UNCRAKED	STANDARD	7,500	14	6	12,800	20	7
			9,600	17	6	17,100	25	9
			12,800	20	7	21,300	28	10
			14,800	22	8	26,000	32	11
		HIGH STRENGTH	16,900	24	8	31,300	36	12
			19,900	27	9	35,300	39	13

STEEL STRONG-WALL ANCHORAGE SOLUTIONS FOR 4500 PSI CONCRETE								
DESIGN CRITERIA	CONCRETE CONDITION	ANCHOR STRENGTH	SSWAB 3/4" ANCHOR BOLT			SSWAB 1" ANCHOR BOLT		
			ASD ALLOWABLE UPLIFT (lbs)	W (in)	de (in)	ASD ALLOWABLE UPLIFT (lbs)	W (in)	de (in)
SEISMIC	CRACKED	STANDARD	8,700	18	6	16,000	27	9
			9,600	20	7	17,100	29	10
		HIGH STRENGTH	17,800	29	10	32,100	42	14
			19,900	32	11	35,300	45	15
	UNCRAKED	STANDARD	9,100	16	6	15,700	23	8
			9,600	17	6	17,100	25	9
		HIGH STRENGTH	17,800	25	9	32,500	37	13
			19,900	27	9	35,300	39	13
WIND	CRACKED	STANDARD	5,400	12	6	6,800	14	6
			8,300	16	6	11,600	20	7
			9,600	18	6	17,100	26	9
			11,600	20	7	21,400	30	10
		HIGH STRENGTH	13,400	22	8	25,800	34	12
			17,300	26	9	31,000	38	13
			19,900	29	10	35,300	42	14
			6,800	12	6	6,800	12	6
	UNCRAKED	STANDARD	8,500	14	6	12,400	18	6
			9,600	16	6	17,100	23	8
			12,400	18	6	21,600	26	9
			14,500	20	7	26,700	30	10
		HIGH STRENGTH	16,800	22	8	32,200	34	12
			19,900	25	9	35,300	36	12





## NOTES:

- ANCHORAGE DESIGNS CONFORM TO ACI 318-14 AND ACI 318-11 APPENDIX D WITH NO SUPPLEMENTARY REINFORCEMENT FOR CRACKED OR UNCRACKED CONCRETE AS NOTED.
- ANCHOR STRENGTH INDICATES REQUIRED GRADE OF SSWAB ANCHOR BOLT. STANDARD (ASTM F1554 GRADE 36) OR HIGH STRENGTH (HS) (ASTM A449).
- SEISMIC INDICATES SEISMIC DESIGN CATEGORY C THROUGH F. DETACHED 1 AND 2 FAMILY DWELLINGS IN SDC C MAY USE WIND ANCHORAGE SOLUTIONS. SEISMIC ANCHORAGE DESIGNS CONFORM TO ACI 318-14 SECTION 17.2.3.4.3 AND ACI 318-11 SECTION D.3.3.4.
- WIND INCLUDES SEISMIC DESIGN CATEGORY A AND B AND DETACHED 1 AND 2 FAMILY DWELLINGS IN SDC C.
- FOUNDATION DIMENSIONS ARE FOR ANCHORAGE ONLY. FOUNDATION DESIGN (SIZE AND REINFORCEMENT) BY OTHERS. THE REGISTERED DESIGN PROFESSIONAL MAY SPECIFY ALTERNATE EMBEDMENT, FOOTING SIZE OR ANCHOR BOLT.
- REFER TO 1/SSW1 FOR de.

SSWAB TENSION ANCHORAGE SCHEDULE 3,500/4,500 PSI

3/SSW1

# Anchorage Details

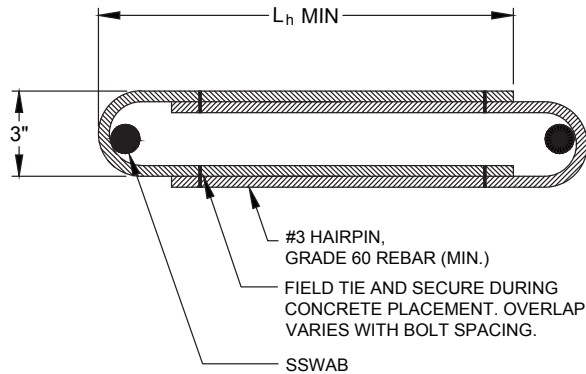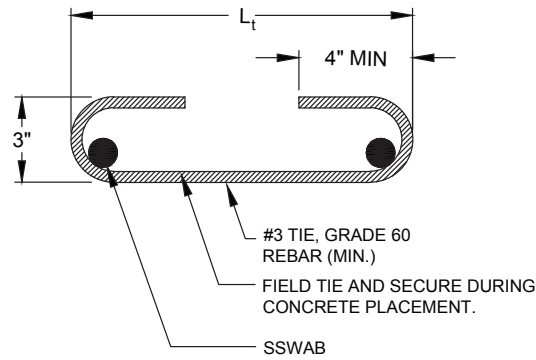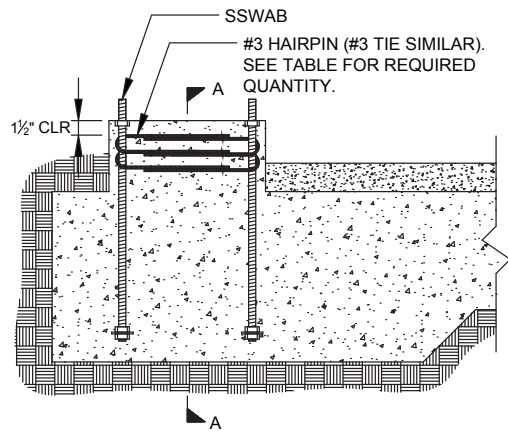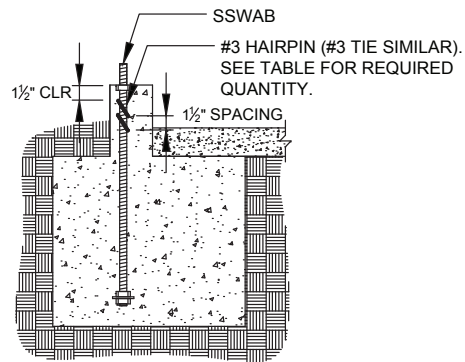
**HAIRPIN SHEAR REINFORCEMENT**

**TIE SHEAR REINFORCEMENT**

**HAIRPIN INSTALLATION**  
 (GARAGE CURB SHOWN. OTHER FOOTING TYPES SIMILAR.)

**SECTION A-A**

 REGISTERED DESIGN PROFESSIONAL  
 IS PERMITTED TO MODIFY DETAILS  
 FOR SPECIFIC CONDITIONS.


STEEL STRONG-WALL SHEAR ANCHORAGE									
MODEL	SEISMIC <sup>3</sup>			WIND <sup>4</sup>					
	L <sub>t</sub> OR L <sub>h</sub> (in.)	SHEAR REINFORCE- MENT	MIN. CURB / STEMWALL WIDTH (in.)	SHEAR REINFORCE- MENT	MIN. CURB / STEMWALL WIDTH (in.)	ASD ALLOWABLE SHEAR LOAD V (lbs.) <sup>6</sup>			
						6" MIN CURB / STEMWALL		8" MIN CURB / STEMWALL	
						UNCRACKED	CRACKED	UNCRACKED	CRACKED
SSW12	9	(1) #3 TIE	6	NONE REQUIRED	-	1230	880	1440	1030
SSW15	12	(2) #3 TIES	6	NONE REQUIRED	-	1590	1135	1810	1295
SSW18	14	(1) #3 HAIRPIN	8 <sup>5</sup>	(1) #3 HAIRPIN	6	HAIRPIN REINFORCEMENT ACHIEVES MAXIMUM ALLOWABLE SHEAR LOAD OF THE STEEL STRONG-WALL PANEL			
SSW21	15	(2) #3 HAIRPIN	8 <sup>5</sup>	(1) #3 HAIRPIN	6				
SSW24	17	(2) #3 HAIRPIN	8 <sup>5</sup>	(1) #3 HAIRPIN	6				

**NOTES:**

1. SHEAR ANCHORAGE DESIGNS CONFORM TO ACI 318-14 AND ACI 318-11 AND ASSUME MINIMUM  $f'_c=2,500$  PSI CONCRETE. SEE DETAILS 1/SSW1 TO 3/SSW1 FOR TENSION ANCHORAGE.
2. SHEAR REINFORCEMENT IS NOT REQUIRED FOR PANELS INSTALLED ON A WOOD FLOOR, INTERIOR FOUNDATION APPLICATIONS (PANEL INSTALLED AWAY FROM EDGE OF CONCRETE), OR BRACED-WALL PANEL APPLICATIONS.
3. SEISMIC INDICATES SEISMIC DESIGN CATEGORY C THROUGH F. DETACHED 1 AND 2 FAMILY DWELLINGS IN SD C MAY USE WIND ANCHORAGE SOLUTIONS.
4. WIND INCLUDES SEISMIC DESIGN CATEGORY A AND B.
5. MINIMUM CURB/STEMWALL WIDTH IS 6" WHEN STANDARD STRENGTH SSWAB IS USED.
6. USE (1) #3 TIE FOR SSW12 AND SSW15 WHEN THE STEEL STRONG-WALL PANEL DESIGN SHEAR FORCE EXCEEDS THE TABULATED ANCHORAGE ALLOWABLE SHEAR LOAD.
7. CONCRETE EDGE DISTANCE FOR ANCHORS MUST COMPLY WITH ACI 318-14 SECTION 17.7.2 AND ACI 318-11 SECTION D.8.2.




# Anchorage Details

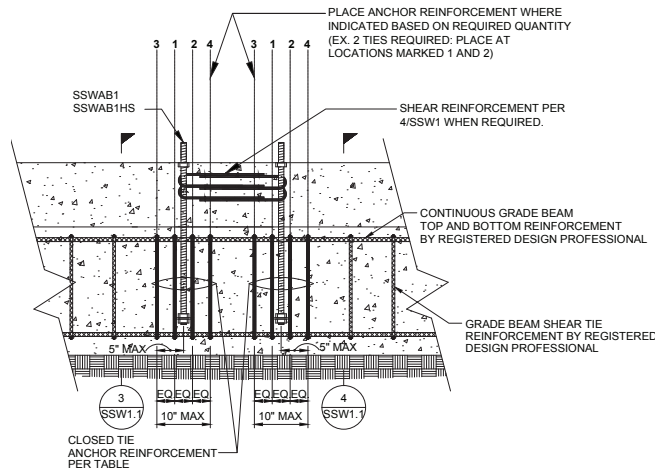

GRADE BEAM ELEVATION AT 18", 21" AND 24" WALL MODELS

1/SSW1.1

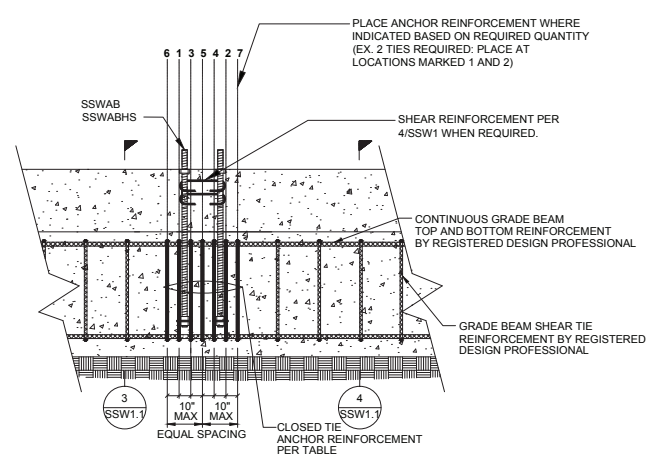


GRADE BEAM ELEVATION AT 12" AND 15" WALL MODELS

2/SSW1.1


**NOTE:**

ANCHOR REINFORCEMENT IS FOR ANCHORAGE ONLY. GRADE BEAM DESIGN (SIZE AND REINFORCEMENT) BY REGISTERED DESIGN PROFESSIONAL.

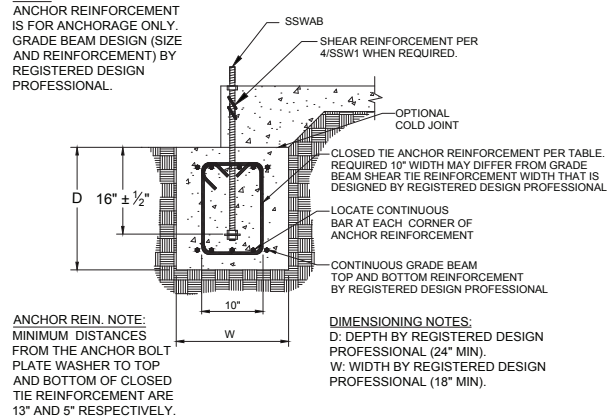

GRADE BEAM SECTION AT ANCHOR REINFORCEMENT

3/SSW1.1

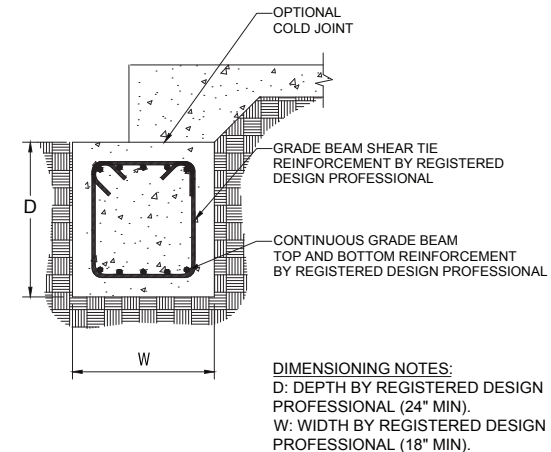

GRADE BEAM SECTION AWAY FROM ANCHOR REINFORCEMENT

4/SSW1.1

## SSW GRADE BEAM ANCHOR REINFORCEMENT

STEEL STRONG-WALL WIDTH (in.)	ANCHOR MODEL NO.	ANCHOR DIAMETER (in.)	ANCHOR REINFORCEMENT FOR WIND AND SEISMIC <sup>3,8,9</sup>		LRFD APPLIED DESIGN SEISMIC MOMENT (ft.-lbs.) <sup>4,5,6,7</sup>	
			STANDARD STRENGTH SSWAB	HIGH STRENGTH (HS) SSWAB	STANDARD STRENGTH SSWAB	HIGH STRENGTH (HS) SSWAB
12" MODEL	SSWAB3/4 SSWAB3/4HS	3/4	2- #4 CLOSED TIES PER $\frac{2}{SSW1.1}$	5- #4 CLOSED TIES PER $\frac{2}{SSW1.1}$	16,700	23,000
15" MODEL	SSWAB1 SSWAB1HS	1	4- #4 CLOSED TIES PER $\frac{2}{SSW1.1}$	7- #4 CLOSED TIES PER $\frac{2}{SSW1.1}$	37,000	44,000
18" MODEL			2- #4 CLOSED TIES PER $\frac{1}{SSW1.1}$	4- #4 CLOSED TIES PER $\frac{1}{SSW1.1}$	48,700	61,000
21" MODEL					60,300	77,000
24" MODEL					72,000	87,000


**NOTES:**

- ANCHOR REINFORCEMENT CONFORMS TO ACI 318-14 SECTION 17.4.2.9 AND ACI 318-11 SECTION D.5.2.9 AND PERFORMANCE WAS VALIDATED THROUGH FULL SCALE TESTING.
- MINIMUM CONCRETE COMPRESSIVE STRENGTH,  $f_c = 2500$  psi.
- CLOSED TIE ANCHOR REINFORCEMENT TO BE ASTM A615 GRADE 60 (MIN) #4 REBAR.
- GRADE BEAM LONGITUDINAL AND TIE REINFORCEMENT SHALL BE SPECIFIED BY THE REGISTERED DESIGN PROFESSIONAL FOR FLEXURE AND SHEAR LOADING. DESIGN SHOULD CONSIDER PROJECT SPECIFIC DESIGN LOADS AND ALLOWABLE SOIL PRESSURE.
- SIMPSON STRONG-TIE RECOMMENDS USING THE TABULATED MINIMUM LRFD APPLIED SEISMIC DESIGN MOMENT TO ENSURE GRADE BEAM DESIGN FLEXURE AND SHEAR STRENGTH IS ADEQUATE TO PREVENT PLASTIC HINGE FORMATION UNDER DEMANDS ASSOCIATED WITH ANCHORAGE FORCES CORRESPONDING TO ACI 318-14 SECTION 17.2.3.4.3 AND ACI 318-11 SECTION D.3.3.4.3.
- DESIGNER MAY USE REDUCED MOMENT DUE TO APPLIED SSW LATERAL LOAD. MINIMUM MOMENT SHALL BE THE LESSER OF THE TABULATED MOMENT OR THE AMPLIFIED LRFD DESIGN MOMENT FOR SEISMIC:  $(ASD \text{ SHEAR}/0.7) \times D_o \times \text{SSW HEIGHT FOR GRADE BEAM DESIGN}$ .
- MINIMUM GRADE BEAM DESIGN MOMENT FOR WIND AND SEISMIC IN SEISMIC DESIGN CATEGORY A AND B AND DETACHED 1 AND 2 FAMILY DWELLINGS IN SDC C:  $(ASD \text{ SHEAR}/0.6) \times \text{SSW HEIGHT}$ .
- CLOSED TIE MAY BE SINGLE PIECE HOOP OR TWO PIECE ASSEMBLY WITH A U-STIRRUP WITH STANDARD 135 DEGREE HOOKS AND A TOP CROSS TIE CAP. SEE DETAIL 6/SSW1.1.
- SEE DETAILS FOR GRADE BEAM ANCHOR REINFORCEMENT PLACEMENT, INSTALLATION AND SPACING REQUIREMENTS. CLOSED TIE ANCHOR REINFORCEMENT QUANTITY IS PER WALL FOR THE 12" AND 15" WALL MODELS, AND PER ANCHOR FOR THE 18", 21" AND 24" MODELS.

SSWAB ANCHOR GRADE BEAM REINFORCEMENT AND DESIGN MOMENTS


5/SSW1.1

# Anchorage Details

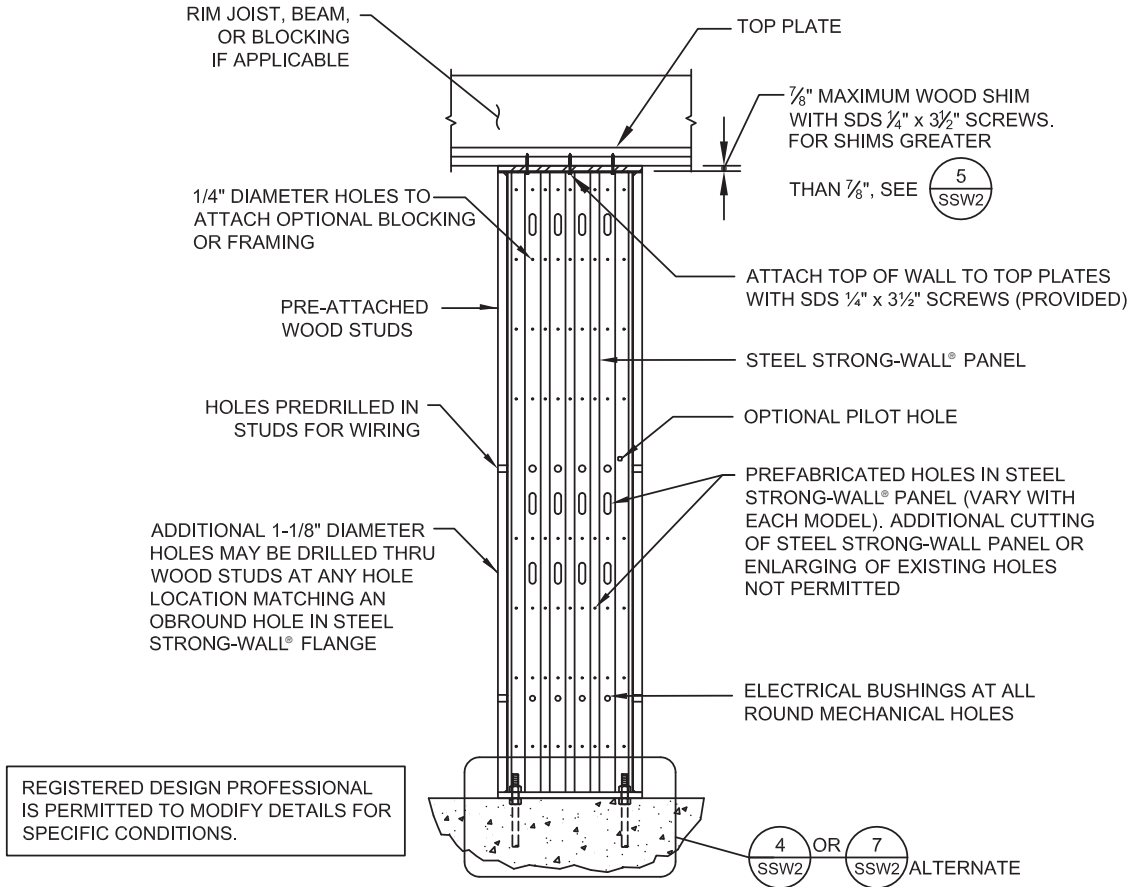

SINGLE-STORY STEEL STRONG-WALL® SHEARWALL ON CONCRETE

2/SSW2

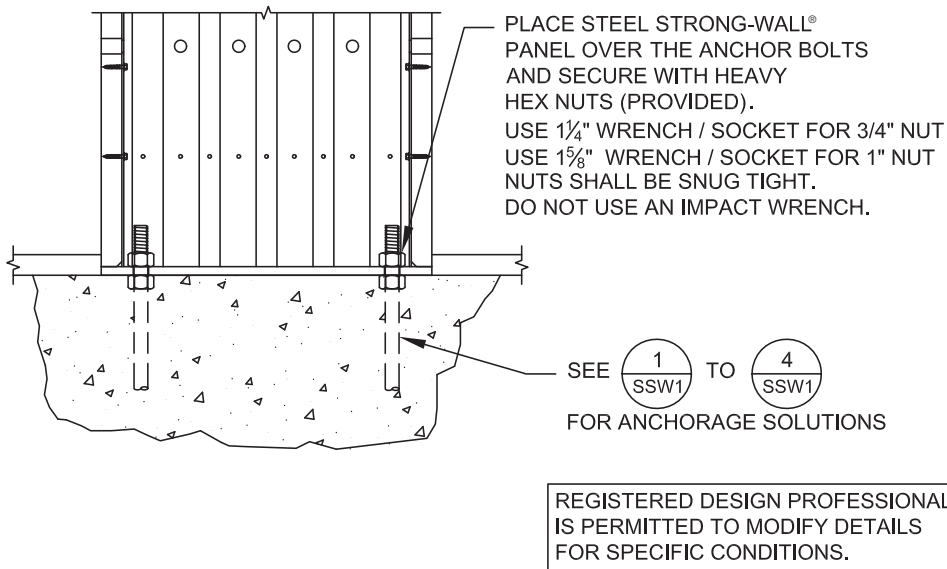

STEEL STRONG-WALL® SHEARWALL ON CONCRETE


4/SSW2

# Installation Details

## GARAGE HEADER ROUGH OPENING HEIGHT

MODEL No.	H CURB	ROUGH OPENING HEIGHT
SSW12x7	5½"	7' - 1½"
SSW15x7		
SSW18x7		
SSW21x7	6"	7' - 2"
SSW24x7		
SSW12x8	5½"	8' - 2¾"
SSW15x8		
SSW18x8		
SSW21x8	6"	8' - 3¼"
SSW24x8		

1. THE HEIGHT OF THE GARAGE CURB ABOVE THE GARAGE SLAB IS CRITICAL FOR THE ROUGH HEADER OPENING AT GARAGE RETURN WALLS.
2. SHIMS ARE NOT PROVIDED WITH STEEL STRONG-WALL® PANEL.
3. FURRING ON UNDERSIDE OF GARAGE HEADER MAY BE NECESSARY FOR LESSER ROUGH OPENING HEIGHTS.

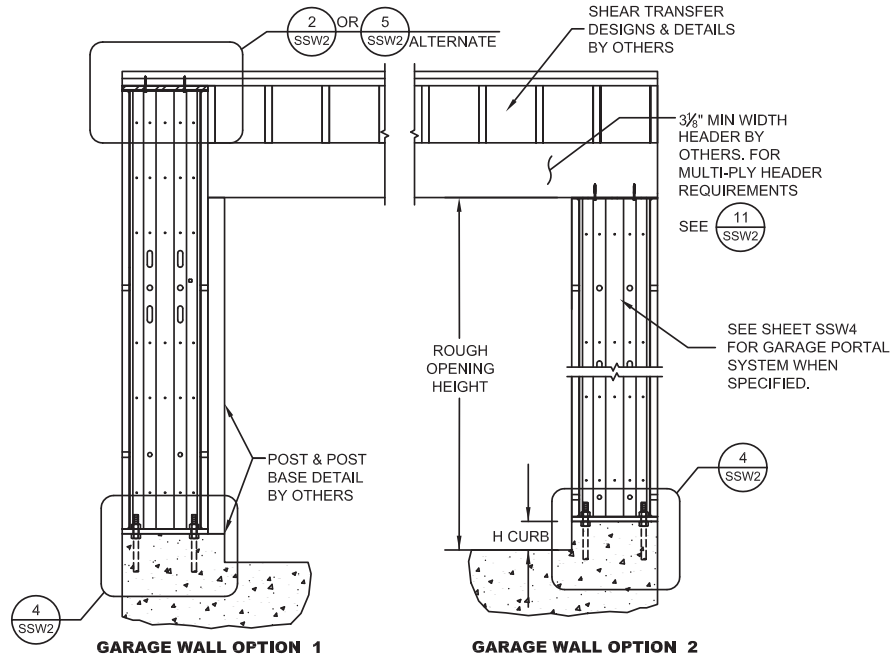

NOTE:  
7-FT. HIGH STEEL STRONG-WALL® MODELS ARE 80", 2" TALLER THAN 7-FT. HIGH WOOD STRONG-WALL® SHEARWALLS


### GARAGE WALL OPTION 2

#### FOR GARAGE WALL OPTION 2

REGISTERED DESIGN PROFESSIONAL SHALL DESIGN AND DETAIL FOR:  
1. SHEAR TRANSFER  
2. OUT OF PLANE LOADING EFFECT  
3. INCREASED OVERTURNING AND DRIFT DUE TO ADDITIONAL HEIGHT.

## ALTERNATE GARAGE WALL OPTIONS

3/SSW2

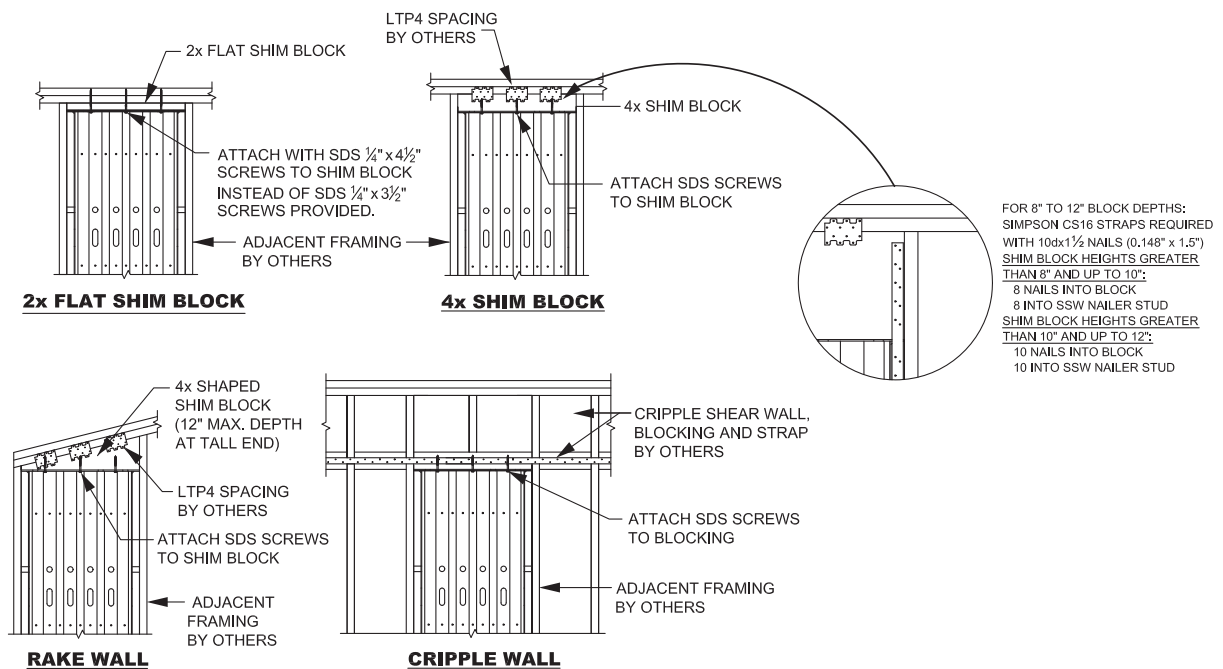


REGISTERED DESIGN PROFESSIONAL SHALL DESIGN FOR:  
1. SHEAR TRANSFER  
2. OUT OF PLANE LOADING EFFECT  
3. INCREASED OVERTURNING AND DRIFT DUE TO ADDITIONAL HEIGHT.

REGISTERED DESIGN PROFESSIONAL IS PERMITTED TO MODIFY DETAILS FOR SPECIFIC CONDITIONS.


## TOP OF WALL HEIGHT ADJUSTMENTS

5/SSW2

# Installation Details

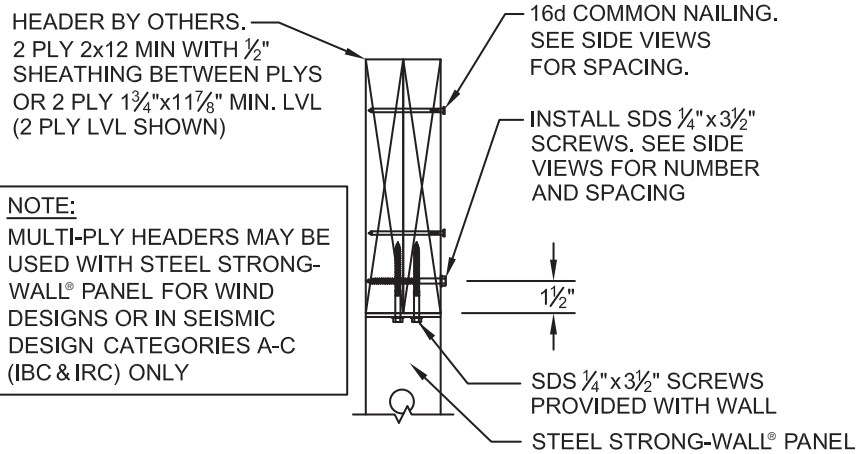

## SSW MULTI-PLY HEADER CROSS SECTION

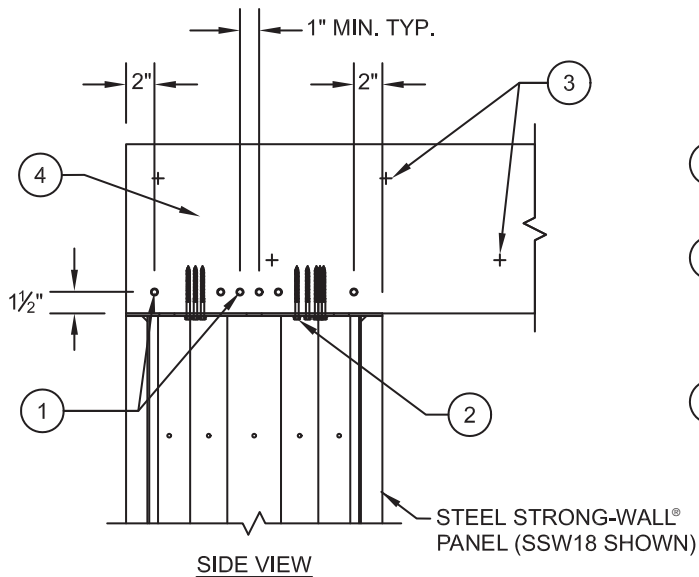


- 1 INSTALL SDS 1/4" x 3 1/2" SCREWS HORIZONTALLY THROUGH LVL OR 2x LUMBER HEADER PLIES. 4 SCREWS TOTAL FOR SSW12, 6 SCREWS TOTAL FOR SSW15, SSW18, SSW21 AND SSW24
- 2 SDS 1/4" x 3 1/2" SCREWS PROVIDED WITH WALL
- 3 FASTEN PLYS TOGETHER WITH 16d COMMON NAILS AT 16" O.C. ALONG EACH EDGE OF BEAM
- 4 1 5/32" SHEATHING BETWEEN 2x HEADER PLIES SHALL MATCH HEADER DEPTH AND EXTEND FULL WIDTH OF STEEL STRONG-WALL® PANEL, MINIMUM

## SSW WITH MULTI-PLY HEADER

REGISTERED DESIGN PROFESSIONAL IS PERMITTED TO MODIFY DETAILS FOR SPECIFIC CONDITIONS.




# Installation Details

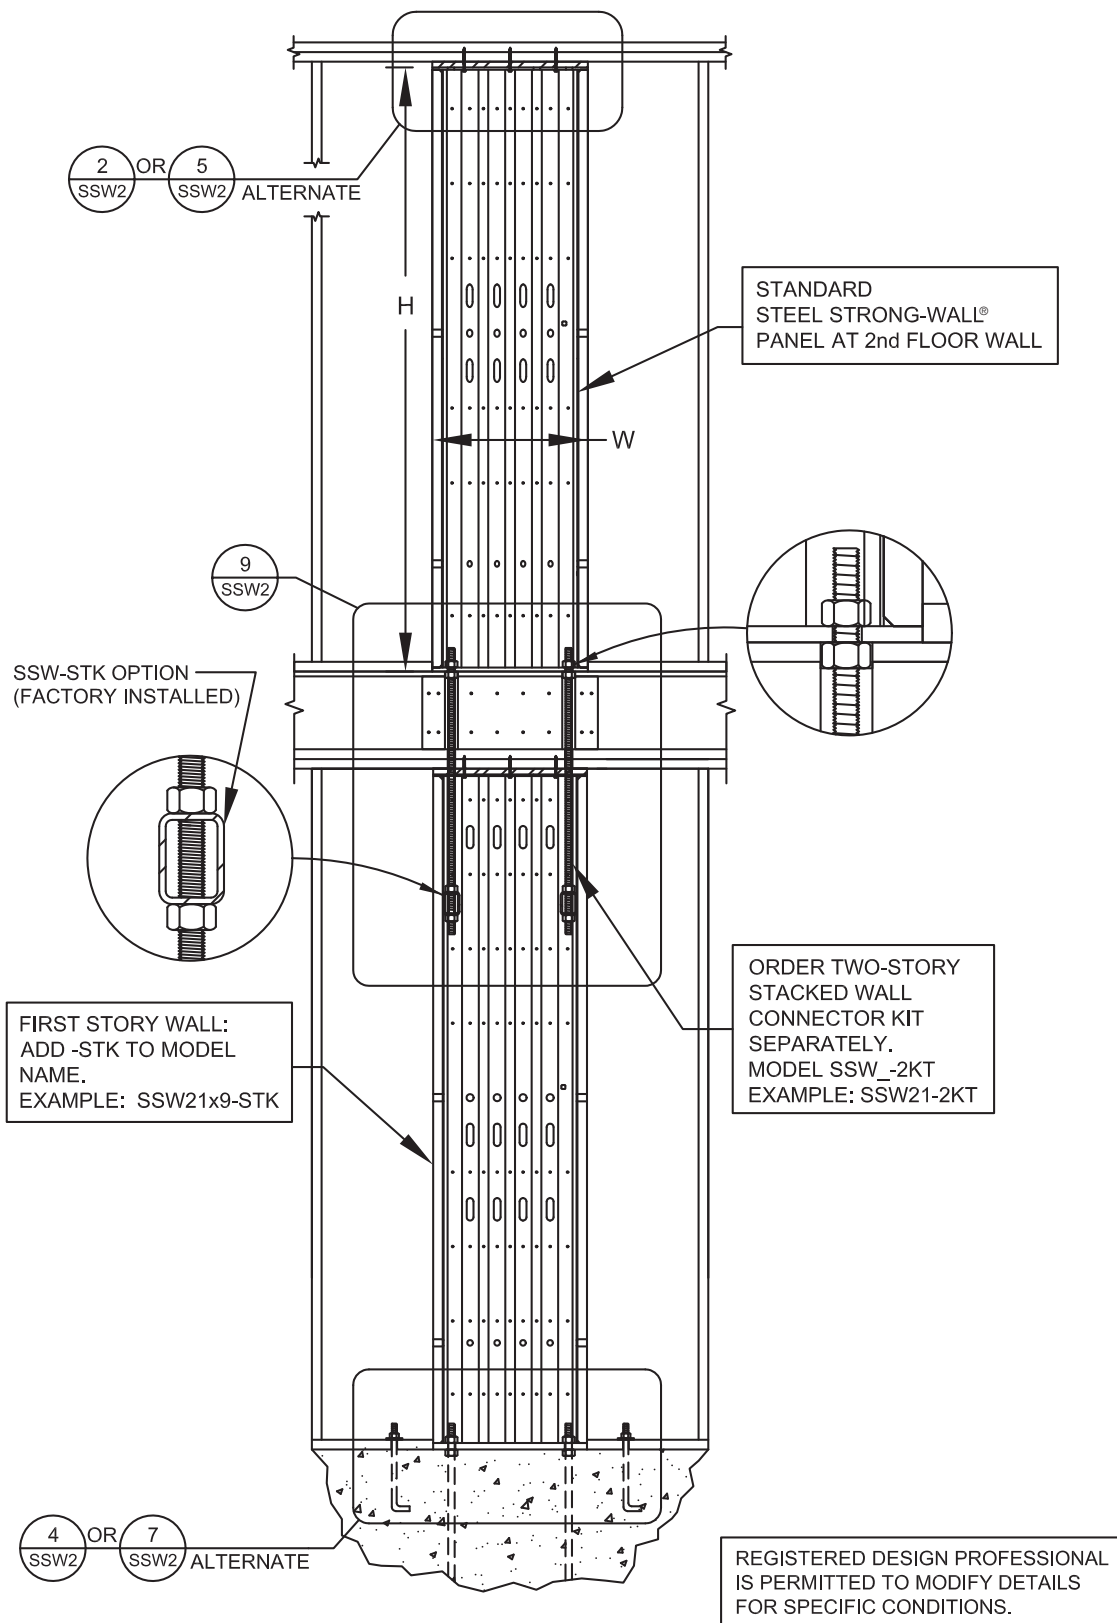

C-L-SW17 ©2017 SIMPSON STRONG-TIE COMPANY INC.


Anchorage and Installation Details

# Installation Details

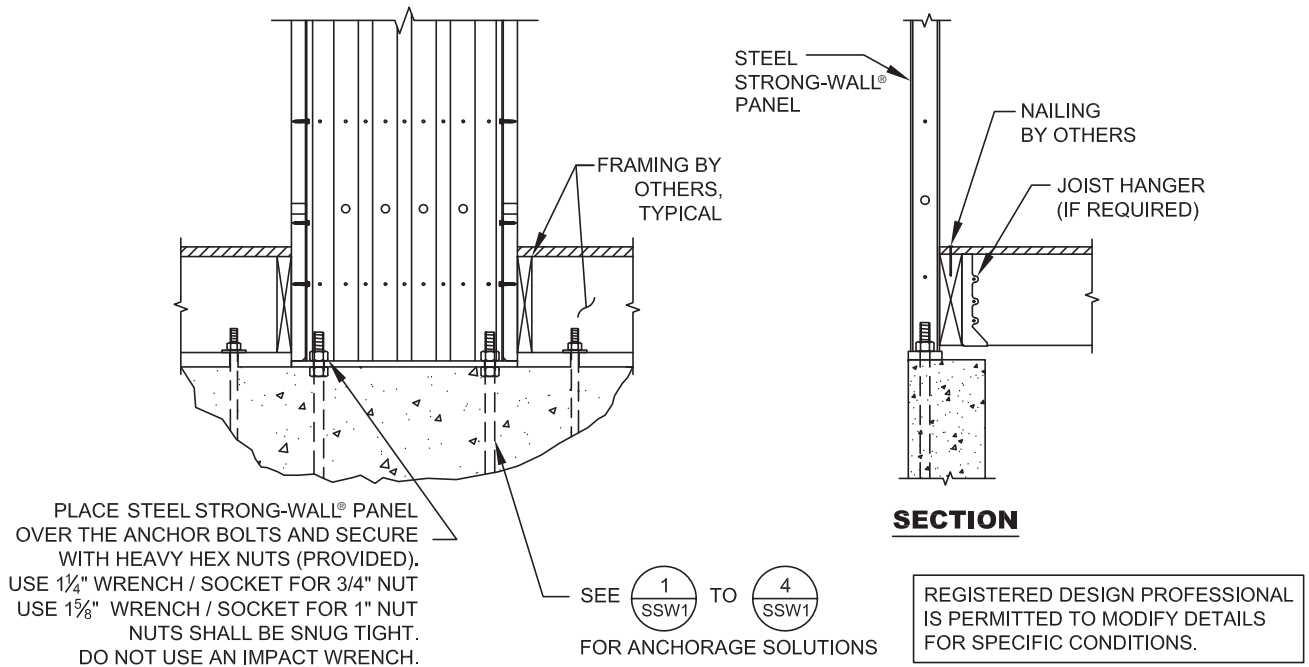

## ALTERNATE 1ST FLOOR WOOD FRAMING


7/SSW2

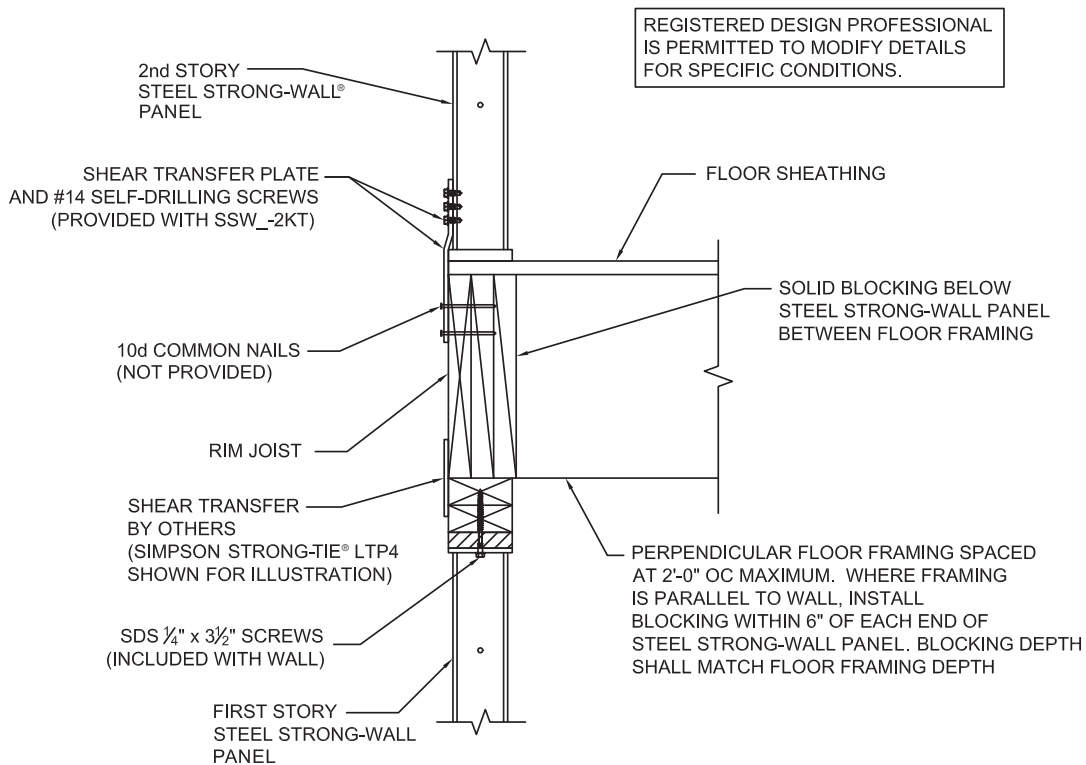


## TWO-STORY STACKED FLOOR SECTION

8/SSW2

# Installation Details

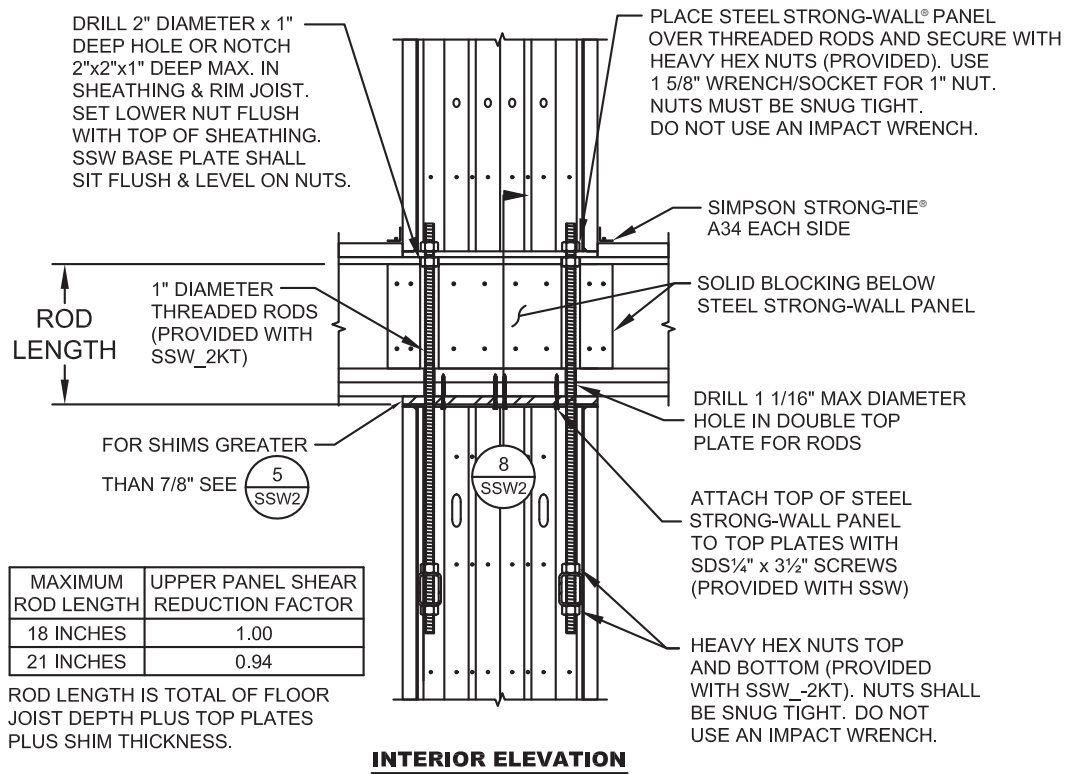


REGISTERED DESIGN PROFESSIONAL IS PERMITTED TO MODIFY DETAILS FOR SPECIFIC CONDITIONS.

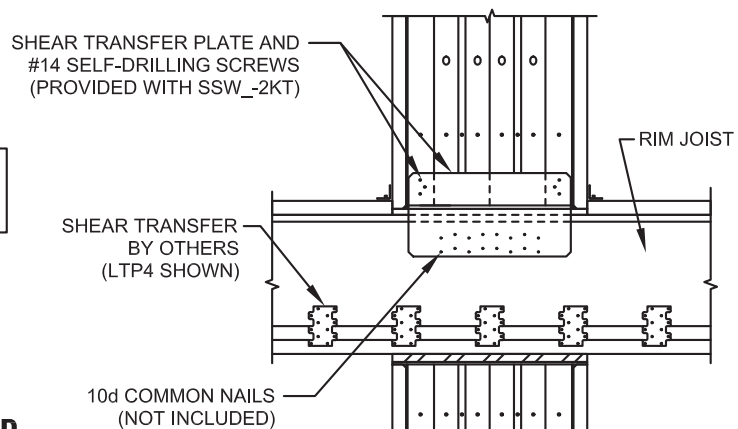

## TWO-STORY STACKED WALL CONNECTION KIT

WALL WIDTH (in)	MODEL NO.	CONTENTS
15	SSW15-2KT	EACH KIT CONTAINS: (1) SHEAR TRANSFER PLATE (with #14 SCREWS) (2) 1" x 48" THREADED RODS (ASTM A36) (6) HEAVY HEX NUTS INSTALLATION INSTRUCTIONS
18	SSW18-2KT	
21	SSW21-2KT	
24	SSW24-2KT	


# Installation Details

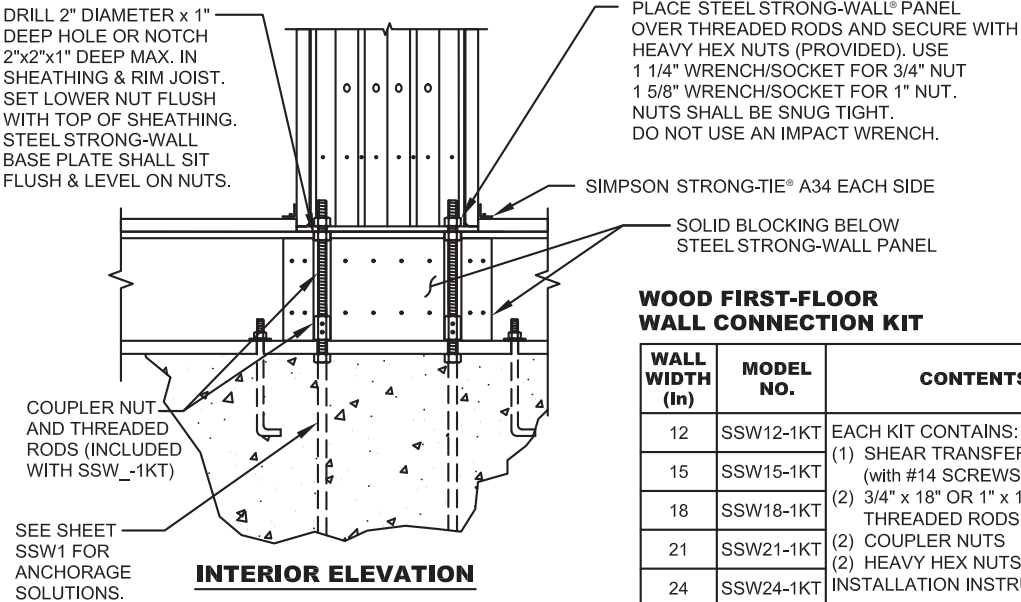



## WOOD FIRST-FLOOR WALL CONNECTION KIT

WALL WIDTH (In)	MODEL NO.	CONTENTS
12	SSW12-1KT	EACH KIT CONTAINS: (1) SHEAR TRANSFER PLATE (with #14 SCREWS) (2) 3/4" x 18" OR 1" x 18" THREADED RODS (ASTM A36) (2) COUPLER NUTS (2) HEAVY HEX NUTS INSTALLATION INSTRUCTIONS
15	SSW15-1KT	
18	SSW18-1KT	
21	SSW21-1KT	
24	SSW24-1KT	

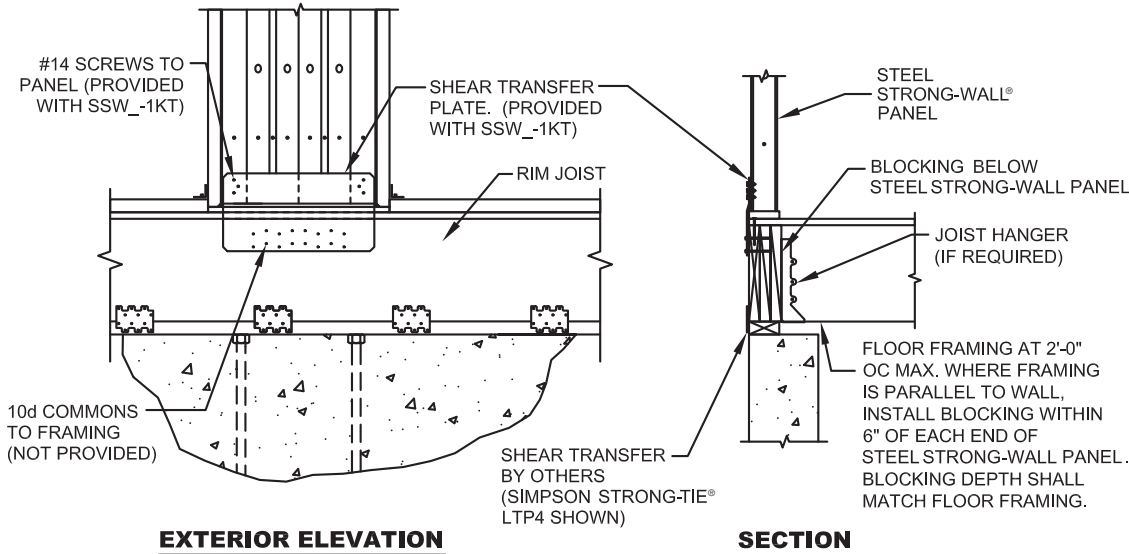ORDER FIRST FLOOR CONNECTOR KIT SEPARATELY. MODEL SSW\_-1KT . EXAMPLE: SSW21-1KT




### FIRST FLOOR AT WOOD FRAMING NOTES:

1. USE WOOD FIRST-FLOOR ALLOWABLE LOAD TABLES FOR THIS INSTALLATION.
2. USE ALTERNATE DETAIL  TO ACHIEVE MAXIMUM ON CONCRETE ALLOWABLE LOADS.
3. FOR TWO-STORY STACKED STEEL STRONG-WALLS WITH WOOD FIRST FLOOR, USE ALTERNATE DETAIL .
4. REGISTERED DESIGN PROFESSIONAL SHALL DESIGN FOR SHEAR TRANSFER FROM RIM JOIST TO SILL PLATE AND SILL PLATE TO FOUNDATION.

REGISTERED DESIGN PROFESSIONAL IS PERMITTED TO MODIFY DETAILS FOR SPECIFIC CONDITIONS.




# Installation Details

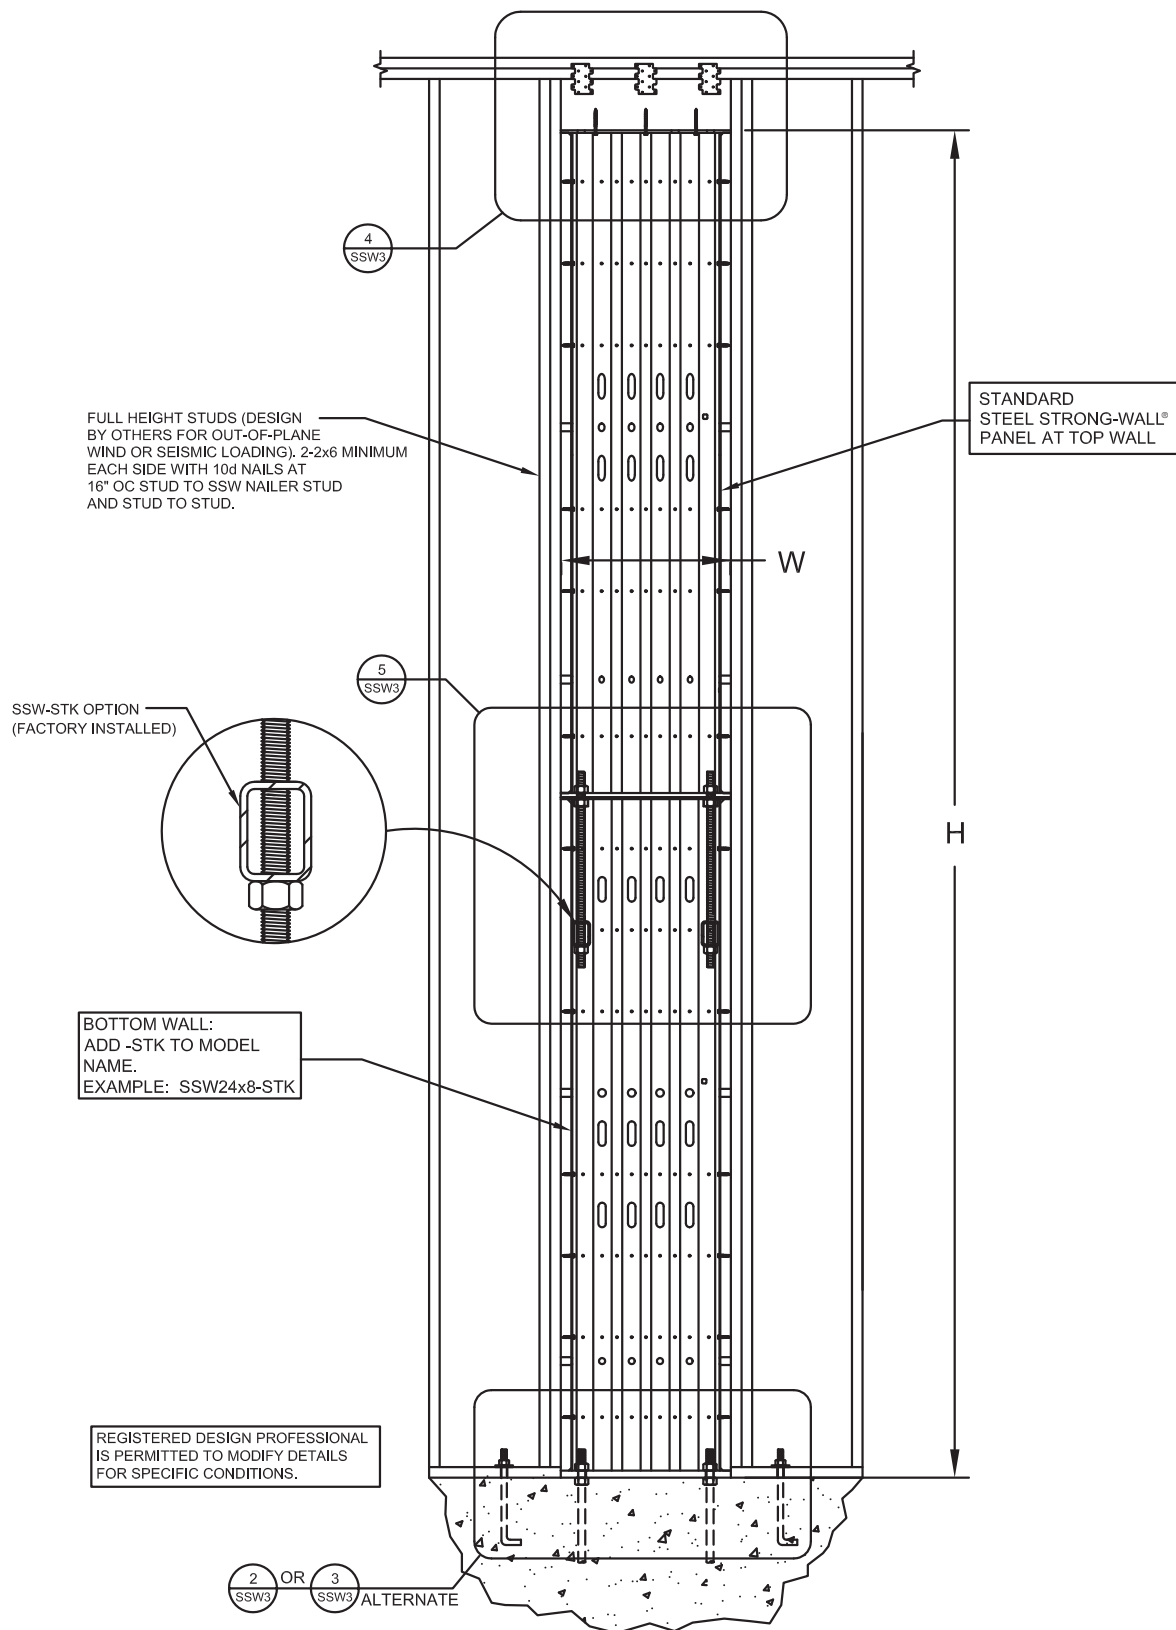

C-L-SW17 ©2017 SIMPSON STRONG-TIE COMPANY INC.


Anchorage and Installation Details

# Installation Details

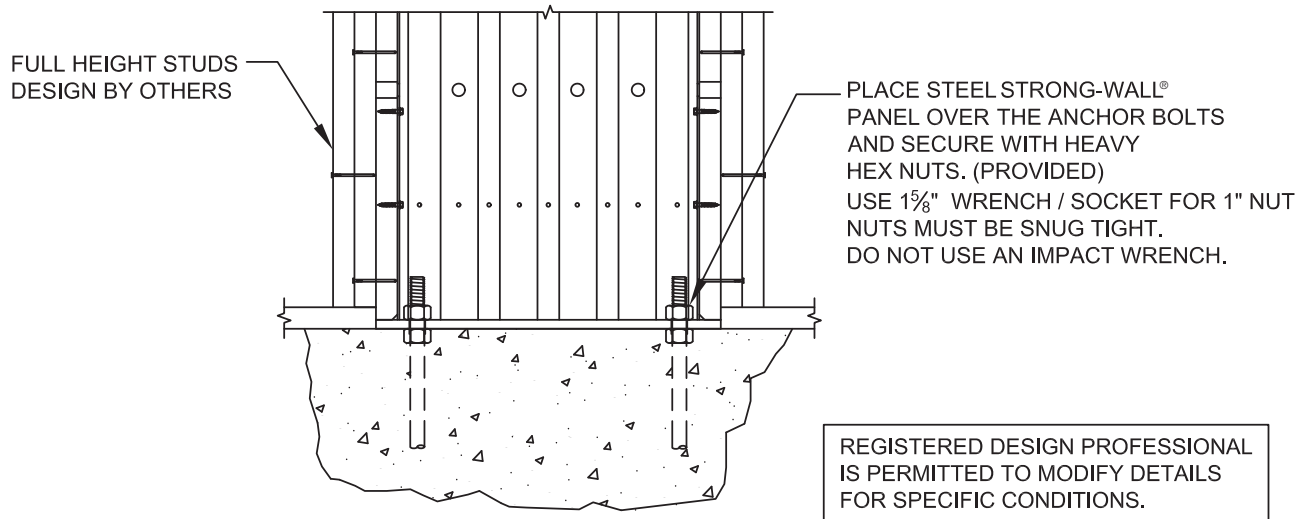

## BALLOON FRAMING BASE PLATE CONNECTION


2/SSW3

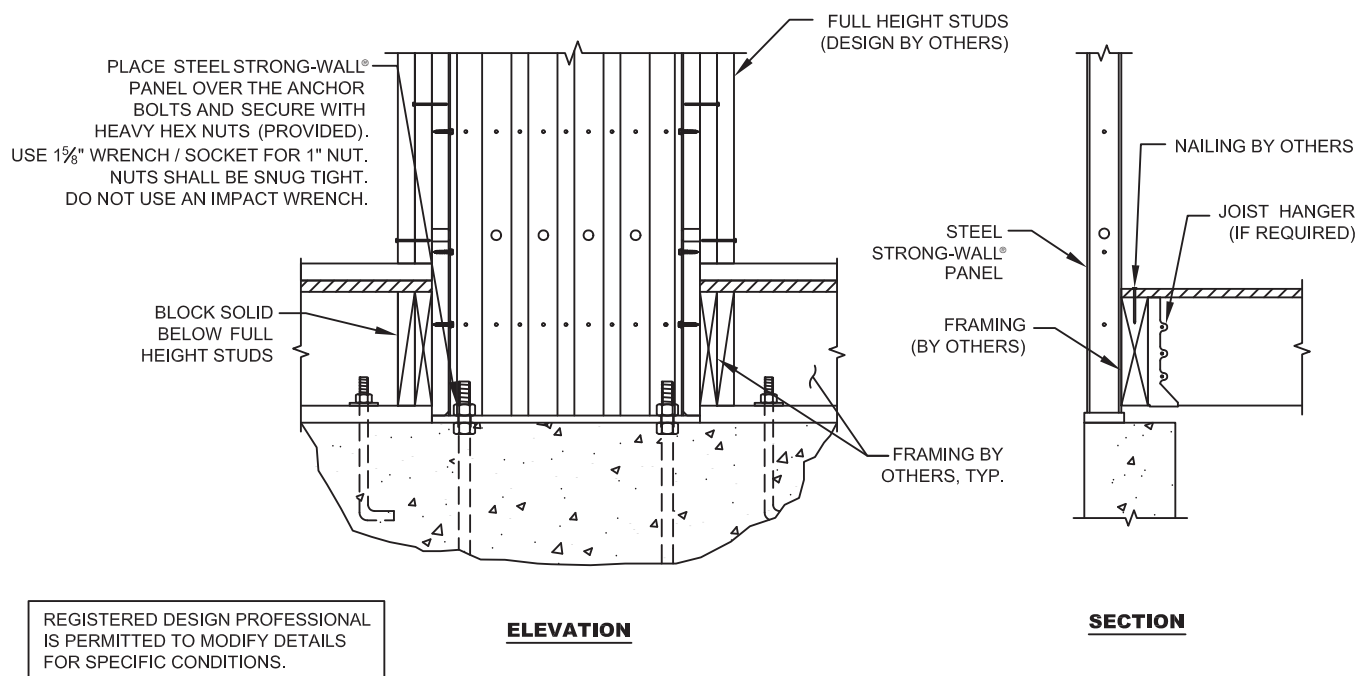

## BALLOON FRAMING AT WOOD FLOOR


3/SSW3

# Installation Details

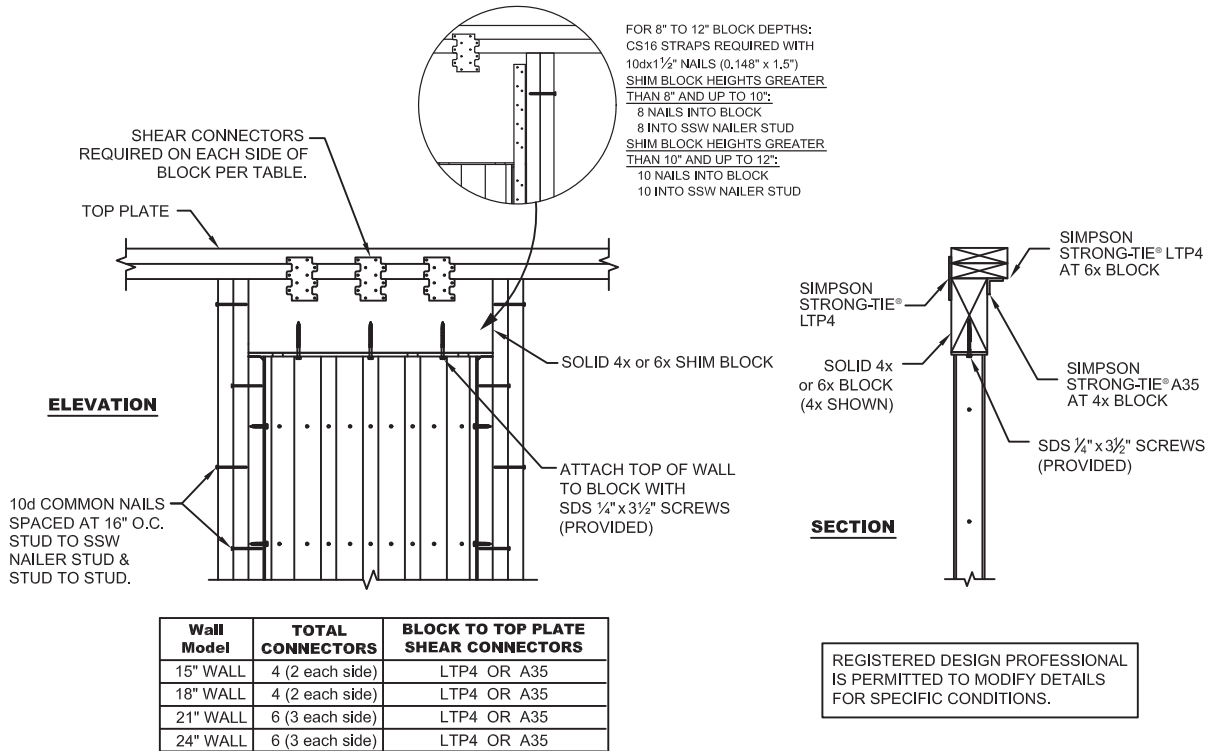

## BALLOON FRAMING TOP OF WALL CONNECTION


4/SSW3

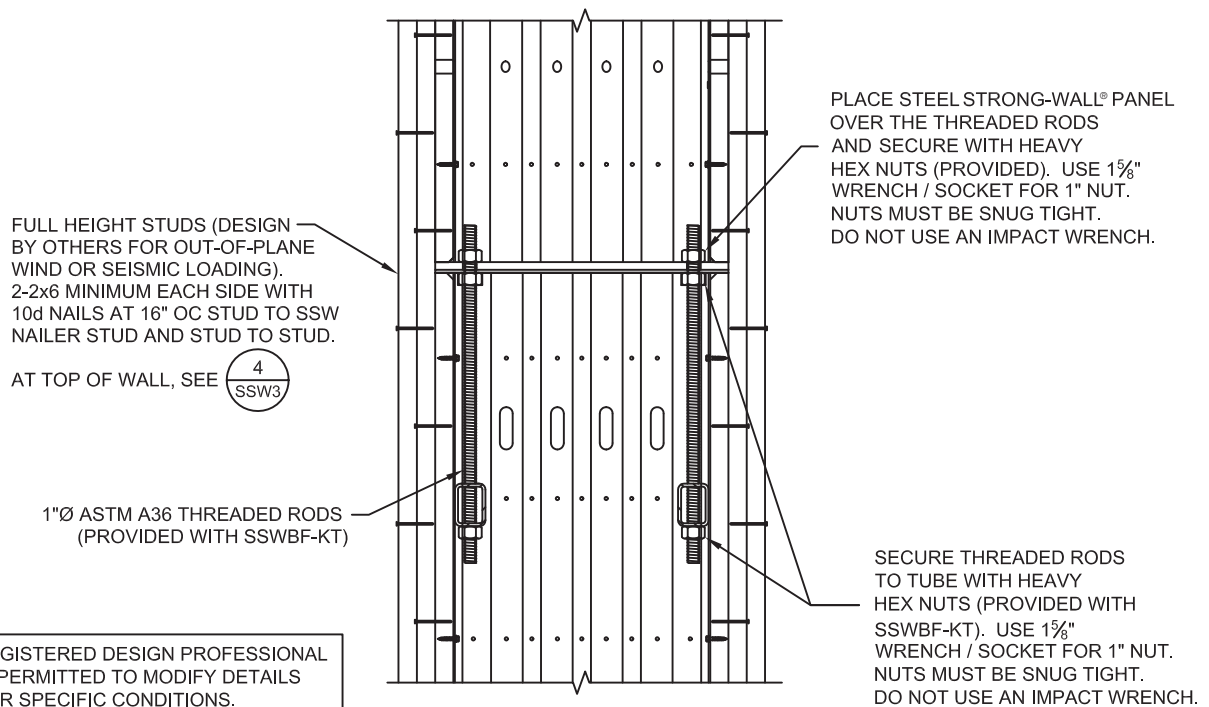

## BALLOON FRAMING WALL TO WALL CONNECTION


5/SSW3

# Installation Details

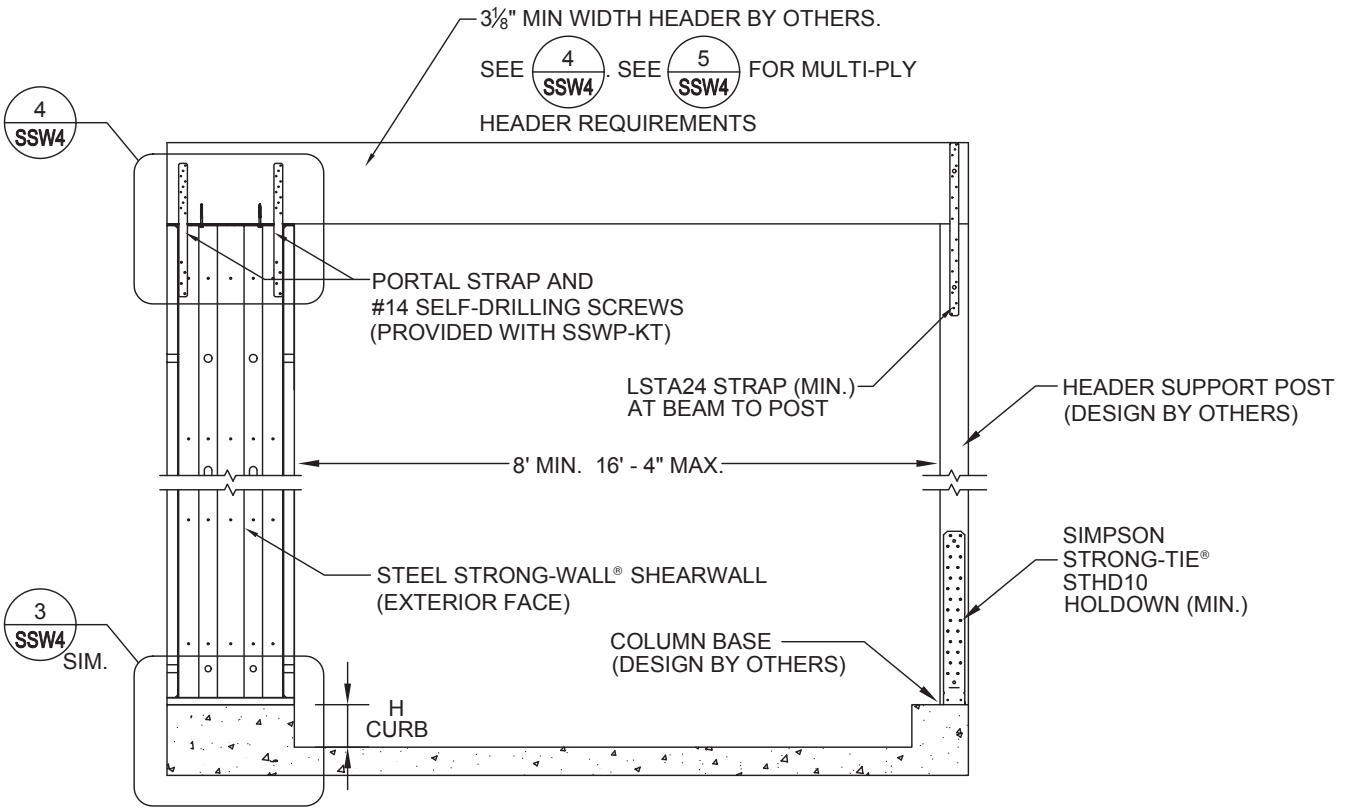

SINGLE PORTAL ASSEMBLY


1/SSW4

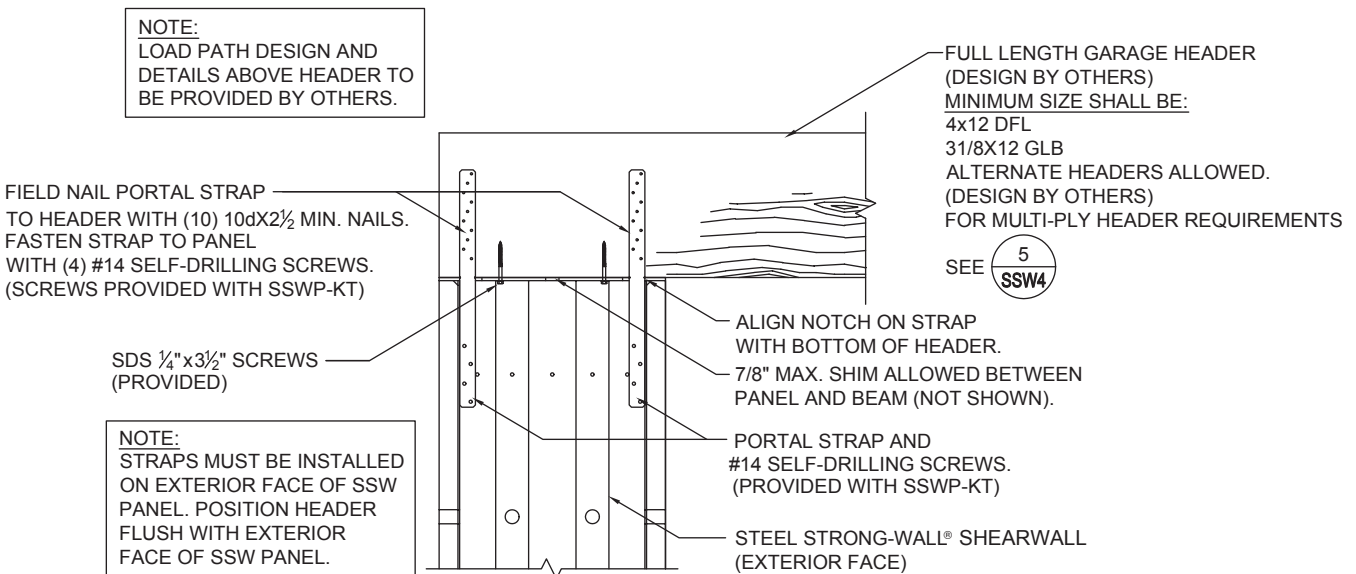


PORTAL TOP CONNECTION

4/SSW4

# Installation Details

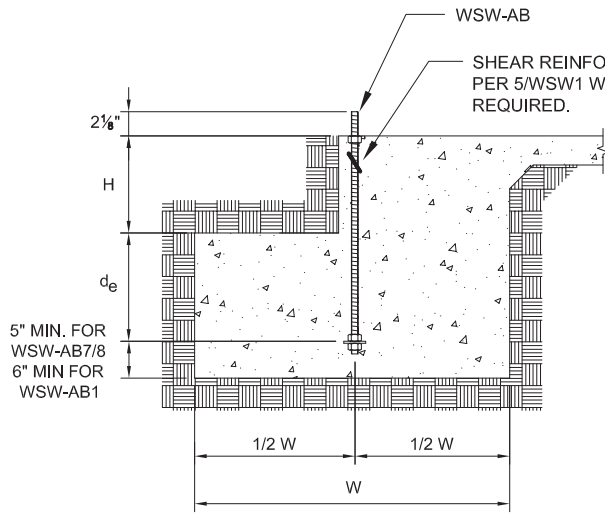


**SLAB ON GRADE FOUNDATION**

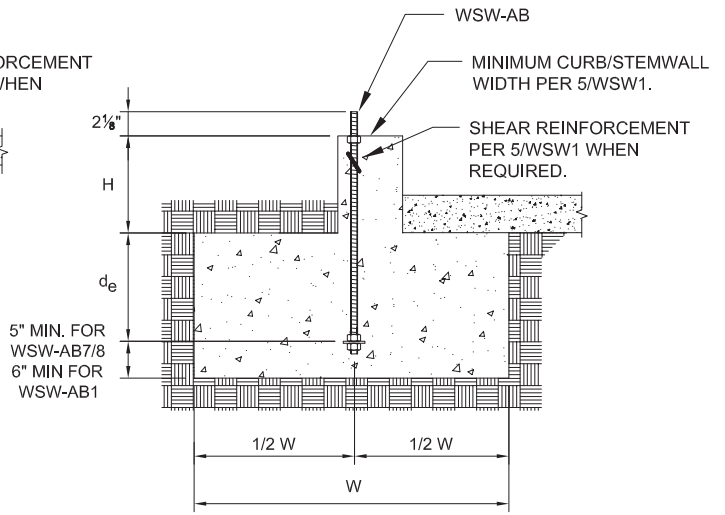


**CURB OR STEMWALL FOUNDATION**

REGISTERED DESIGN PROFESSIONAL  
IS PERMITTED TO MODIFY DETAILS  
FOR SPECIFIC CONDITIONS.

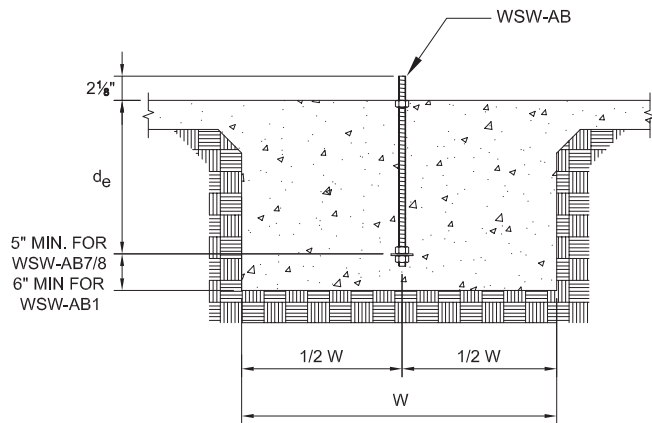

**INTERIOR FOUNDATION**

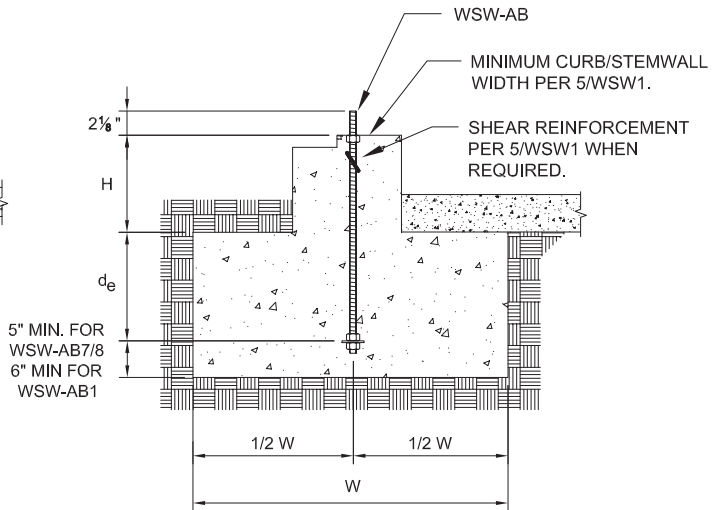


**BRICK LEDGE FOUNDATION**

**NOTES:**

1. SEE 2/WSW1 FOR DIMENSIONS AND ADDITIONAL NOTES.
2. SEE 5/WSW1 FOR SHEAR REINFORCEMENT WHEN REQUIRED.
3. MAXIMUM  $H = l_e - d_e$ . SEE 3/WSW1 AND 4/WSW1 FOR  $l_e$ .



# Installation Details

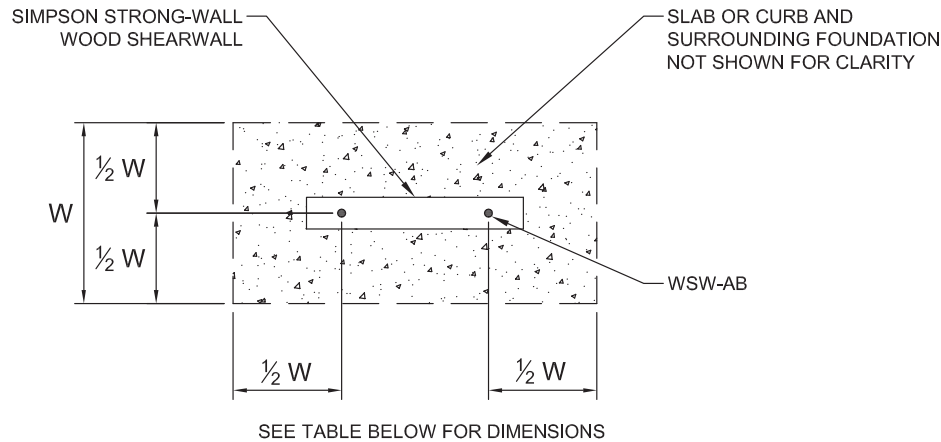

**FOUNDATION PLAN VIEW**

WSW ANCHORAGE SOLUTIONS FOR 2,500 PSI CONCRETE								
DESIGN CRITERIA	CONCRETE CONDITION	ANCHOR STRENGTH	WSW-AB7/8 ANCHOR BOLT			WSW-AB1 ANCHOR BOLT		
			ASD ALLOWABLE TENSION (lb.)	W (in.)	d <sub>e</sub> (in.)	ASD ALLOWABLE TENSION (lb.)	W (in.)	d <sub>e</sub> (in.)
SEISMIC	CRACKED	STANDARD	11,900	27	9	16,100	33	11
			13,100	29	10	17,100	35	12
		HIGH STRENGTH	24,900	43	15	33,000	51	17
			27,100	46	16	35,300	54	18
	UNCRAKED	STANDARD	12,500	24	8	15,700	28	10
			13,100	25	9	17,100	30	10
		HIGH STRENGTH	25,300	38	13	32,300	44	15
			27,100	40	14	35,300	47	16
WIND	CRACKED	STANDARD	5,100	14	6	6,200	16	6
			8,700	20	7	11,400	24	8
			13,100	27	9	17,100	32	11
		HIGH STRENGTH	15,900	30	10	21,100	36	12
			18,400	33	11	27,300	42	14
			23,100	38	13	31,800	46	16
			27,100	42	14	35,300	50	17
	UNCRAKED	STANDARD	5,000	12	6	6,400	14	6
			9,300	18	6	12,500	22	8
			13,100	23	8	17,100	28	10
		HIGH STRENGTH	15,200	25	9	21,900	32	11
			19,900	30	10	26,400	36	12
			24,000	34	12	31,500	40	14
			27,100	37	13	35,300	43	15

**NOTES:**

- ANCHORAGE DESIGNS CONFORM TO ACI 318-11 APPENDIX D AND ACI 318-14 WITH NO SUPPLEMENTARY REINFORCEMENT FOR CRACKED OR UNCRACKED CONCRETE AS NOTED.
- ANCHOR STRENGTH INDICATES REQUIRED GRADE OF WSW-AB ANCHOR BOLT. STANDARD (ASTM F1554 GRADE 36) OR HIGH STRENGTH (HS) (ASTM A449).
- SEISMIC INDICATES SEISMIC DESIGN CATEGORY C - F. DETACHED 1 AND 2 FAMILY DWELLINGS IN SDC C MAY USE WIND ANCHORAGE SOLUTIONS. SEISMIC ANCHORAGE DESIGNS CONFORM TO ACI 318-11 SECTION D.3.3.4.3 AND ACI 318-14 SECTION 17.2.3.4.3.
- WIND INCLUDES SEISMIC DESIGN CATEGORY A AND B AND DETACHED 1 AND 2 FAMILY DWELLINGS IN SDC C.
- FOUNDATION DIMENSIONS ARE FOR ANCHORAGE ONLY. FOUNDATION DESIGN (SIZE AND REINFORCEMENT) BY OTHERS. THE REGISTERED DESIGN PROFESSIONAL MAY SPECIFY ALTERNATE EMBEDMENT, FOOTING SIZE OR ANCHOR BOLT.
- REFER TO 1/WSW1 FOR d<sub>e</sub>.

# Installation Details


WSW ANCHORAGE SOLUTIONS FOR 3,000 PSI CONCRETE								
DESIGN CRITERIA	CONCRETE CONDITION	ANCHOR STRENGTH	WSW-AB7/8 ANCHOR BOLT			WSW-AB1 ANCHOR BOLT		
			ASD ALLOWABLE TENSION (lb.)	W (in.)	d <sub>e</sub> (in.)	ASD ALLOWABLE TENSION (lb.)	W (in.)	d <sub>e</sub> (in.)
SEISMIC	CRACKED	STANDARD	12,300	26	9	16,000	31	11
			13,100	28	10	17,100	33	11
		HIGH STRENGTH	25,200	41	14	32,700	48	16
			27,100	43	15	35,300	51	17
	UNCRAKED	STANDARD	12,000	22	8	16,300	27	9
			13,100	24	8	17,100	28	10
		HIGH STRENGTH	25,300	36	12	32,700	42	14
			27,100	38	13	35,300	44	15
WIND	CRACKED	STANDARD	5,000	13	6	5,600	14	6
			8,800	19	7	10,200	21	7
			13,100	25	9	17,100	30	10
		HIGH STRENGTH	15,700	28	10	20,100	33	11
			19,200	32	11	25,300	38	13
			23,200	36	12	32,300	44	15
			27,100	40	14	35,300	47	16
			27,100	40	14	35,300	47	16
	UNCRAKED	STANDARD	5,500	12	6	6,200	13	6
			8,500	16	6	12,800	21	7
			13,100	22	8	17,100	26	9
		HIGH STRENGTH	16,600	25	9	21,800	30	10
			19,700	28	10	25,200	33	11
			24,000	32	11	31,700	38	13
			27,100	35	12	35,300	41	14
			27,100	35	12	35,300	41	14

WSW ANCHORAGE SOLUTIONS FOR 4,500 PSI CONCRETE								
DESIGN CRITERIA	CONCRETE CONDITION	ANCHOR STRENGTH	WSW-AB7/8 ANCHOR BOLT			WSW-AB1 ANCHOR BOLT		
			ASD ALLOWABLE TENSION (lb.)	W (in.)	d <sub>e</sub> (in.)	ASD ALLOWABLE TENSION (lb.)	W (in.)	d <sub>e</sub> (in.)
SEISMIC	CRACKED	STANDARD	12,600	23	8	16,000	27	9
			13,100	24	8	17,100	29	10
		HIGH STRENGTH	24,800	36	12	32,100	42	14
			27,100	38	13	35,300	45	15
	UNCRAKED	STANDARD	12,700	20	7	15,700	23	8
			13,100	21	7	17,100	25	9
		HIGH STRENGTH	24,600	31	11	32,500	37	13
			27,100	34	12	35,300	39	13
WIND	CRACKED	STANDARD	5,400	12	6	6,800	14	6
			8,300	16	6	11,600	20	7
			13,100	22	8	17,100	26	9
		HIGH STRENGTH	15,300	24	8	21,400	30	10
			19,300	28	10	25,800	34	12
			23,600	32	11	31,000	38	13
			27,100	36	12	35,300	42	14
			27,100	36	12	35,300	42	14
	UNCRAKED	STANDARD	6,800	12	6	6,800	12	6
			9,400	15	6	12,400	18	6
			13,100	19	7	17,100	23	8
		HIGH STRENGTH	16,800	22	8	21,600	26	9
			20,300	25	9	26,700	30	10
			24,100	28	10	32,200	34	12
			27,100	31	11	35,300	36	12
			27,100	31	11	35,300	36	12


## NOTES:

- ANCHORAGE DESIGNS CONFORM TO ACI 318-11 APPENDIX D AND ACI 318-14 WITH NO SUPPLEMENTARY REINFORCEMENT FOR CRACKED OR UNCRACKED CONCRETE AS NOTED.
- ANCHOR STRENGTH INDICATES REQUIRED GRADE OF WSW-AB ANCHOR BOLT. STANDARD (ASTM F1554 GRADE 36) OR HIGH STRENGTH (HS) (ASTM A449).
- SEISMIC INDICATES SEISMIC DESIGN CATEGORY C - F. DETACHED 1 AND 2 FAMILY DWELLINGS IN SDC C MAY USE WIND ANCHORAGE SOLUTIONS. SEISMIC ANCHORAGE DESIGNS CONFORM TO ACI 318-11 SECTION D.3.3.4.3 AND ACI 318-14 SECTION 17.2.3.4.3.
- WIND INCLUDES SEISMIC DESIGN CATEGORY A AND B AND DETACHED 1 AND 2 FAMILY DWELLINGS IN SDC C.
- FOUNDATION DIMENSIONS ARE FOR ANCHORAGE ONLY. FOUNDATION DESIGN (SIZE AND REINFORCEMENT) BY OTHERS. THE REGISTERED DESIGN PROFESSIONAL MAY SPECIFY ALTERNATE EMBEDMENT, FOOTING SIZE OR ANCHOR BOLT.
- REFER TO 1/WSW1 FOR d<sub>e</sub>.


# Installation Details

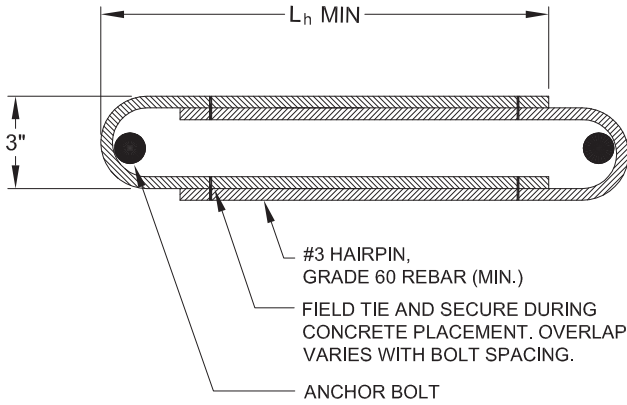


**HAIRPIN SHEAR REINFORCEMENT**

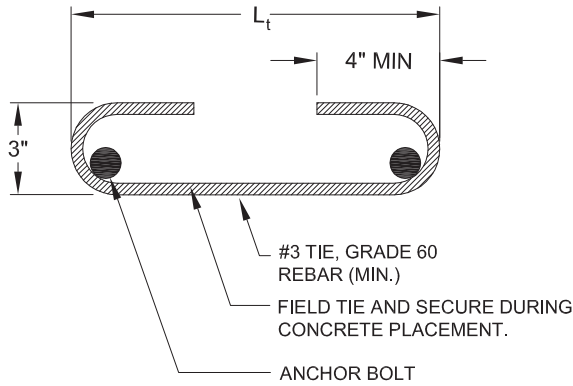

**TIE SHEAR REINFORCEMENT**

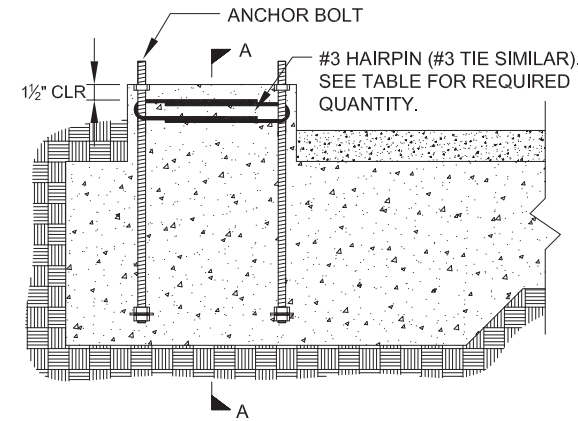

**HAIRPIN INSTALLATION**  
(GARAGE CURB SHOWN. OTHER FOOTING TYPES SIMILAR.)

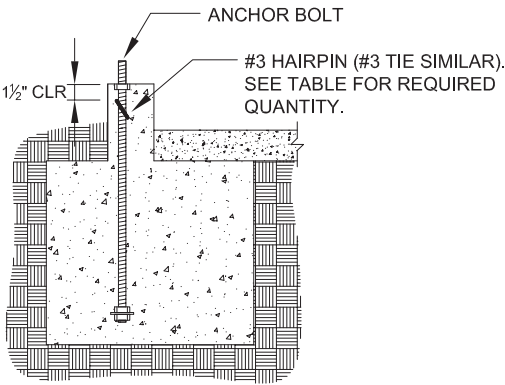


**SECTION A-A**

REGISTERED DESIGN PROFESSIONAL  
IS PERMITTED TO MODIFY DETAILS  
FOR SPECIFIC CONDITIONS.

STRONG-WALL® WOOD SHEARWALL SHEAR ANCHORAGE							
MODEL	L <sub>t</sub> OR L <sub>h</sub> (in.)	SEISMIC <sup>3</sup>		WIND <sup>4</sup>			
		SHEAR REINFORCEMENT	MINIMUM CURB/ STEMWALL WIDTH (in.)	SHEAR REINFORCEMENT	MINIMUM CURB/ STEMWALL WIDTH (in.)	ASD ALLOWABLE SHEAR LOAD, V (lb.) <sup>6</sup>	
						UNCRACKED	CRACKED
WSW12	10 1/4	(1) #3 HAIRPIN	8 <sup>5</sup>	SEE NOTE 6	6	1035	740
WSW18	15	(1) #3 HAIRPIN	8 <sup>5</sup>	(1) #3 HAIRPIN	6	HAIRPIN REINFORCEMENT ACHIEVES MAXIMUM ALLOWABLE SHEAR LOAD OF THE WSW	
WSW24	19	(2) #3 HAIRPINS	8 <sup>5</sup>	(1) #3 HAIRPIN	6		


- NOTES:
1. SHEAR ANCHORAGE DESIGNS CONFORM TO ACI 318-11 AND ACI 318-14 AND ASSUME MINIMUM 2,500 PSI CONCRETE.
  2. SHEAR REINFORCEMENT IS NOT REQUIRED FOR INTERIOR FOUNDATION APPLICATIONS (PANEL INSTALLED AWAY FROM EDGE OF CONCRETE), OR BRACED WALL PANEL APPLICATIONS.
  3. SEISMIC INDICATES SEISMIC DESIGN CATEGORY C THROUGH F. DETACHED 1 AND 2 FAMILY DWELLINGS IN SDC C MAY USE WIND ANCHORAGE SOLUTIONS.
  4. WIND INCLUDES SEISMIC DESIGN CATEGORY A AND B AND DETACHED 1 AND 2 FAMILY DWELLINGS IN SDC C.
  5. WHERE NOTED, MINIMUM CURB/STEMWALL WIDTH IS 6 INCHES WHEN STANDARD STRENGTH ANCHOR BOLT IS USED.
  6. USE (1) #3 TIE FOR WSW12 WHEN PANEL DESIGN SHEAR FORCE EXCEEDS TABULATED ANCHORAGE ALLOWABLE SHEAR LOAD.
  7. #4 GRADE 40 SHEAR REINFORCEMENT MAY BE SUBSTITUTED FOR WSW SHEAR ANCHORAGE SOLUTIONS.

# Installation Details

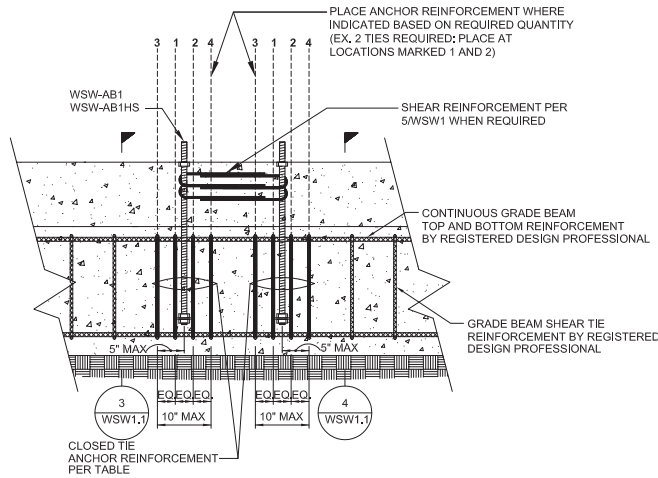


**GRADE BEAM ELEVATION AT 24" WALL MODEL**

1/WSW1.1

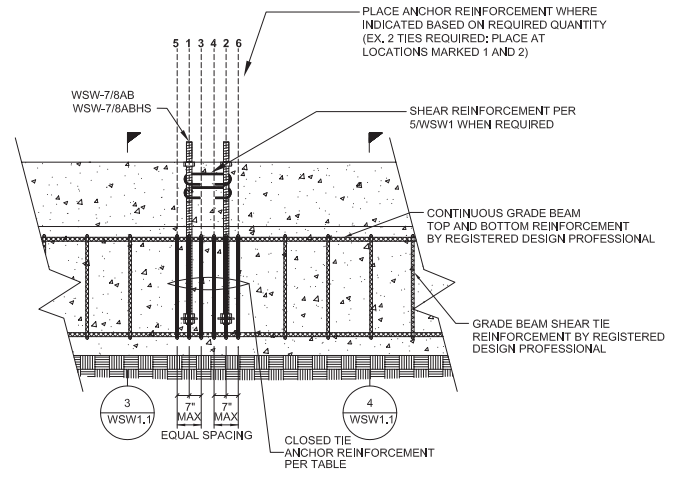


**GRADE BEAM ELEVATION AT 12" AND 18" WALL MODELS**

2/WSW1.1

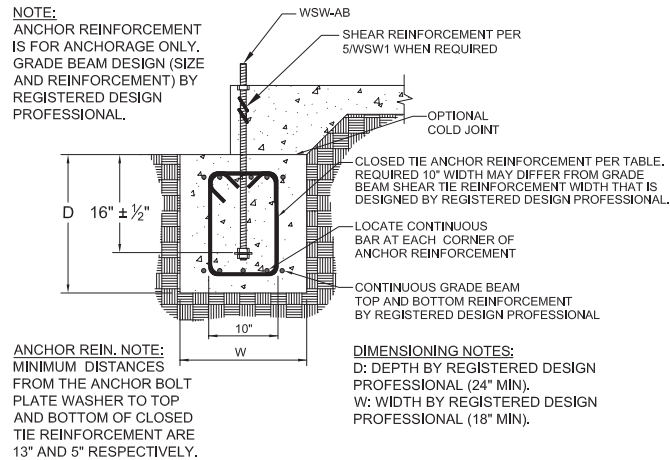

**GRADE BEAM SECTION AT ANCHOR REINFORCEMENT**

3/WSW1.1

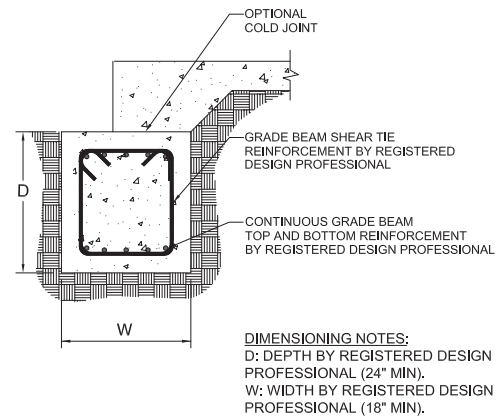

**GRADE BEAM SECTION AWAY FROM ANCHOR REINFORCEMENT**

4/WSW1.1

WSW GRADE BEAM ANCHOR REINFORCEMENT						
STRONG-WALL WOOD SHEARWALL WIDTH (in.)	ANCHOR MODEL NO.	ANCHOR DIAMETER (in.)	ANCHOR REINFORCEMENT FOR WIND AND SEISMIC <sup>3,8,9</sup>		AMPLIFIED LRFD APPLIED DESIGN SEISMIC MOMENT (ft.-lbs.) <sup>4,5,6,7</sup>	
			STANDARD STRENGTH WSW-AB	HIGH STRENGTH (HS) WSW-AB	STANDARD STRENGTH WSW-AB	HIGH STRENGTH (HS) WSW-AB
12" MODEL	WSW-AB7/8 WSW-AB7/8HS	7/8	4- #4 CLOSED TIES PER $\frac{2}{WSW1.1}$	6- #4 CLOSED TIES PER $\frac{2}{WSW1.1}$	24,700	24,700
18" MODEL					44,100	50,600
24" MODEL	WSW-AB1 WSW-AB1HS	1	2- #4 CLOSED TIES PER $\frac{1}{WSW1.1}$	4- #4 CLOSED TIES PER $\frac{1}{WSW1.1}$	75,600	93,600


**NOTES:**

- ANCHOR REINFORCEMENT CONFORMS TO ACI 318-14 SECTION 17.4.2.9 AND ACI 318-11 SECTION D.5.2.9. FULL-SCALE TESTING WAS USED TO VALIDATE ANCHOR REINFORCEMENT CONFIGURATION AND PLACEMENT.
- MINIMUM CONCRETE COMPRESSIVE STRENGTH,  $f_c = 2500$  psi.
- CLOSED TIE ANCHOR REINFORCEMENT TO BE ASTM A615 GRADE 60 (MIN) #4 REBAR.
- GRADE BEAM LONGITUDINAL AND TIE REINFORCEMENT SHALL BE SPECIFIED BY THE REGISTERED DESIGN PROFESSIONAL FOR FLEXURE AND SHEAR LOADING. DESIGN SHOULD CONSIDER PROJECT SPECIFIC DESIGN LOADS AND ALLOWABLE SOIL PRESSURE.
- SIMPSON STRONG-TIE RECOMMENDS USING THE TABULATED MINIMUM AMPLIFIED LRFD APPLIED SEISMIC DESIGN MOMENT TO ENSURE GRADE BEAM DESIGN FLEXURE AND SHEAR STRENGTH ARE ADEQUATE TO PREVENT PLASTIC HINGE FORMATION UNDER DEMANDS ASSOCIATED WITH ANCHORAGE FORCES CORRESPONDING TO ACI 318-14 SECTION 17.2.3.4.3 AND ACI 318-11 SECTION D.3.3.4.3.
- DESIGNER MAY USE REDUCED MOMENT DUE TO APPLIED WSW LATERAL LOAD. MINIMUM MOMENT SHALL BE THE LESSER OF THE TABULATED MOMENT OR THE AMPLIFIED LRFD DESIGN MOMENT FOR SEISMIC: (ASD DESIGN DEMAND SHEAR/0.7) x  $D_o$  x WSW WALL HEIGHT FOR GRADE BEAM DESIGN.
- MINIMUM GRADE BEAM DESIGN MOMENT FOR WIND AND SEISMIC IN SEISMIC DESIGN CATEGORY A AND B AND DETACHED 1 AND 2 FAMILY DWELLINGS IN SDC C: (ASD DESIGN DEMAND SHEAR/0.6) x WSW WALL HEIGHT.
- CLOSED TIE MAY BE SINGLE PIECE HOOP OR TWO PIECE ASSEMBLY WITH A U-STIRRUP WITH STANDARD 135 DEGREE HOOKS AND A TOP CROSS TIE CAP. SEE DETAIL 6/WSW1.1.
- SEE DETAILS FOR GRADE BEAM ANCHOR REINFORCEMENT PLACEMENT, INSTALLATION AND SPACING REQUIREMENTS. CLOSED TIE ANCHOR REINFORCEMENT QUANTITY IS PER WALL FOR THE 12" AND 18" WALL MODELS, AND PER ANCHOR FOR THE 24" MODEL.

**WSW-AB ANCHOR GRADE BEAM REINFORCEMENT AND DESIGN MOMENTS**

5/WSW1.1

# Installation Details

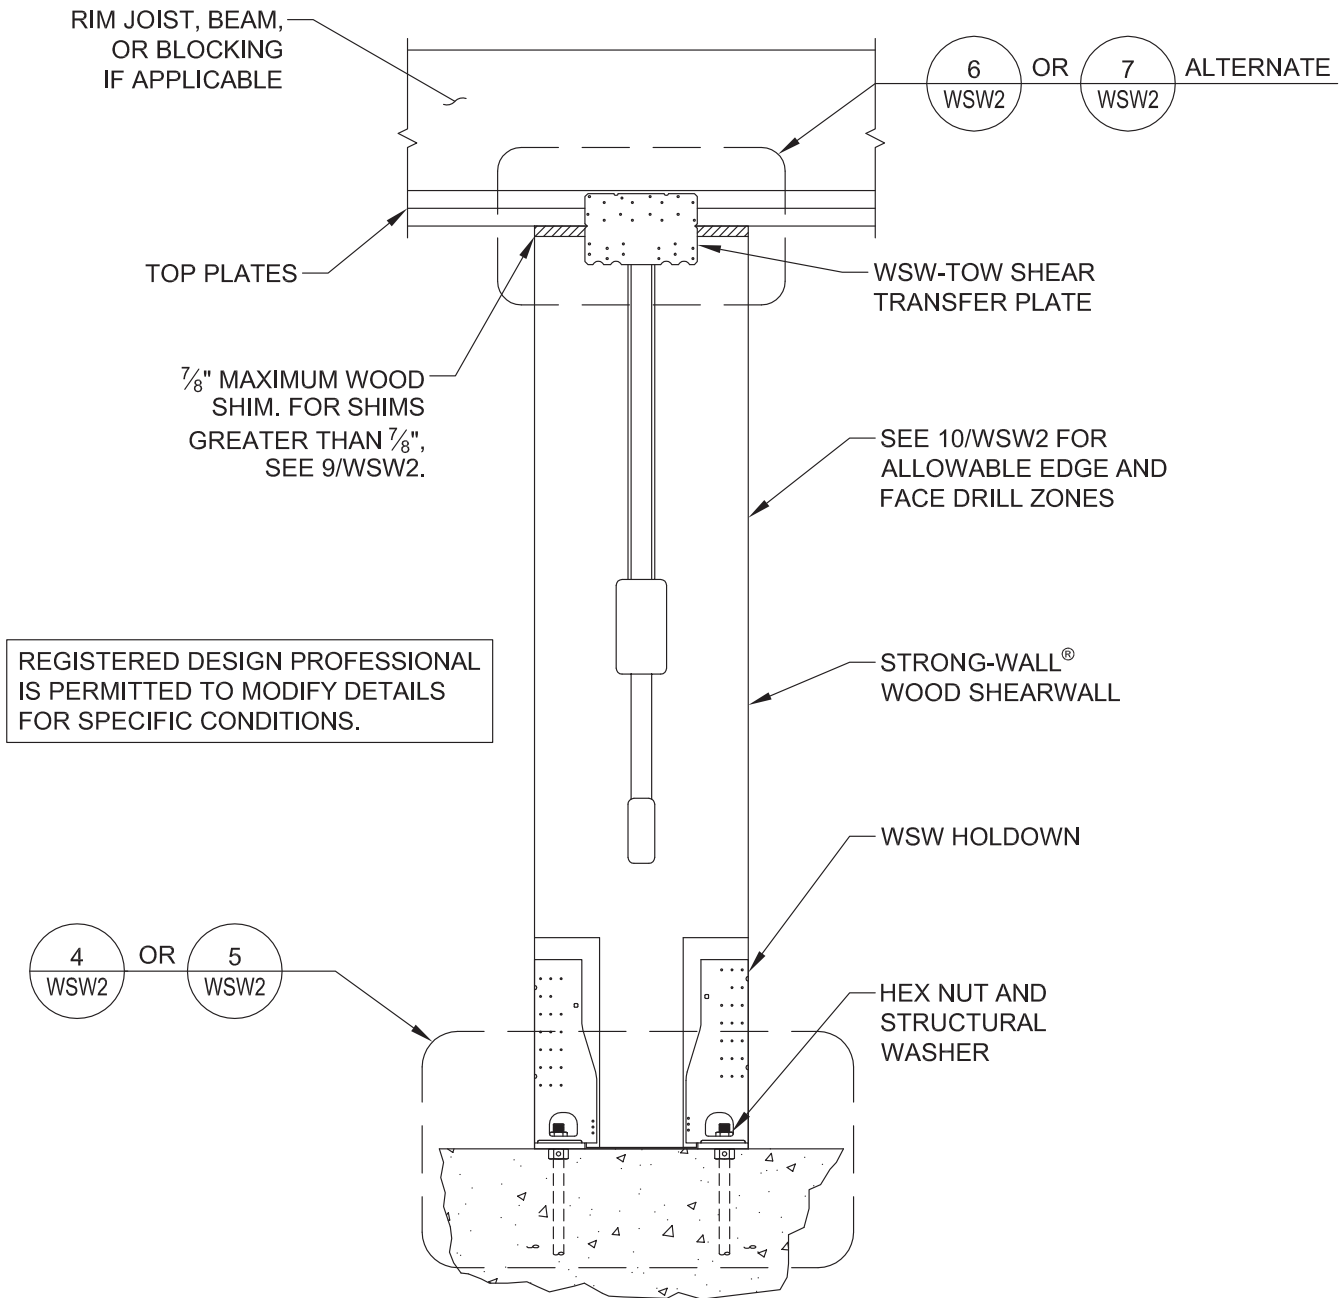


WSW DESIGNED TO PROVIDE 1/8" GAP BETWEEN LSL AT BASE OF WSW AND CONCRETE. ENSURE CONCRETE IS LEVEL AND SMOOTH BENEATH PANEL. GRIND OR FILL AS NECESSARY.



# Installation Details

GARAGE HEADER ROUGH OPENING HEIGHT		
MODEL NO.	H CURB	ROUGH OPENING HEIGHT
WSW12x7 WSW18x7 WSW24x7	5½"	6'-11½"
	6"	7'-0"
WSW12x7.5 WSW18x7.5 WSW24x7.5	0"	7'-1½"
WSW12x8 WSW18x8 WSW24x8	5½"	8'-2¾"
	6"	8'-3¼"


1. IF REQUIRED ROUGH OPENING HEIGHT EXCEEDS TABLE VALUE, SPECIFY NEXT TALLER PANEL AND TRIM AS NECESSARY. THE STRONG-WALL® WOOD SHEARWALL MAY BE TRIMMED TO A MINIMUM HEIGHT OF 74½".
2. FURRING DOWN GARAGE HEADER MAY BE REQUIRED FOR CORRECT ROUGH OPENING HEIGHT.

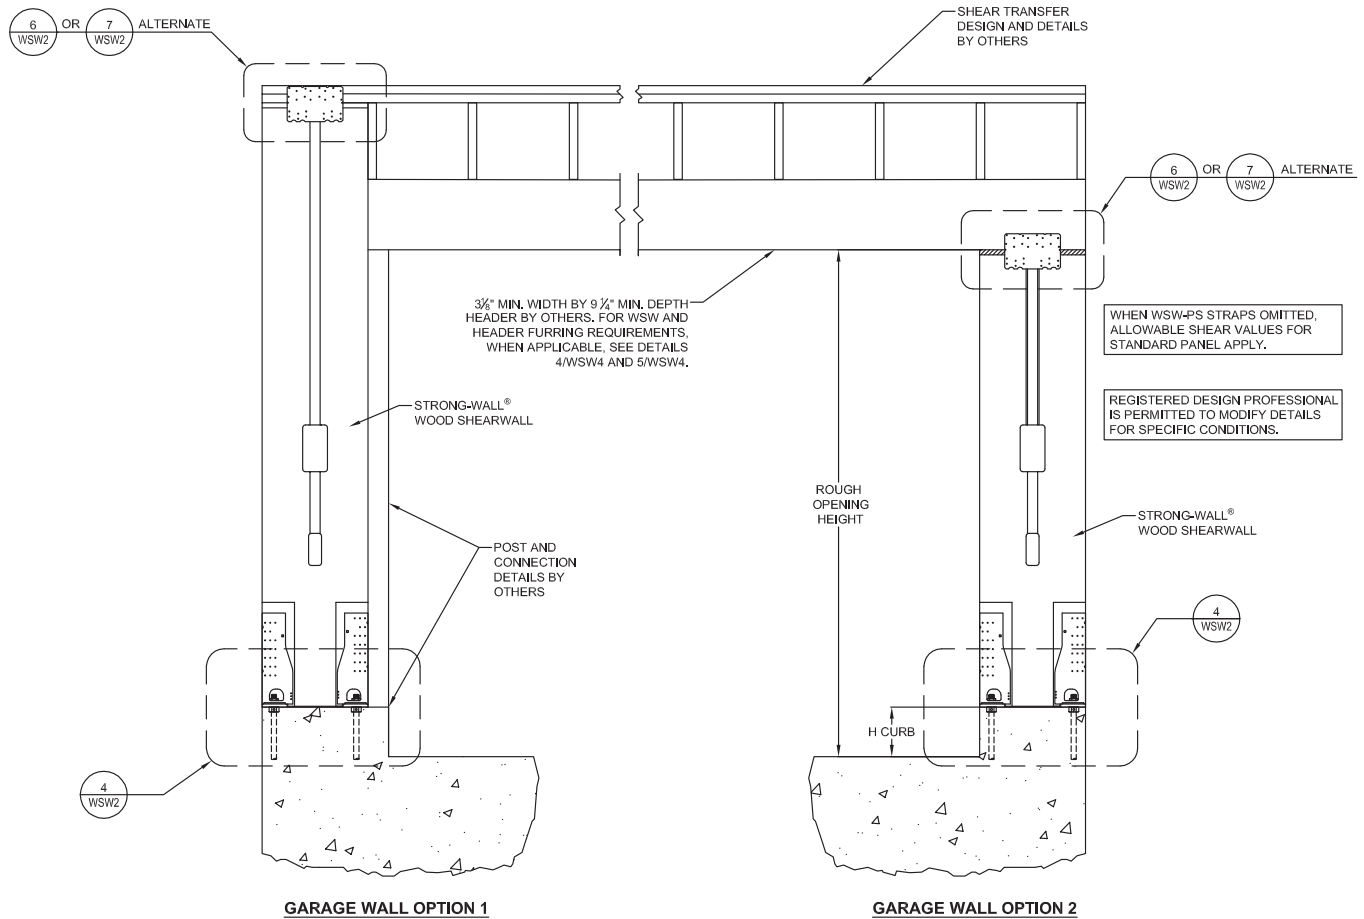

FOR GARAGE WALL OPTION 2, REGISTERED DESIGN PROFESSIONAL SHALL DESIGN AND DETAIL FOR:


1. SHEAR TRANSFER
2. OUT-OF-PLANE LOADING EFFECT
3. INCREASED OVERTURNING AND DRIFT DUE TO ADDITIONAL HEIGHT

# Installation Details

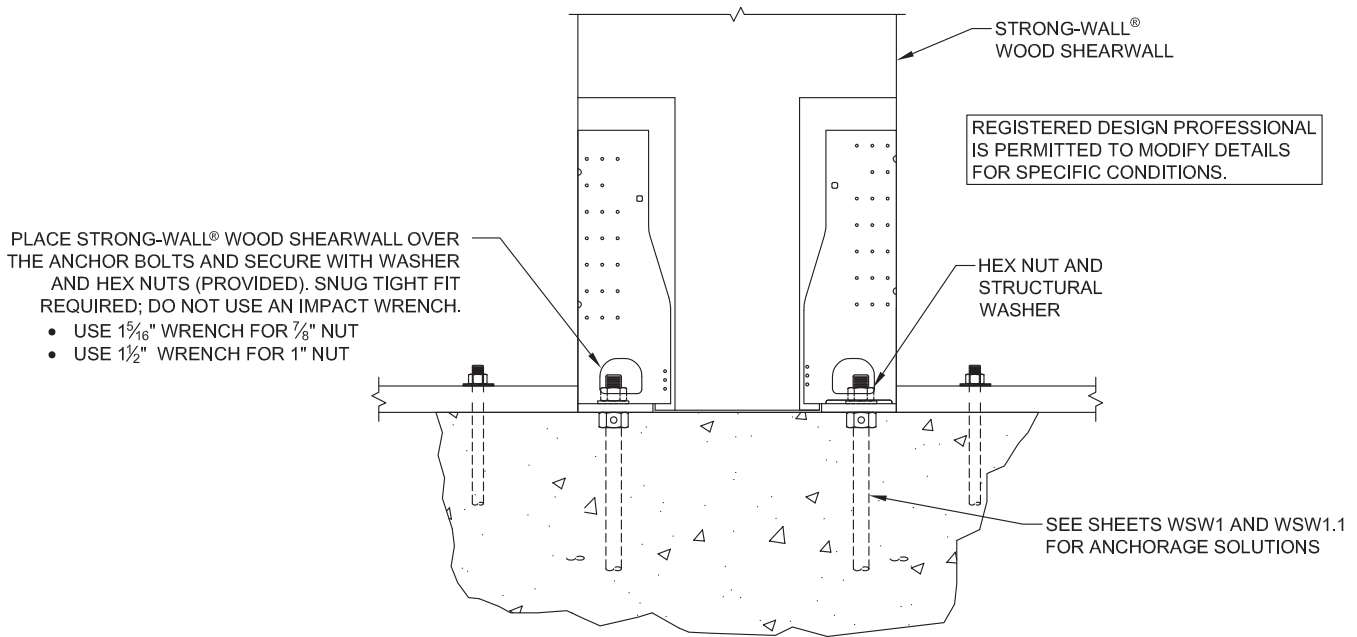

## STANDARD INSTALLATION BASE CONNECTION


4/WSW2

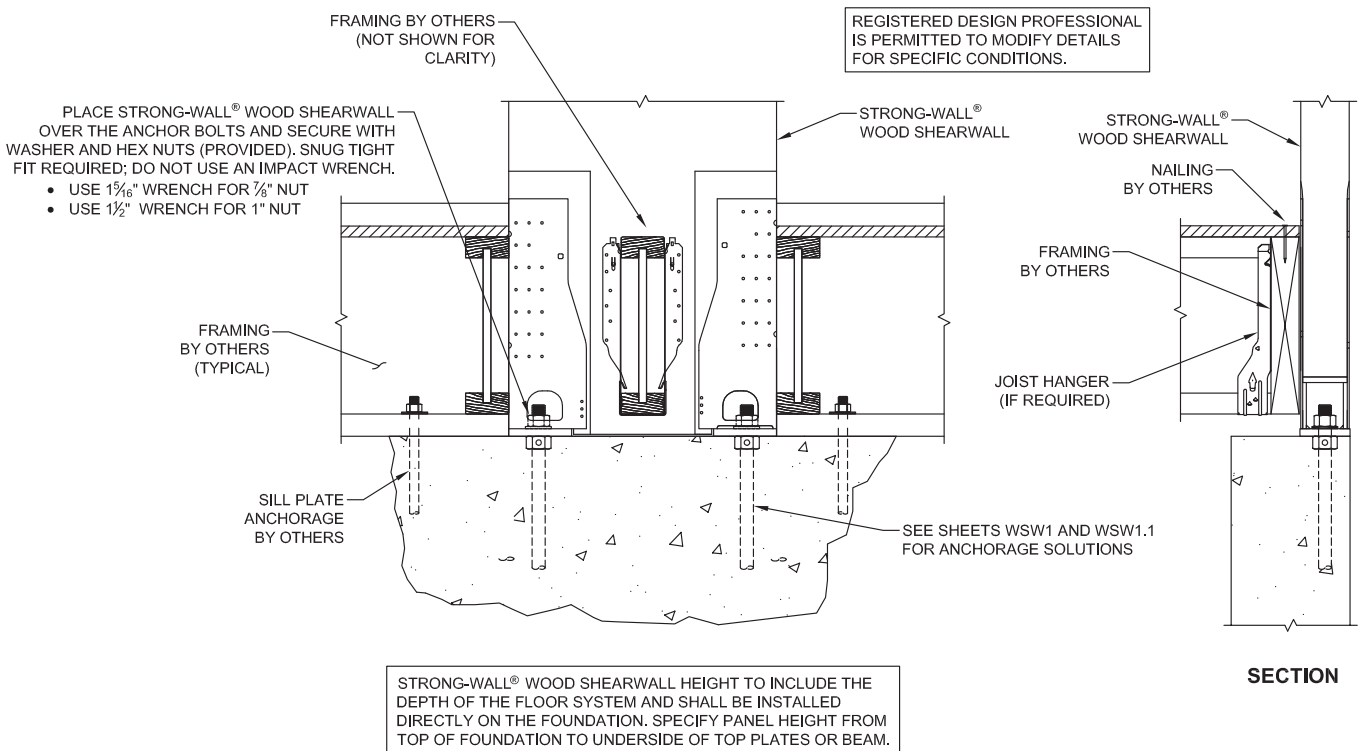

## WOOD FLOOR SYSTEM BASE CONNECTION

5/WSW2


# Installation Details

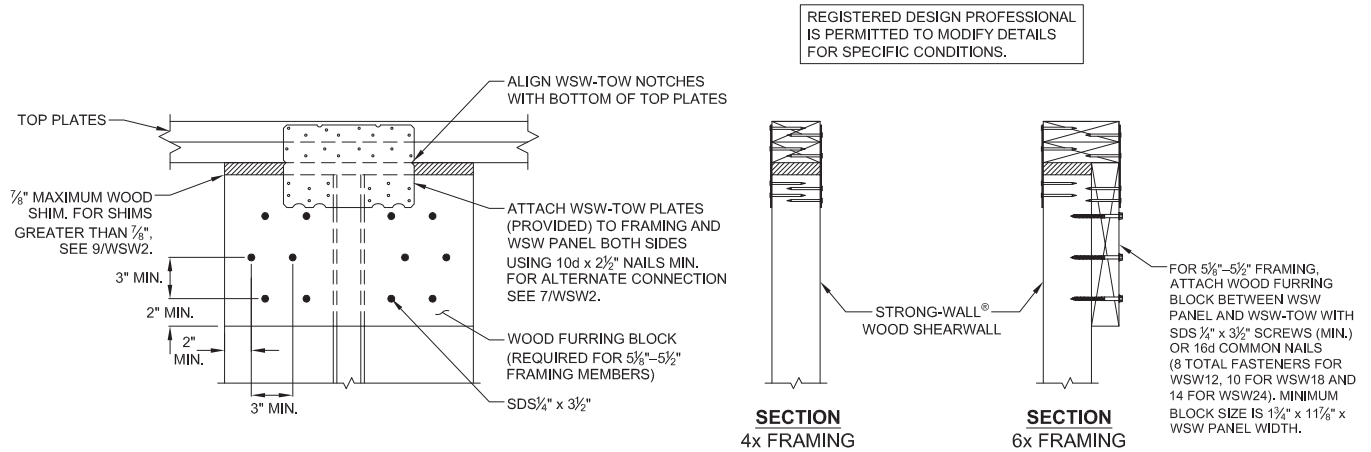

STANDARD TOP CONNECTION

6/WSW2

WSW-TOW ALTERNATE CONNECTION KIT		
MODEL NO.	FASTENER QUANTITY	
	SD #10 x 1 1/2"	SDS 1/4" x 6"
WSW-TOW12KT	20	2
WSW-TOW18KT	28	4
WSW-TOW24KT	40	8

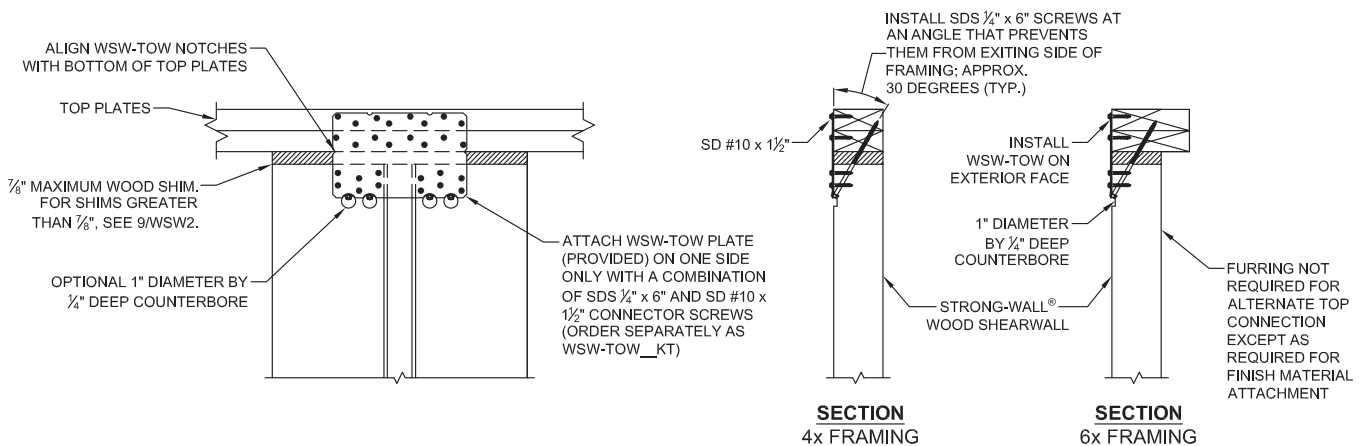

ALTERNATE TOP CONNECTION

7/WSW2

# Installation Details



REGISTERED DESIGN PROFESSIONAL  
IS PERMITTED TO MODIFY DETAILS  
FOR SPECIFIC CONDITIONS.

INSTALL SDS 1/4" x 6" SCREWS (ORDER  
SEPARATELY). INSTALL IN 2 ROWS AS  
SHOWN AND COUNTERSINK AS REQUIRED.



QTY. OF SDS 1/4" x 6" SCREWS REQ'D.	
WSW12	4
WSW18	8
WSW24	12

EDGE DISTANCE FOR SCREWS		
SLOPE	A (IN.)	B (IN.)
0:12-4:12	2	3
5:12-8:12	1 1/2	4 1/2
9:12-12:12	1/2	5 1/2

1. MAINTAIN END DISTANCES TO PREVENT SCREWS FROM PENETRATING THROUGH THE OUTER EDGES.
2. INSTALL SCREWS PERPENDICULAR TO THE TOP PLATE.
3. EDGE DISTANCES ASSUME DOUBLE TOP PLATE.

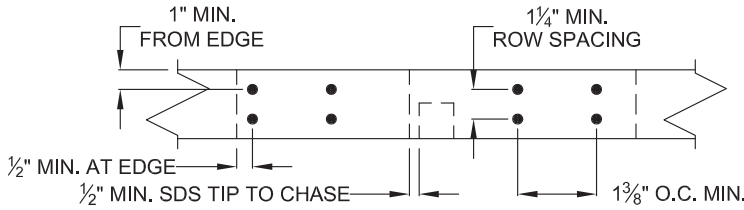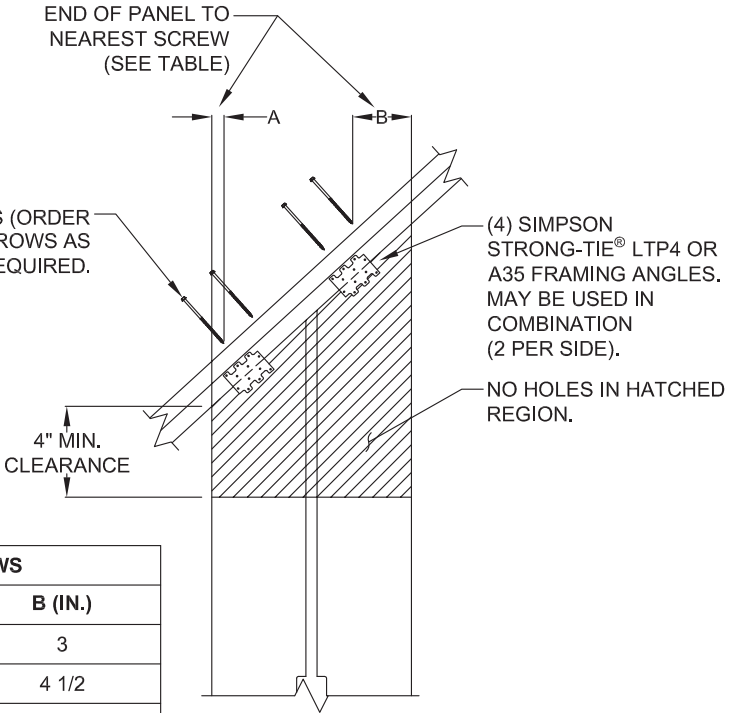



**PLAN VIEW**  
SDS SCREW SPACING

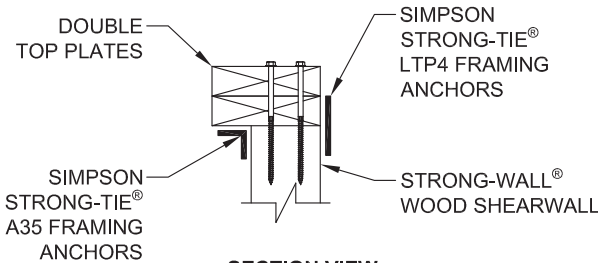

**SECTION VIEW**  
2X6 OR WIDER FRAMING


- INSTALLATION NOTES :
1. ACTUAL CUT LENGTH (L) MUST BE GREATER THAN OR EQUAL TO PANEL WIDTH (W).
  2. THIS DETAIL APPLICABLE FOR SLOPES UP TO 12:12.
  3. PANELS TALLER THAN 12' MUST BE DESIGNED FOR THE APPLICATION.

# Installation Details

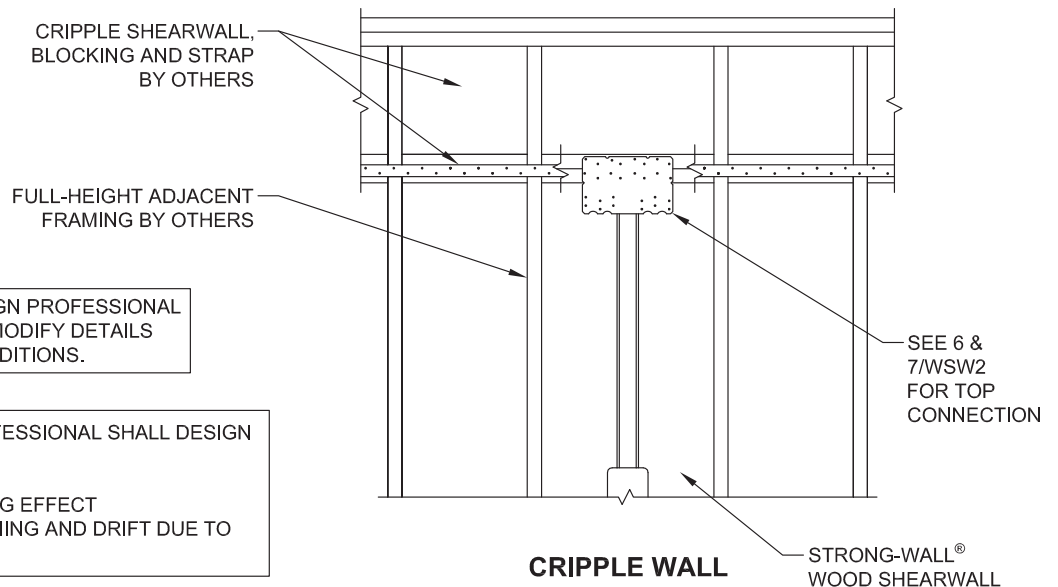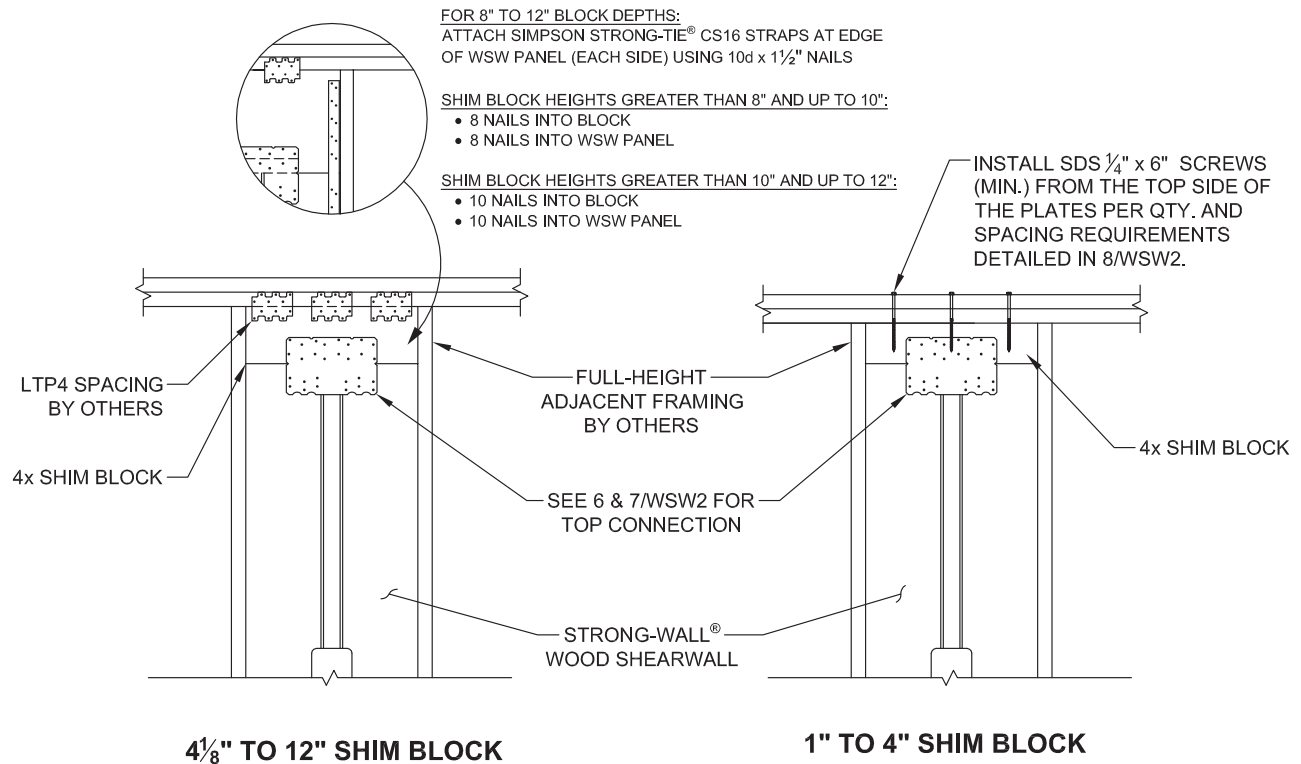




# Installation Details

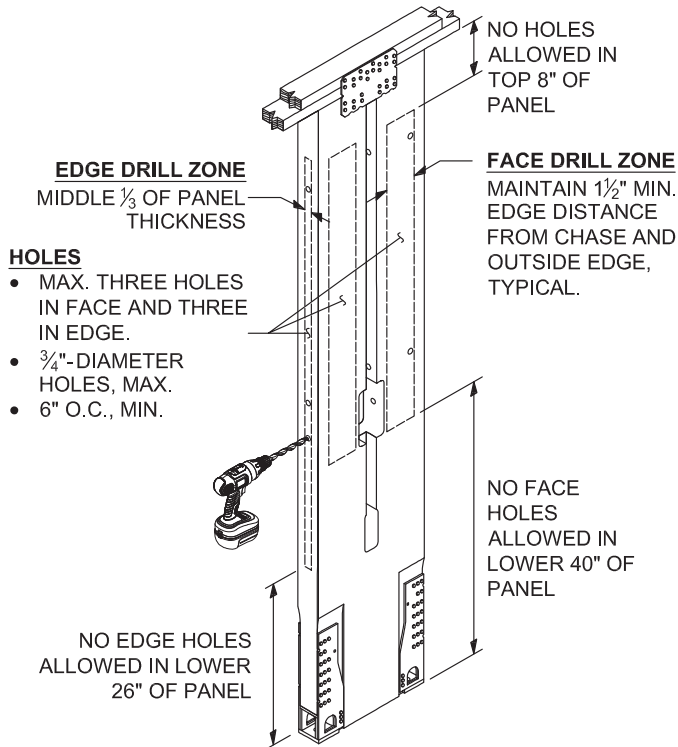


**ALLOWABLE SMALL HOLES**  
FACE AND EDGE DRILL ZONES

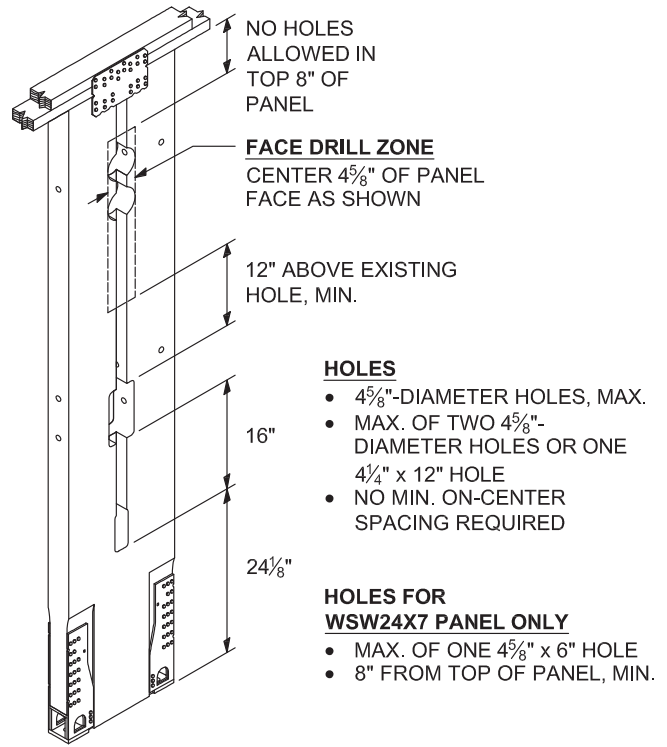

**ALLOWABLE LARGE HOLES**  
IN ADDITION TO ALLOWABLE SMALL HOLES

# Installation Details

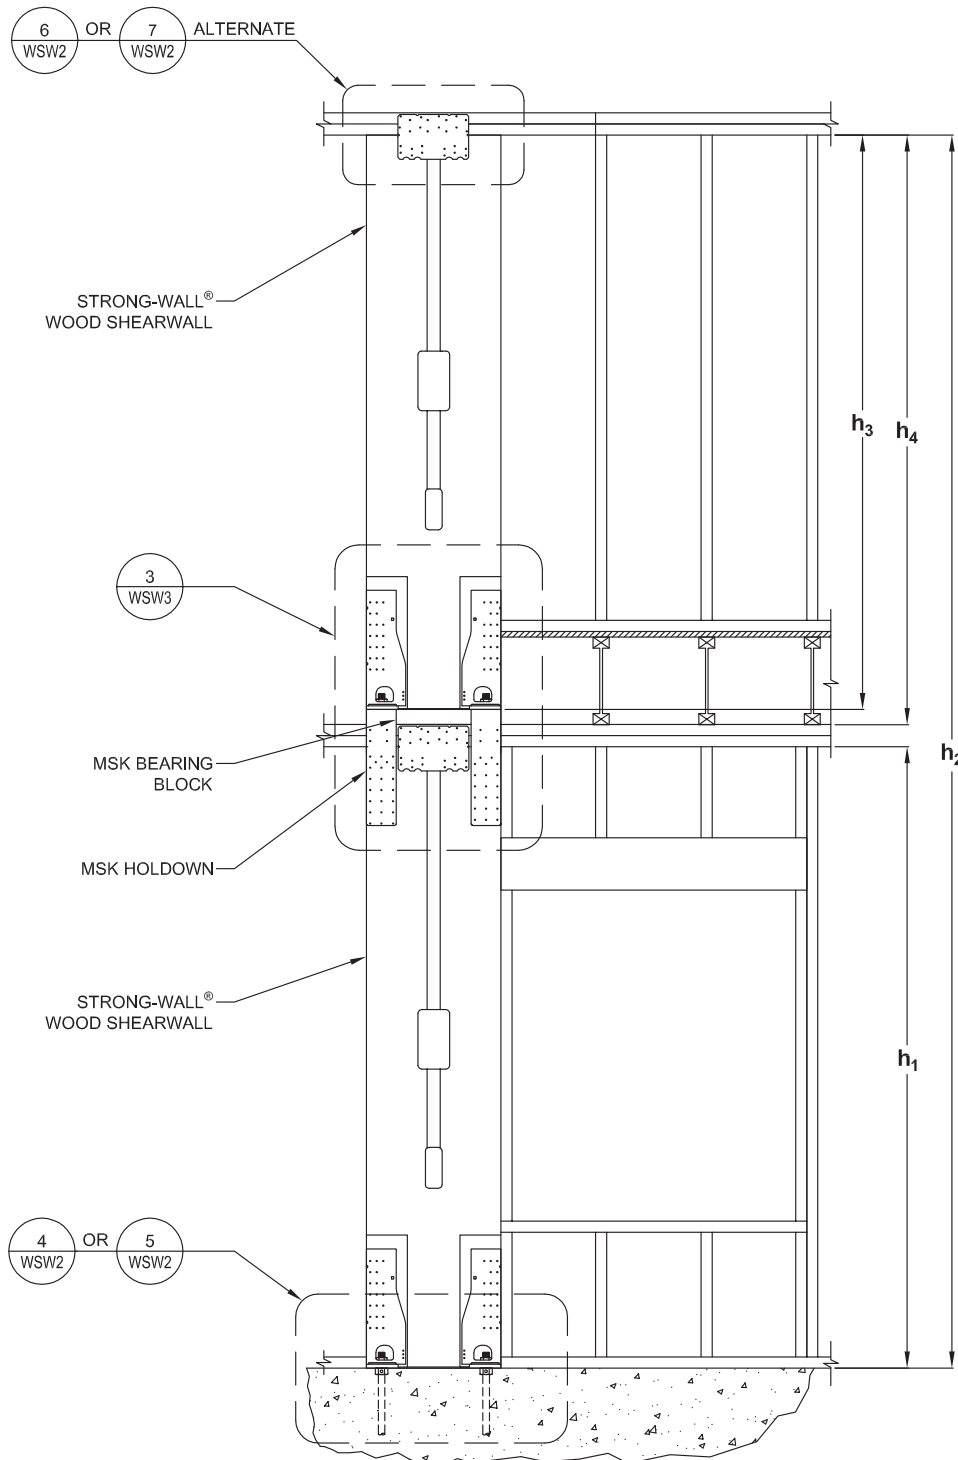
**NOTES:**

- 1<sup>ST</sup> STORY WSW MUST BE THE SAME WIDTH AS THE 2<sup>ND</sup> STORY WSW.
- JOIST AND SHEATHING MAY BE ATTACHED TO WSW WITH JOIST HANGER AND LEDGER. LOAD TRANSFER IS THE RESPONSIBILITY OF THE DESIGN PROFESSIONAL OF RECORD.
- WSW MULTI-STORY KIT (MSK) INCLUDES MSK BEARING BLOCK AND MSK HOLDOWN.

**LEGEND:**

- $h_1$  = 1<sup>ST</sup> STORY WSW HEIGHT; TOP OF CONCRETE TO UNDERSIDE OF 1<sup>ST</sup> STORY TOP PLATES (IN.)
- $h_2$  = TOTAL ASSEMBLY HEIGHT; TOP OF CONCRETE TO UNDERSIDE OF 2<sup>ND</sup> STORY TOP PLATES (IN.)
- $h_3 = h_4 - 2" = 2^{\text{ND}}$  STORY WSW HEIGHT; TOP OF BEARING BLOCK TO BOTTOM OF 2<sup>ND</sup> STORY TOP PLATES (IN.)
- $h_4$  = TOP OF 1<sup>ST</sup> STORY TOP PLATES TO UNDERSIDE OF 2<sup>ND</sup> STORY TOP PLATES (IN.)

REGISTERED DESIGN PROFESSIONAL IS PERMITTED TO MODIFY DETAILS FOR SPECIFIC CONDITIONS.


C-L-SW17 ©2017 SIMPSON STRONG-TIE COMPANY INC.

TWO-STORY STACKED ELEVATION

2/WSW3


# Installation Details

FOR 2X6 AND WIDER WALL FRAMING,  
CUT SLOTS IN TOP PLATES TO ALLOW  
MSK HOLDOWN TO PASS THROUGH. DO  
NOT NOTCH DOUBLE TOP PLATE.

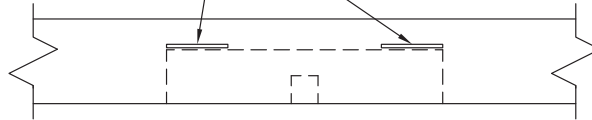


**PLAN VIEW**  
6x FRAMING

REGISTERED DESIGN PROFESSIONAL  
IS PERMITTED TO MODIFY DETAILS  
FOR SPECIFIC CONDITIONS.

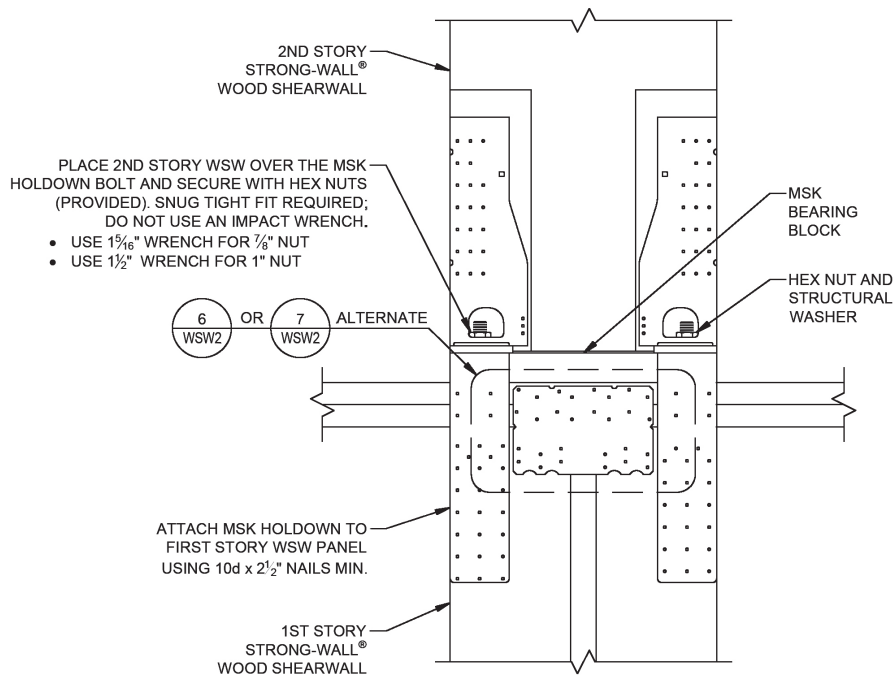


**SECTION**  
4x FRAMING:  
SEE 6 & 7/WSW2  
FOR CONNECTION  
DETAILS



**SECTION**  
6x FRAMING:  
SEE 7/WSW2  
FOR CONNECTION  
DETAILS


# Installation Details

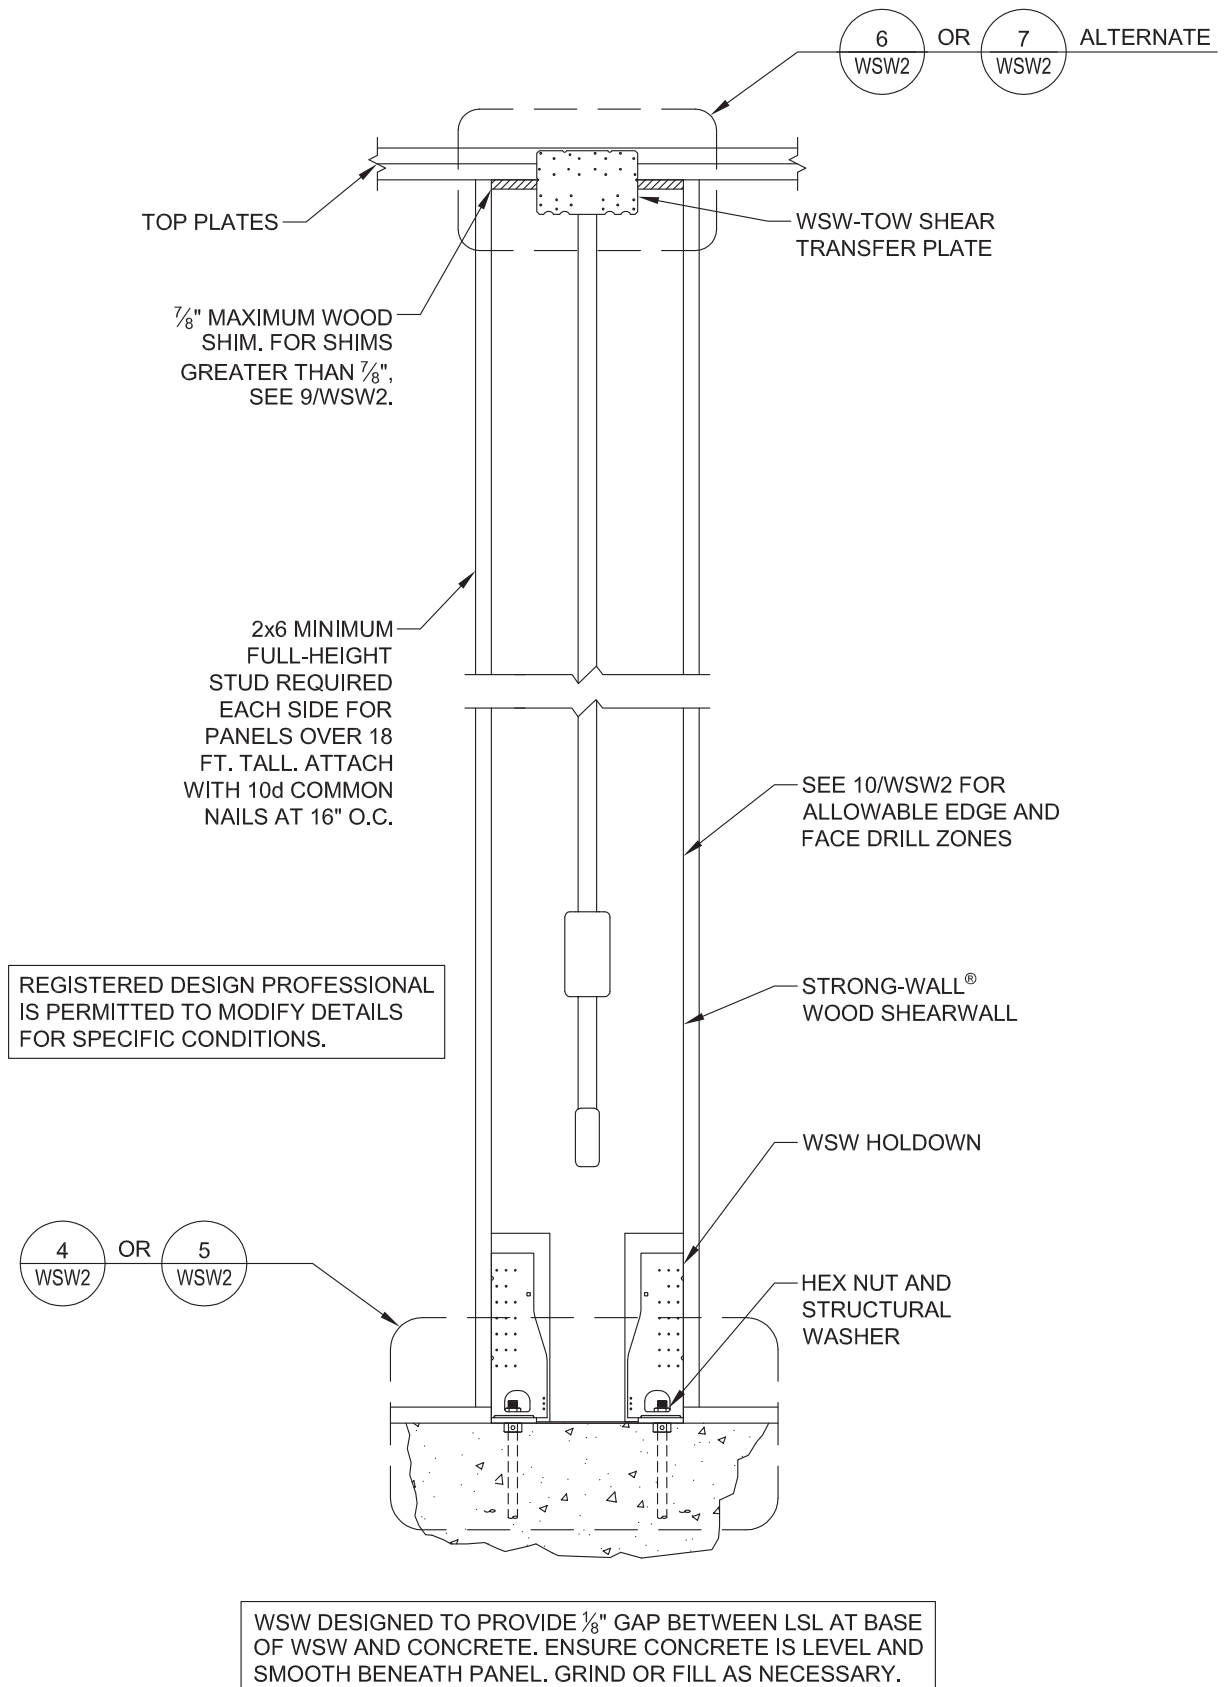

C-L-SW17 ©2017 SIMPSON STRONG-TIE COMPANY INC.

Anchorage and Installation Details

# Installation Details

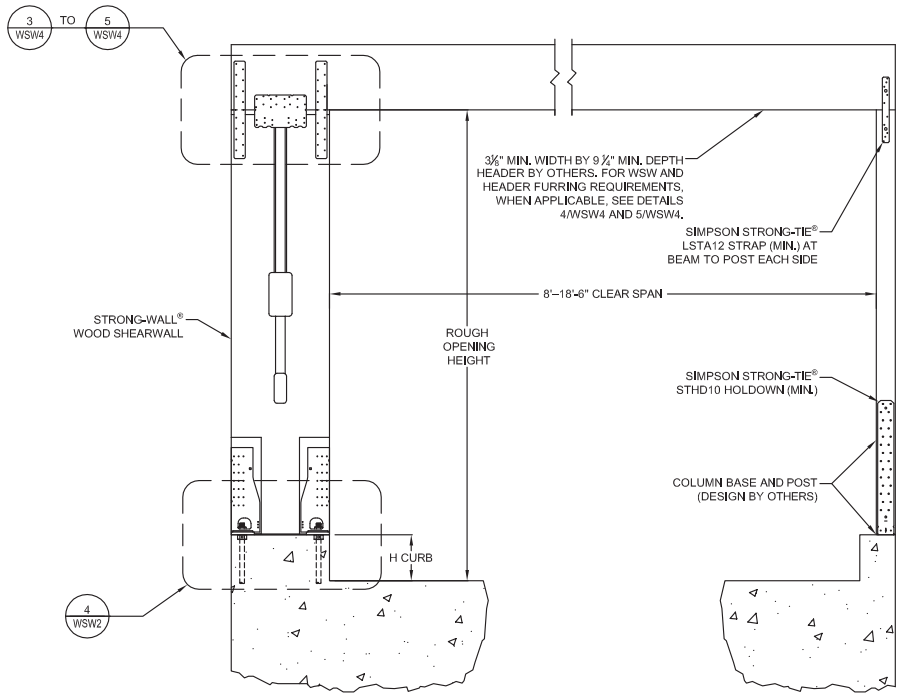

GARAGE HEADER ROUGH OPENING HEIGHT		
MODEL NO.	H CURB	ROUGH OPENING HEIGHT
WSW12x7 WSW18x7 WSW24x7	5 1/2"	6'-11 1/2"
	6"	7'-0"
	0"	7'-1 1/2"
WSW12x8 WSW18x8 WSW24x8	5 1/2"	8'-2 3/4"
	6"	8'-3 1/4"


1. IF REQUIRED ROUGH OPENING HEIGHT EXCEEDS TABLE VALUE, SPECIFY NEXT TALLER PANEL AND TRIM AS NECESSARY, THE STRONG-WALL® WOOD SHEARWALL MAY BE TRIMMED TO A MINIMUM HEIGHT OF 74 1/2".
2. FURRING DOWN GARAGE HEADER MAY BE REQUIRED FOR CORRECT ROUGH OPENING HEIGHT.

REGISTERED DESIGN PROFESSIONAL  
IS PERMITTED TO MODIFY DETAILS  
FOR SPECIFIC CONDITIONS.

WSW DESIGNED TO PROVIDE 1/8" GAP BETWEEN LSL AT BASE  
OF WSW AND CONCRETE. ENSURE CONCRETE IS LEVEL AND  
SMOOTH BENEATH PANEL, GRIND OR FILL AS NECESSARY.

## STRONG-WALL® WOOD SHEARWALL SINGLE PORTAL ASSEMBLY

1/WSW4

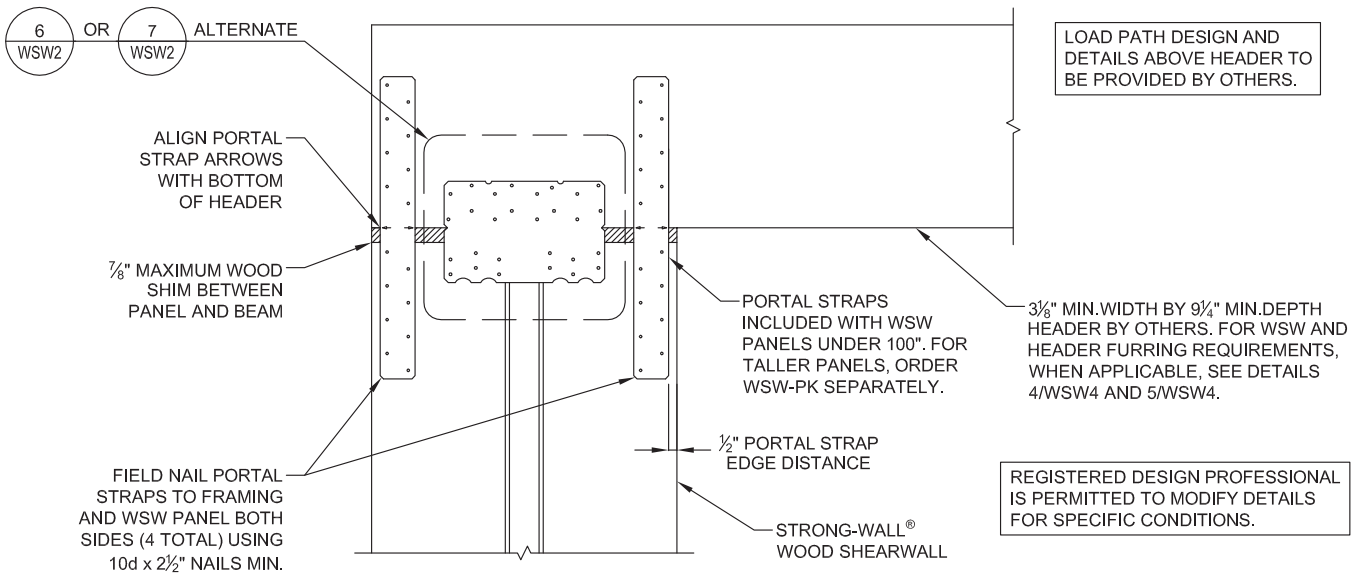


## PORTAL TOP CONNECTION

3/WSW4




# Installation Details

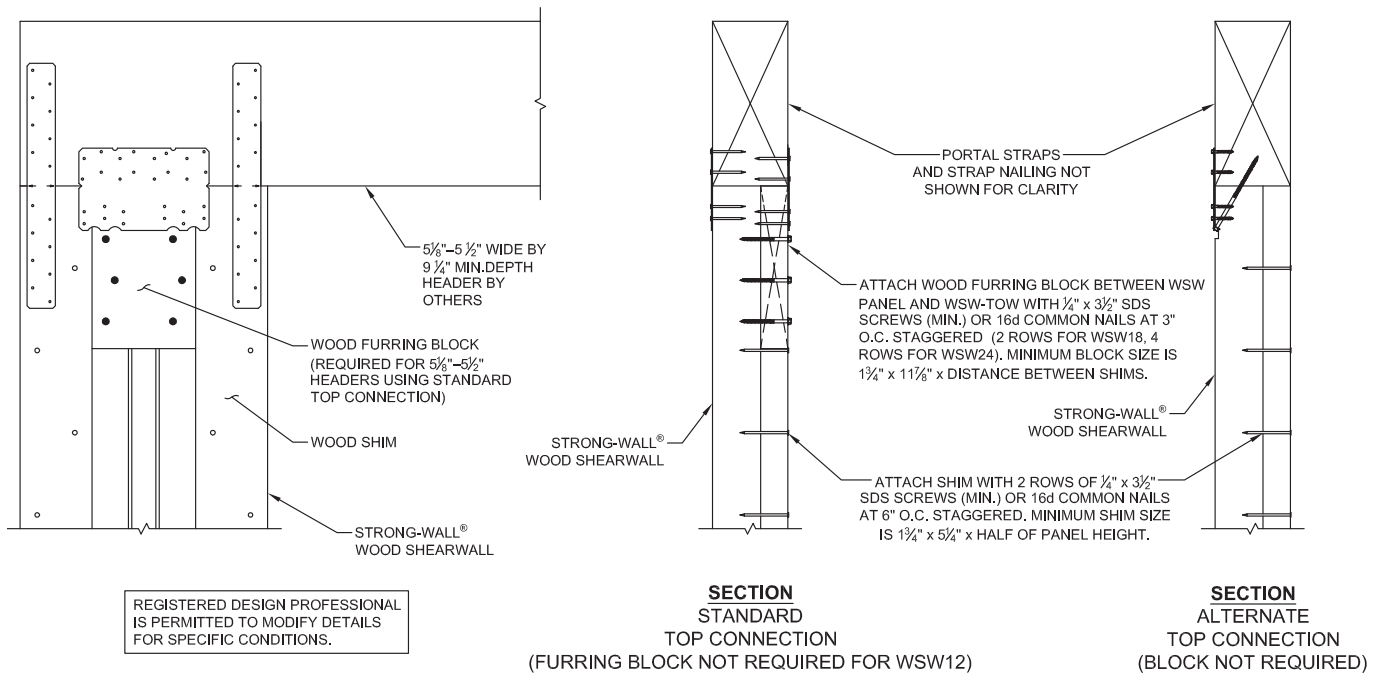

FURRING FOR 5 1/8" TO 5 1/2" HEADER

4/WSW4

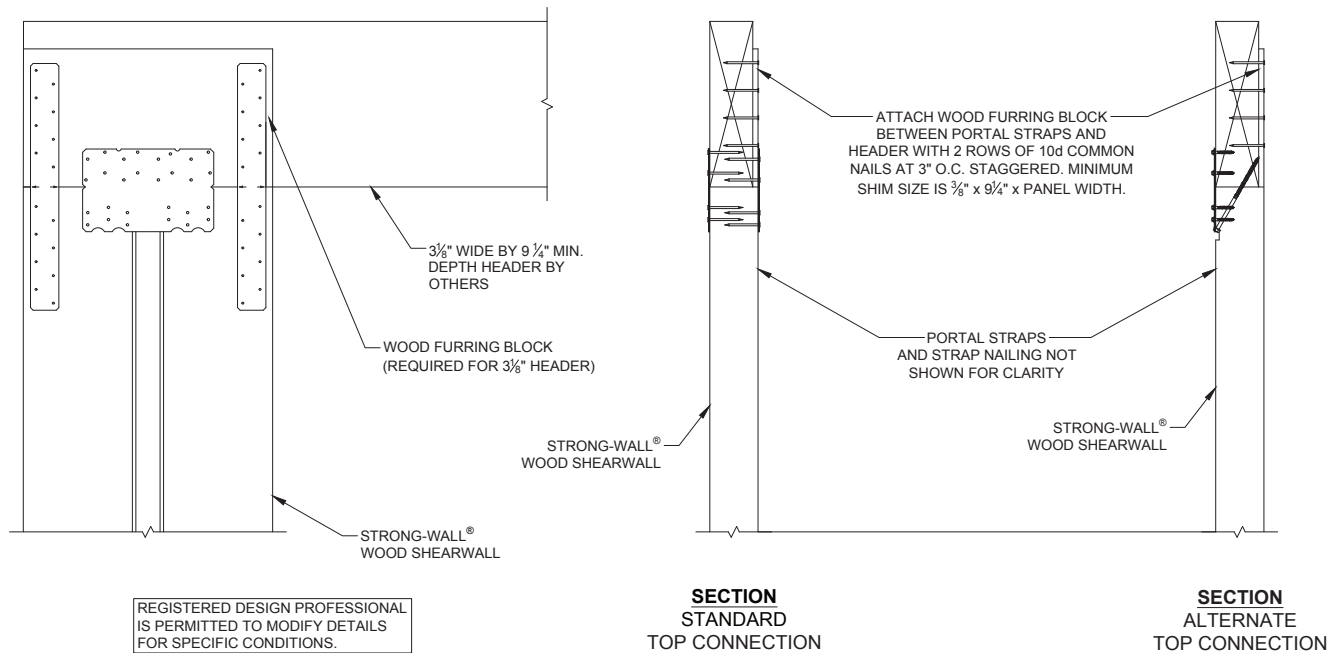

FURRING FOR 3 1/8" HEADER

5/WSW4

## Notes





## Notes







## Notes





Every day we work hard to earn your business, blending the talents of our people with the quality of our products and services to exceed your expectations. This is our pledge to you.

**Home Office**

5956 W. Las Positas Boulevard  
Pleasanton, CA 94588  
Tel: (925) 560-9000  
Fax: (925) 847-1603

**Southeast USA**

2221 Country Lane  
McKinney, TX 75069  
Tel: (972) 542-0326  
Fax: (972) 542-5379

**Northwest USA**

5151 S. Airport Way  
Stockton, CA 95206  
Tel: (209) 234-7775  
Fax: (209) 234-3868

**Eastern Canada**

5 Kenview Boulevard  
Brampton, ON L6T 5G5  
Tel: (905) 458-5538  
Fax: (905) 458-7274

**Southwest USA**

12246 Holly Street  
Riverside, CA 92509  
Tel: (714) 871-8373  
Fax: (951) 369-2889

**Western Canada**

11476 Kingston Street  
Maple Ridge, B.C. V2X 0Y5  
Tel: (604) 465-0296  
Fax: (604) 465-0297

**Northeast USA**

2600 International Street  
Columbus, OH 43228  
Tel: (614) 876-8060  
Fax: (614) 876-0636

**Distribution Centers**

Chandler, AZ; Eagan, MN;  
Enfield, CT; High Point, NC;  
Houston, TX; Jacksonville, FL;  
Kansas City, KS; Kent, WA;  
Jessup, MD

**International Facilities**

Please visit our website for address and contact information for our European facilities.

**(800) 999-5099**  
**strongtie.com**

# Simplify the process.



## Select the right shearwall with the **Strong-Wall®** Shearwall Selector.

The Simpson Strong-Tie® Shearwall Selector web application helps designers choose shearwall solutions based on usage and building code. The web app complies with the 2015 International Building Code and includes our new Strong-Wall® wood shearwall.

For more information, call (800) 999-5099 or visit [strongtie.com/swss](http://strongtie.com/swss).

**SIMPSON**  
**Strong-Tie**

®